



STATE OF MAINE
DEPARTMENT OF HEALTH AND HUMAN SERVICES
DIVISION OF HEALTH ENGINEERING
286 WATER STREET
AUGUSTA, MAINE
04333-0011

John Elias Baldacci
Governor

June 27, 2005

John R. Nicholas
Commissioner

Ecological Tanks, Inc.
Attn.: Calvin Locker, R.S.
401 Valley View Drive
Edwardsville, IL 62025

Subject: Product Registration, Aqua Aire

Dear Mr. Locker:

The Division of Health Engineering has completed a review of a registration application for your company's product. This information was submitted pursuant to Section 1802 of the Maine State Plumbing Code, Subsurface Wastewater Disposal Rules (Rules), for code registration, for use in Maine.

Product Description

The Aqua Aire consists of aerated extended treatment tanks with integral conical clarifiers. The Aqua Aire is available in 500 gallon, 600 gallon, 750 gallon, 800 gallon, 1,000 gallon, 1,250 gallon, and 1,500 gallon capacities with corresponding model designations. Various specialty models (such as with integral pre-treatment) are also included under these model designations (ref.: Aqua Aire operation manual dated 2002). Treated 30 day average effluent levels of CBOD₅ are less than 3 mg/l and TSS are less than 5 mg/l, each.

Claim

According to the information you provided, the Aqua Aire has received National Sanitation Foundation Standard 40 approval. The Aqua Aire qualifies for a 0.5 adjustment factor for disposal area sizing under Table 603.1 of the Subsurface Wastewater Disposal Rules.

Determination

On the basis of the information and sample product submitted, the Division has determined that the Aqua Aire is acceptable for use in the State of Maine, provided that it is installed, operated, and maintained in conformance with the manufacturer's directions.

In the event that the product fails to perform as claimed by the applicant, use of the new or experimental technology in Maine, including all installations approved pursuant to Section 1801.7 of the Rules, shall cease. Use of the new or experimental technology shall not resume until the applicant and the Division have reached a mutually acceptable agreement for resolving the failure to perform as claimed.

Because installation and owner maintenance has a significant effect on the working order of onsite sewage disposal systems, including their components, the Division makes no representation or guarantee as to the efficiency and/or operation of Aqua Aire. Further, registration of this product for use in the State of Maine does not represent Division preference or recommendation for this product over similar products.

If you have any questions please feel free to contact me at (207) 287-5695.

Sincerely,

James A. Jacobsen, Environmental Specialist IV
Wastewater and Plumbing Control Program
Division of Health Engineering
e-mail: james.jacobsen@state.me.us

/jaj

xc: Product File



ECOLOGICAL TANKS, INC.

Makers of

AQUA SAFE®
Wastewater Treatment

and

AQUA AIRE®
Wastewater Treatment

2247 Hwy. 151 N. • Downs ville, LA 71234 • (318) 644-0397 • Fax (318) 644-7257

June 2, 2005

RECEIVED

Mr. James A. Jacobsen
Environmental Specialist IV
Department of Human Services
Bureau of Health
Div. of Health Engineering
Wastewater & Plumbing Program
286 Water Street
Augusta, Maine 04330

JUN 03 2005

WASTEWATER &
PLUMBING PROGRAM

Subject: Request for approval of the Aqua Safe and Aqua Aire wastewater treatment plants


Dear Mr. Jacobsen:

Enclosed are the applications and supporting documents for registration of both the Aqua Safe and Aqua Aire wastewater treatment plants. Each treatment plant includes several plant capacities from 500 to 1500 gpd, in addition to various modifications of each size, such as the addition of pretreatment chambers, chlorine contact chambers and pump chambers. These are listed in the enclosed technical manuals, as well as the official NSF listing, which is included with the packet.

Also included are the respective Performance Testing and Evaluation Certification Reports for both the Aqua Safe and Aqua Aire plants, as well as additional testing on both plants to determine nutrient removal capabilities. If you need any additional information, please contact me at 401 Valley View Drive, Edwardsville, IL 62025, (phone: 618-659-1367)

I look forward to hearing from you in the near future.

Sincerely,


Calvin Locker, R.S.
National Sales Director

ECOLOGICAL TANKS, INC.
AQUA SAFE® & AQUA AIRE®

2247 Hwy. 151 North • Downs ville, LA 71234

"Changing the shape of Advanced Aerobic Treatment Systems"™

CALVIN LOCKER, R.S.
National Sales Director
401 Valley View Drive
Edwardsville, IL 62025

Office: 618-659-1367
Fax: 618-659-1361
Cell: 618-910-0227
etiaquasafe.com

Email: calvinlocker@sbcglobal.net





**Maine Department of Health and Human Services
Bureau of Health
Division of Health Engineering
Wastewater and Plumbing Control Program**

**APPLICATION FOR REGISTRATION OF
EXPERIMENTAL SYSTEM/INNOVATIVE TECHNOLOGY
OR ONSITE SEWAGE DISPOSAL SYSTEM PRODUCT**

Please complete the following Sections. Please print or type.

Applicant

Company Name: Ecological Tanks, Inc.
 Contact Person: George Johnson
 Address: 2247 Hwy 151 N.
 Town/City: Downsville State/Province: LA Zip Code: 71234
 Country: USA
 Telephone: 318-644-0397 e-mail: agua safe @ kayou.com

Product

Product Name: Agua - Aire
 Model: AA 500, AA 600, AA 750, AA 800, AA 1000, AA 1200, AA 1500
Also, all modifications of above as listed on NSF listing.

Product Classification (choose one)

Primary or Secondary Treatment Unit

- Septic Tank Extended Aerobic Treatment Unit Recirculating Aerobic Unit
 Aerobic Fixed Film Unit Other (specify) _____

Effluent Filter

- Septic Tank Outlet Filter Post-Tank Filter Other (specify) _____

Disposal Device

- Gravel-less Disposal Pipe Gravel-less Disposal Bed Chamber, Plastic
 Chamber, Other Other (specify) _____

Miscellaneous

- Pipe Effluent Flow Distribution Device Other (specify) _____

and, about, 1940-1941
... ..
... ..
... ..
... ..
... ..

... ..
... ..
... ..
... ..

Claim

Describe the product's features (attach additional sheets if necessary).

See attached process description

Describe the product's performance (attach additional sheets if necessary).

See attached copies of NSF Standard 40
Test Results (testing was done at Baylor Univ.)

Also attached are test results for
nitrogen removal

Has the product received National Sanitation Foundation or Canadian Standards Authority approval?

No Yes (If "yes", enclose a copy of the certification.)

IMPORTANT NOTE!

Don't forget to enclose relevant product literature, engineering specifications, studies, and third party certifications with this application.

I, Calvin Locker, am the applicant agent for the applicant of the subject product.
(print name)

I state that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Department to deny registration for use of the product in Maine.

Calvin Locker

Signature of Applicant
 Signature of Agent for Applicant

6/2/05
Date

Handwritten text at the top of the page, possibly a title or header.


Main body of handwritten text, consisting of several lines of cursive script.

Handwritten text at the bottom of the page, possibly a signature or footer.

Aqua Aire® Aerobic Treatment Unit

Narrative Description

The Aqua Aire® series of advanced aerobic treatment units are designed to treat domestic wastewater from residential homes, multiple homes, or light commercial applications. The wastewater is treated by the patented Aqua Aire® process and the highly treated effluent is disposed of per state regulations by multiple disposal applications.

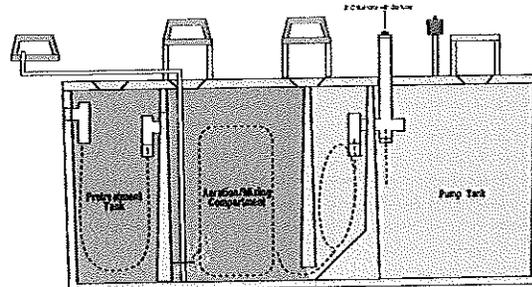

The Aqua Aire® individual home sewage treatment system is an inexpensive self-contained wastewater treatment system that features an extended aeration activated sludge process which reduces sewage to an odorless safe discharge in 24 hours. Aqua Aire® was tested according to requirements listed in A.N.S.I./N.S.F. Standard #40 and meets or exceeds Class 1 characteristic requirements. Aqua Aire® is listed by NSF.

Aqua Aire® series of treatment units are constructed out of concrete. Aqua Aire® A.T.U.'s are available in 500gpd-1500gpd with optional add-on configurations to assist with ease of installations.

Pre-treatment tank-This is an optional item on the Aqua Aire® unit unless state code dictates otherwise. The pre-treatment tank is equipped with a discharge baffle extending vertically down into the liquid set to draw between the floatable and settleable solids. This is set to where larger solids will not pass through to the mixing zone due to peak hydraulic loading periods. There are Aqua Aire® models with pre-treatment tanks laminated to the A.T.U. for ease of installation.

Aeration or mixing zone-The Aqua Aire® series utilizes an extended aeration activated sludge process which effectively treats the effluent by distributing free dissolved oxygen into the mixed liquor in the aeration zone. This is accomplished by a compressor blowing air to a diffuser centrally located on the front side of the aeration chamber. Air is diffused out of multiple orifices in $\frac{3}{4}$ " Sch. 40 pipe and is deflected off fiberglass disks. As the air bubbles rise up through the process fluid, it creates a rolling action which enhances the mixing of the oxygen with wastewater. This process allows aerobic bacteria and other microorganisms to convert the soluble organic material in the wastewater into new cell mass. As the number of organisms increase, they clump together, forming a floc, or biomass, which in turn, entraps additional organic matter for further treatment.



As the effluent exits the system through the clarifier, the organic solids (floc) settle down through the quiescent zone of the clarifier, back into the aeration chamber. The extended aeration retention time in the **Aqua Aire®** 500 gpd unit is quite generous at 26.8 hours.

During periods of low flows through the treatment plant, organisms in the system consume other microorganisms as an energy source, thereby reducing the total volume of suspended solids. Periodically, however, it is necessary to pump out (waste) the excess solids that accumulate within the system.

Although the extended aeration process is considered to be a suspended growth process, the interior surface area of the aeration chamber acts as a biological reactor or supporting media to which bacteria clings. For example, the AA500gpd unit has a total of 12,820 sq. in. of area for bacterial organisms to cling and multiply.

Clarifier-After through treatment is accomplished in the aeration chamber, hydraulic displacement forces the effluent into the clarifier. The settleable solids will settle down the slope of the clarifier and re-enter the mixing zone for further aerated treatment. The polished effluent will rise upwards through the clarifier to the discharge pipe. The average retention time in the clarifier for a 500 gpd is 9 hours.

Pump tanks-When the method of effluent dispersal requires a pump application, the **Aqua Aire®** series has models available that have the pump chambers affixed to the A.T.U.


Disinfection-Tablet fed chlorinators are usually located in the pump tanks in line with the discharge pipe for complete disinfection. A riser is brought to grade for ease of applying tablets. Liquid chlorinators are also available showing long term savings in chlorine cost.

Controls-Ecological Tanks Inc., manufactures a wide variety of controls for use in the on-site industry. Controls are constructed out of a poly Nema 4x watertight enclosures and are available in multitudes of demand and timed models for effluent dispersal applications. Controls are equipped with visual and audible alarms for compressor failures and high water situations. All controls are UL 508A listed and meets or exceeds NSF Standard 40 criteria.

Specifications

The **Aqua Aire®** series of wastewater treatment plants comes in concrete and in multitudes of configurations and volumetric sizes. Plants can be used individually or in conjunction with others for larger flows.

	A.A.500	A.A.600	A.A.750	A.A.800	A.A.1000	A.A.1200	A.A.1500
Treatment Capacity	500 GPD	600 GPD	750 GPD	800 GPD	1000 GPD	1200 GPD	1500 GPD
Volumetric Capacity	748 gal.	857 gal.	1076 gal.	1155 gal.	1420 gal.	1751 gal.	2216 gal.



Aeration Zone Capacity	560 gal.	642 gal.	801 gal.	858 gal.	1063 gal.	1300 gal.	1699 gal.
Clarifier Capacity	188 gal.	215 gal.	275 gal.	297 gal.	357 gal.	451 gal.	517 gal.
BOD5 Loading	1.25	1.50	1.85	2.0	2.50	3.0	3.75
Aerator-Aqua Aire Compressor	ASC2532	ASC3342	ASC3352	ASC3350	ASC5082	ASC7510	ASC7510
Median Length	69.5"	79"	97"	112.5"	112.5"	132.5"	132.5"
Median Width	61.5"	61.5"	61.5"	73"	72.5"	87.5"	72.5"
Inlet Height	57"	57"	57"	59"	57"	69"	67"
Overall Height	67"	67"	67"	69"	67"	80"	77"

Performance


When properly loaded, operated, and maintained the **Aqua Aire®** wastewater treatment plant should provide an effluent quality consistent with the E.P.A. secondary treatment guideline parameters. The expected final discharge from the plant should provide an effluent quality of:

<25mg/l-----CBOD5
 <30mg/l-----TSS
 pH of 6 to 9

Testing in accordance with ANSI/NSF Standard 40 requirements showed the **Aqua Aire®** series to demonstrate a 30 day effluent average of: 2.89 mg/l (CBOD5) and 4.43 mg/l (TSS) or 98.6% total removal of harmful pathogens in the wastewater. Discharge levels of Nitrates tested at 6.13 mg/l with no add-on components.

Inspection/Maintenance

Aqua Aire® home wastewater treatment plants have been designed and built by Ecological Tanks, Inc. to provide long term, reliable and cost efficient service. Our treatment plants will operate with a minimum amount of attention.



Maintenance and Inspection- Risers to allow for the inspection and maintenance of the Aqua Aire® are strategically located on top of the tank.

Periodically: Check and clean the air filter on aerator compressor. Rinse with warm water to clean if necessary. Make sure filter is dry and re-install on aerator compressor.

Recommended: Frequency of solids removal is no more often than every two (2) to five (5) years. Determination of the need for pumping can be made only by a trained service person by testing the tank contents and/or effluent.

NSF Standard 40 dictates that a 2 year service policy shall be furnished to the owner by the manufacturer or the authorized representative and the cost of the initial service policy be included in the original purchase price. The initial service policy consist of 4 inspection visits that are usually once every 6 months in a 2 year period. Items that need to be serviced or maintained are: electrical and mechanical components, effluent (color, turbidity, settleable solids), integrity of the tank(s) and baffles, condition of disposal area, etc... The initial policy states that if a problem arises the owner shall be notified of system failure and a date of correction. Also, an extended service policy shall be made available to the owner when the initial policy expires by the manufacturer or the authorized representative.

Delivery Time

Aqua Aire® concrete units are pre-casted throughout the region and one can call the factory for accessibility nearest you.

Costs

Please consult local distributor or manufacturer for availability and pricing.


Manufacturer

Address: Ecological Tanks Inc.
2247 Hwy 151 North
Downsville La. 71234

Office: (318) 644-0397
Fax: (318) 644-7257

E-mail: aquasafe@bayou.com

Website: www.etiaquasafe.com



- effluent pump chamber. The pump chamber was not tested and is not included as a component of the Certified model.
- [8] Model H-TWO-O Series 25S also as a component of the H-TWO-O Series 25S1 and 25S2 with effluent pump chamber. The pump chamber was not tested and is not included as a component of the Certified model.
 - [9] Model H-TWO-O Series 275S also as a component of the H-TWO-O Series 275S1 and 275S2 with effluent pump chamber. The pump chamber was not tested and is not included as a component of the Certified model.
 - [10] Model H-TWO-O Series 35S also as a component of the H-TWO-O Series 35S1 and 35S2 with effluent pump chamber. The pump chamber was not tested and is not included as a component of the Certified model.
 - [11] Model H-TWO-O Series 375S also as a component of the H-TWO-O Series 375S1 and 375S2 with effluent pump chamber. The pump chamber was not tested and is not included as a component of the Certified model.

ECOLOGICAL TANKS, INC.



2247 HIGHWAY 151 NORTH
 DOWNSVILLE, LA 71234
 800-277-8179
 318-644-0397

Facility : DOWNSVILLE, LA

Model Number	Rated Capacity Gallons/Day	Classification
AA500 - C[2] [6] [11]	500	Class I
AA500T - C[2] [4] [5]	500	Class I
AA600 - C[2] [12]	600	Class I
AA750 - C[2]	750	Class I
AA750T - C[2] [4]	750	Class I
AA800 - C[2] [9] [13]	800	Class I
AA1000 - C[2]	1000	Class I
AA1200 - C[2] [10]	1200	Class I
AA1500 - C[2]	1500	Class I
AA1500T	1500	Class I
AS500 - F, C, M[1] [2] [3] [7] [11]	500	Class I
AS600 - F, C[1] [2] [8]	600	Class I
AS750 - F, C[1] [2]	750	Class I
AS800 - F[1]	800	Class I
AS1000 - F, C[1] [2]	1000	Class I
AS1200 - F[1]	1200	Class I
AS1500 - F, C, M[1] [2] [3]	1500	Class I


[1] Suffix F denotes fiberglass tank.

[2] Suffix C denotes concrete tank.

[3] Suffix M denotes metal tank.

[4] Suffix T denotes two-piece tank.

[5] Model AA500T also as a component of the Model AA500-32 single tank system. Complete Model AA500-32 has not been tested by NSF. Complete Model AA500-32 includes a 325 gallon pretreatment tank.




- [6] Model AA500 also as a component of the Models AA500-35, AA500-3432, AA500-3530, AA500-3575, AA500-4050 and AA500-4075. Complete Models AA500-35, AA500-3432, AA500-3530, AA500-3575, AA500-4050 and AA500-4075 have not been tested by NSF. Complete Models:
- AA500-35 includes a 350 gallon pretreatment tank.
 - AA500-3432 includes a 340 gallon pretreatment tank and a 320 gallon pump tank.
 - AA500-3575 includes a 350 gallon pretreatment tank and a 750 gallon pump tank.
 - AA500-3530 includes a 350 gallon pretreatment tank and a 300 gallon pump tank.
 - AA500-4050 includes a 400 gallon pretreatment tank and a 500 gallon pump tank.
 - AA500-4075 includes a 400 gallon pretreatment tank and a 750 gallon pump tank.
- [7] Model AS500 also as a component of the complete Models AS500-PRE, AS500-EZ, AS500-5PUMP, AS500-CU, AS500-P5CU, AS500-5+5, AS500-5+5E, AS500-4+75 and AS500-166. These complete Models have not been tested by NSF Complete Models:
- AS500-5PRE includes a 516 gallon pretreatment tank.
 - AS500-5PUMP includes a 500 gallon pump tank.
 - AS500-CU includes a 68 gallon chlorine contact tank.
 - AS500-P5CU includes a 516 gallon pretreatment tank and a 68 gallon chlorine contact tank.
 - AS500-5+5 includes a 516 gallon pretreatment tank and a 516 gallon pump tank.
 - AS500-5+5E includes a 516 gallon pretreatment tank and a 580 gallon elliptical pump tank.
 - AS500-4+75 includes a 400 gallon pretreatment tank and a 750 gallon pump tank.
 - AS500-166 includes a 166 gallon pump tank.
- [8] Model AS600 also as a component of the complete Models AS600-166 and AS600-CU. These Models have not been tested by NSF. Complete Models:
- AS600-CU includes a 68 gallon chlorine contact tank.
 - AS600-166 includes a 166 gallon pump tank.
- [9] Model AA800 also as a component of the Model AA800-00110 with an effluent pump tank of 1096 gallons. The pump tank was not tested and is not included as a component of the Certified Model.
- [10] Model AA1200 also as a component of the Model AA1200-00160 with an effluent pump tank of 1625 gallons. The pump tank was not tested and is not included as a component of the Certified Model.
- [11] Average influent wastewater characteristics were outside the 30-day averages specified by NSF/ANSI Standard 40, but were within the average for the overall test, supporting that mass loading of the influent was adequate. The 30-day effluent values were 10 mg/L or less with no effluent values discarded despite the influent variability.
- [12] Model AA600 also as a component of the Model AA600-50 single tank system. Complete Model AA600-50 has not been tested and Certified by NSF. Complete model AA600-50 includes a 500 gallon pretreatment tank.
- [13] Model AA800 also as a component of the Model AA800-65 single tank system. Complete Model AA800-65 has not been tested and Certified by NSF. Complete model AA800-65 includes a 660 gallon pretreatment tank.

NOTE: This company may sell products complying with all applicable requirements for Certification nationally and internationally, but has advised NSF of authorized representatives physically located in the following:

Alabama	Arkansas	Georgia	Hawaii	Illinois
Iowa	Kansas	Louisiana	Mississippi	Missouri
New Mexico	Ohio	Oklahoma	Texas	West Virginia
British West Indies (Turks and Caicos Islands)				

Contact the Listed company directly for further product information and availability in your area.

ENVIRO-FLO INC.
 151 CUSTOM DRIVE
 FLOWOOD, MS 39232
 877-836-8476



ECOLOGICAL TANKS, INC.

AQUA AIRE®

Concrete Class I Wastewater Treatment Plants

Installation, Operation, Maintenance and Trouble-Shooting
Manual for Distributors, Installers, and Maintenance
Providers

MODELS


AA500T	AA500-3575	AA750T
AA500	AA500-4050	AA750
AA500-32	AA500-4075	AA800
AA500-35	AA600	AA1000
AA1200	AA1500	

“Copyright Notice”

No part of this publication may be reproduced, stored in any retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or otherwise without the prior written permission of Ecological Tanks, Inc.



Mfg. By
Ecological Tanks, Inc.
2247 Hwy 151 North
Downsville, LA 71234
PH (318) 644-0397 * FAX (318) 644-7257



I. INTRODUCTION

Ecological Tanks, Inc. was founded in 1994 by people with combined experience in installation, pre-casting and the building industry. At **Ecological Tanks, Inc.** our main goal is to provide products to professionals engaging in the business of distributing, installing and servicing home wastewater treatment plants. To continue our service, we have dedicated ourselves to manufacturing versatile products to simplify the task of installation and maintenance. This will include all-in-one aerobic systems, the first one box control for the operation of pumps and compressors, unique up-size controls and other products that are first in the on-site sewage industry. With this unique diversity and know how, we can provide the help you need with your on-site sewage treatment business.

Ecological Tanks, Inc. Model AA500T, and larger, wastewater treatment plants have been tested by Baylor University Department of Environmental Studies according to requirements listed in ANSI/NSF Standard 40 and meets or exceeds Class 1 plant characteristic requirements.

Some states require the use of a trash trap independent of this test. **Ecological Tanks, Inc.** recommends strongly the use of a trash trap or pre-treatment tank, especially in all cases where a garbage disposal is being used or may be used. Additionally, **Ecological Tanks, Inc.** strongly recommends the use of a trash trap when using sprinklers, drip systems, or pressure dosing as a means of effluent disposal. A minimum recommended size for a trash trap is one-half the daily rated capacity of the unit. This recommendation enables enough capacity to "store" non-biodegradable materials over an extended period of time (several years) to minimize pumping requirements and overall maintenance on sprinkler, drip and dosing effluent disposal systems. This size is also small enough not to interfere substantially with the aerobic performance of the unit or to raise cost excessively. For purposes of the unit certification, a trash trap is treated as an approved "upgrade".

II. AQUA AIRE WASTEWATER TREATMENT PLANT PROCESS DESCRIPTION

Aqua Aire series models of wastewater treatment plants are in many ways similar to large township or municipality sewage treatment plants. They employ an extended aeration activated sludge process. This type of treatment depends primarily upon air passing from the aerator compressor to two diffuser/deflectors located in the

forward section of the aeration mixing compartment. As wastewater enters the aeration mixing compartment simple hydraulic displacement is accomplished by the introduction of air which promotes the growth of aerobic organisms in much larger quantities than would occur naturally. These bacteria break down the organic solids in the wastewater. From the aeration mixing compartment, mixed liquid enters the settling or clarifier compartment from below a partition wall separation. No mixing occurs in this quiet zone where solids separate from the liquid and settle to the bottom of the clarifier and re-enter the mixing compartment. The liquid that separates from the solids in the clarifier continue to flow upward to the discharge pipe.

The Aqua Aire models AA500T, AA500, AA600, AA750T, AA750, AA800, AA1000, AA1200, and AA1500 are rectangular configurations comprised of an aeration mixing compartment and a clarifier compartment. These compartments are partitioned by an internal dividing wall in the treatment plant.


The Aqua Aire models AA500-32 and AA500-35 are three compartment rectangular configurations partitioned by internal dividing walls in the treatment plant. They are comprised of a forward pre-treatment tank, a center aeration mixing zone and a settling or clarifier compartment. Wastewater first enters the pre-treatment tank compartment of the plant, then gravity flows through a 4" SDR 35 PVC inlet to the center aeration mixing zone. The mixed liquid then enters the settling or clarifier compartment and continues to flow upward to the plant's discharge pipe.

The Aqua Aire models AA500-3575, AA500-4050 and AA500-4075 are four compartment rectangular configurations partitioned by internal dividing walls in the treatment plant. They are comprised of a forward pre-treatment tank, an aeration mixing zone, a settling or clarifier compartment and a rear pump tank compartment. Wastewater first enters the pre-treatment tank compartment of the plant, then gravity flows through a 4" SDR 35 PVC inlet to the aeration mixing zone. The mixed liquid then enters the settling or clarifier compartment and continues to flow upward to the discharge pipe. From the plant's discharge pipe, the final effluent then passes through a disinfection or chlorination device into the pump tank compartment for storage and contact mixing. The treated and disinfected effluent is then safely discharged, via an application pump, to a surface spray, subsurface drip, low pressure dose or absorptive mound disposal area. The result of the Aqua Aire process is a clear, odorless effluent discharge, which meets and exceeds state and national water quality standards.

The Aqua Aire models AA800-00110 and AA1200-00160 are three compartment rectangular configurations of up-sized dimensions, partitioned by internal dividing

walls in the treatment plant. They are comprised of an aeration mixing zone, a settling or clarifier compartment and a rear pump tank compartment. Wastewater first enters the treatment plant's aeration mixing zone. From the aeration zone, mixed liquid enters the settling or clarifier compartment and continues to flow upward to the discharge pipe. From the plant's discharge pipe, the final effluent then passes through a disinfection or chlorination device into the pump tank compartment for storage and contact mixing. The treated and disinfected effluent is then safely discharged, via an application pump, to a surface spray, subsurface drip, low pressure dose or absorptive mound disposal area. The result of the Aqua Aire process is a clear, odorless effluent discharge, which meets and exceeds state and national water quality standards.


Aqua Aire Flow Diagram

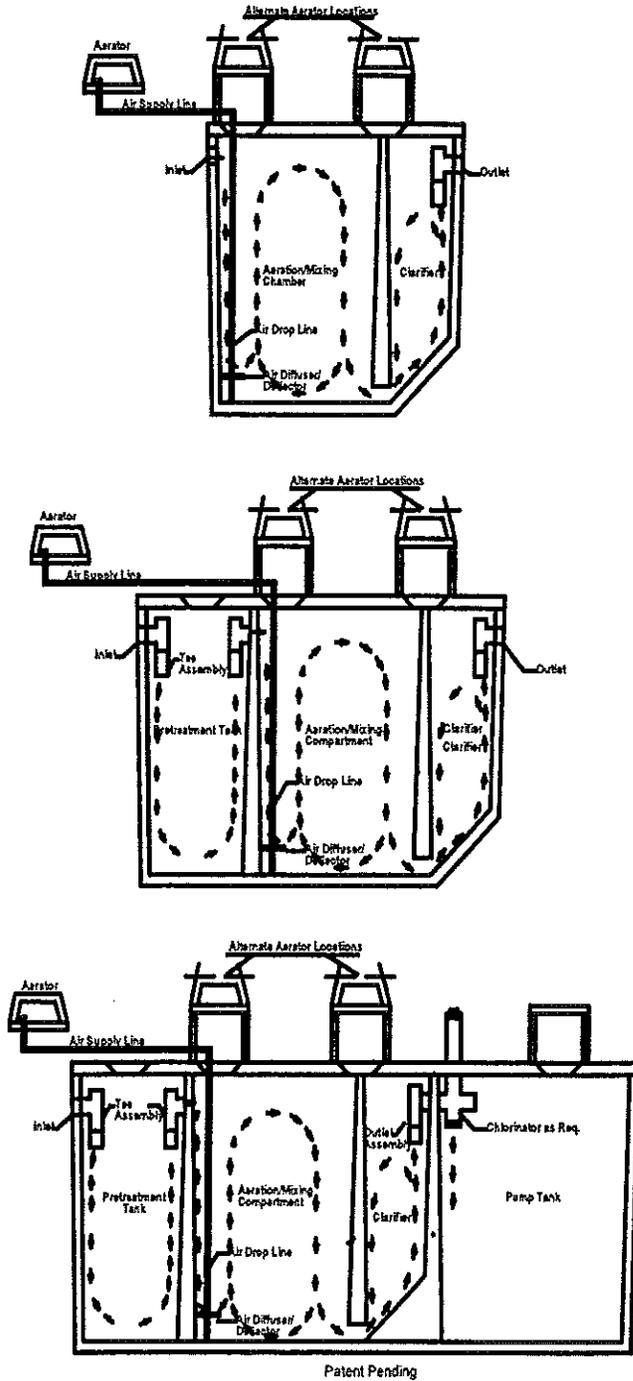

DESIGN COMPONENTS AND MATERIALS
NUMBERS CORRESPOND WITH DESIGN DRAWINGS

1. Aerator (see specifications)
2. Aeration Tank and Lid - Reinforced Concrete - 4000 PSI
3. Aerator Cover and Base - Concrete, Poly or Fiberglass
4. Risers and Riser Top - Concrete, Poly or Fiberglass
Concrete Riser Top to be min. 65lbs, Poly or Fiberglass Riser Top to be fastened so as to only be removed with specialized tools
5. Air Diffusion System - Schedule 40 PVC
6. 4" Tee Assembly Outlet - SDR 35 PVC

AquaAire Sewage Treatment System Models AA500, 600, 750, 800, 1000, 1200, 1500 In One Piece Tank with Lid

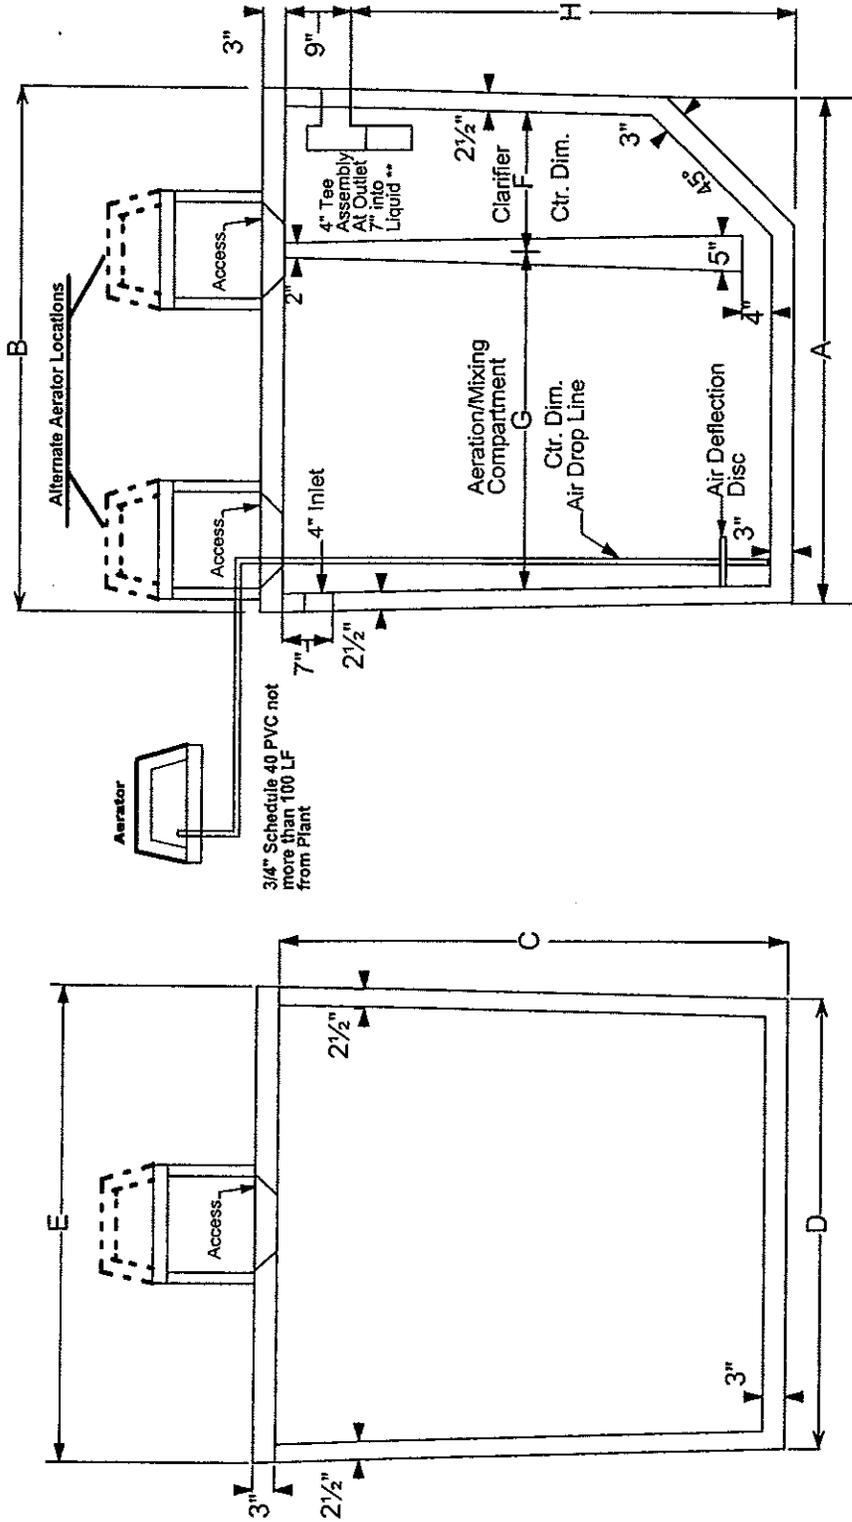


**Extend 10" into liquid depth on AA1500


Schedule

Designation	Treatm Capacity	BOD Loading	Total Volume	Aeration Volume	Clarifier Volume	A	B	C	D	E	F	G	H
AA500	500GPD	1.25	748	560	188	68	71	64	60	63	18%	45%	55
AA600	600GPD	1.50	857	642	215	77½	80½	64	60	63	21%	52%	55
AA750	750GPD	1.85	1076	801	275	95½	98½	64	60	63	29%	64%	55
AA1000	1000GPD	2.50	1420	1063	357	111	114	64	71	74	35%	71%	55
AA1500	1500GPD	3.75	2216	1699	517	131	134	74	71	74	37%	89%	65
AA800	800GPD	2.0	1155	858	297	111	114	69	71	74	23	54	57
AA1200	1200GPD	3.0	1751	1300	451	131	134	80	86	89	23	56	68

**AquaAire Sewage Treatment System
Model AA500-35
AA500 with 350 Gallon Pretreatment Tank
One Piece with Lid**

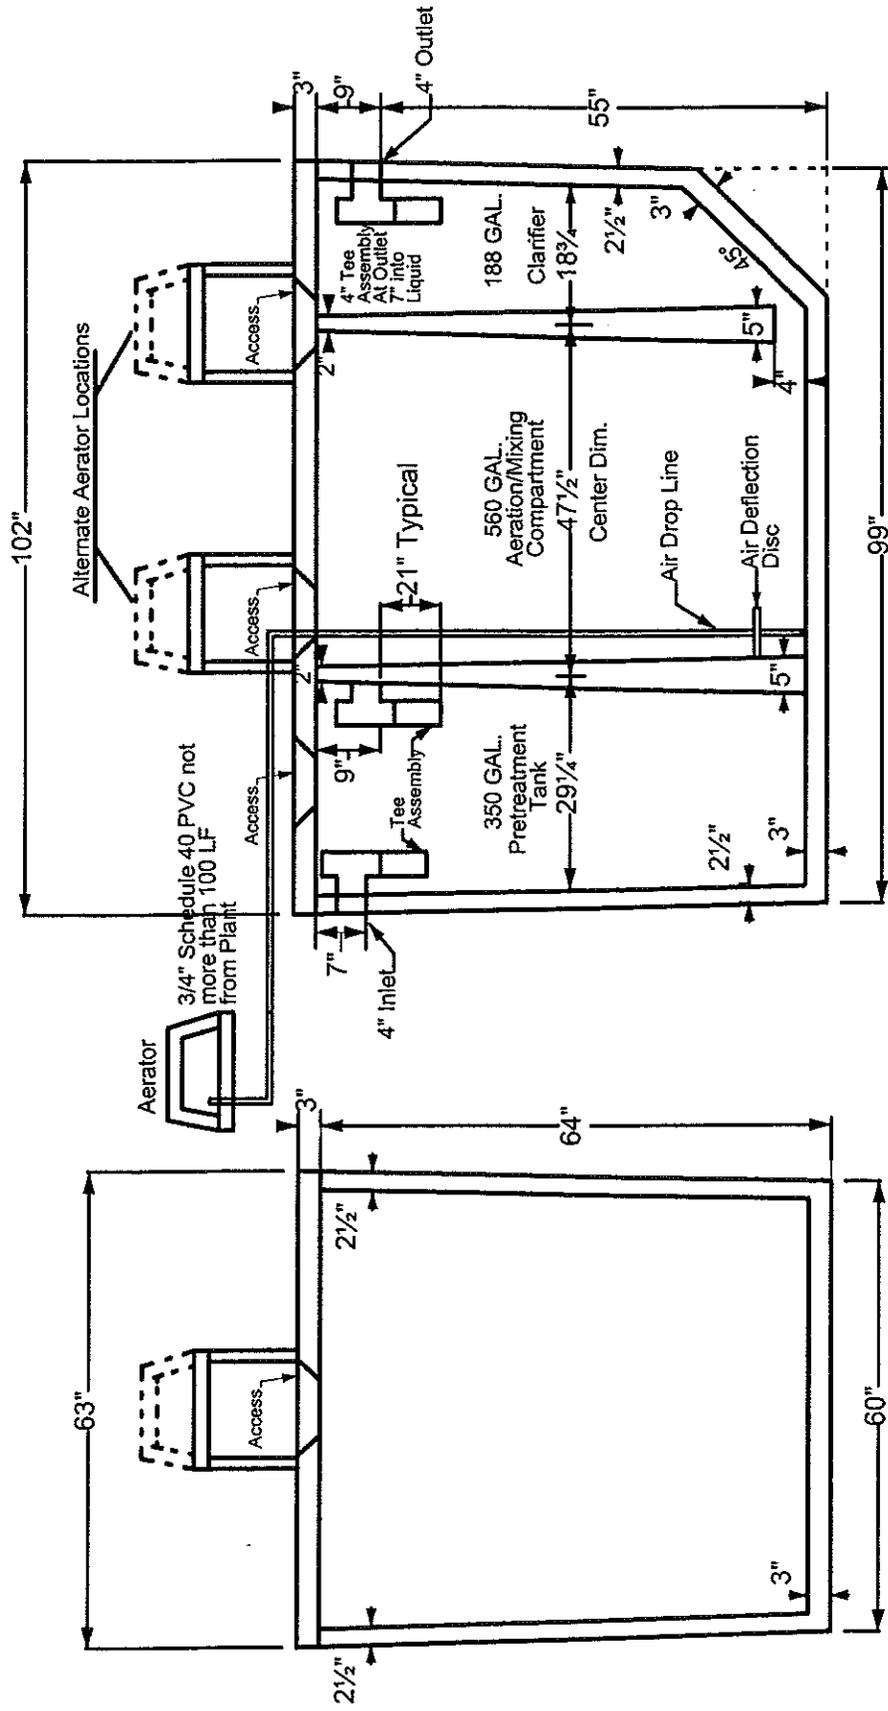


Aqua Aire Sewage Treatment Plant
 Model AA500-32
 AA500T w/325 Gal. Pre Tank
 Two Piece Tank

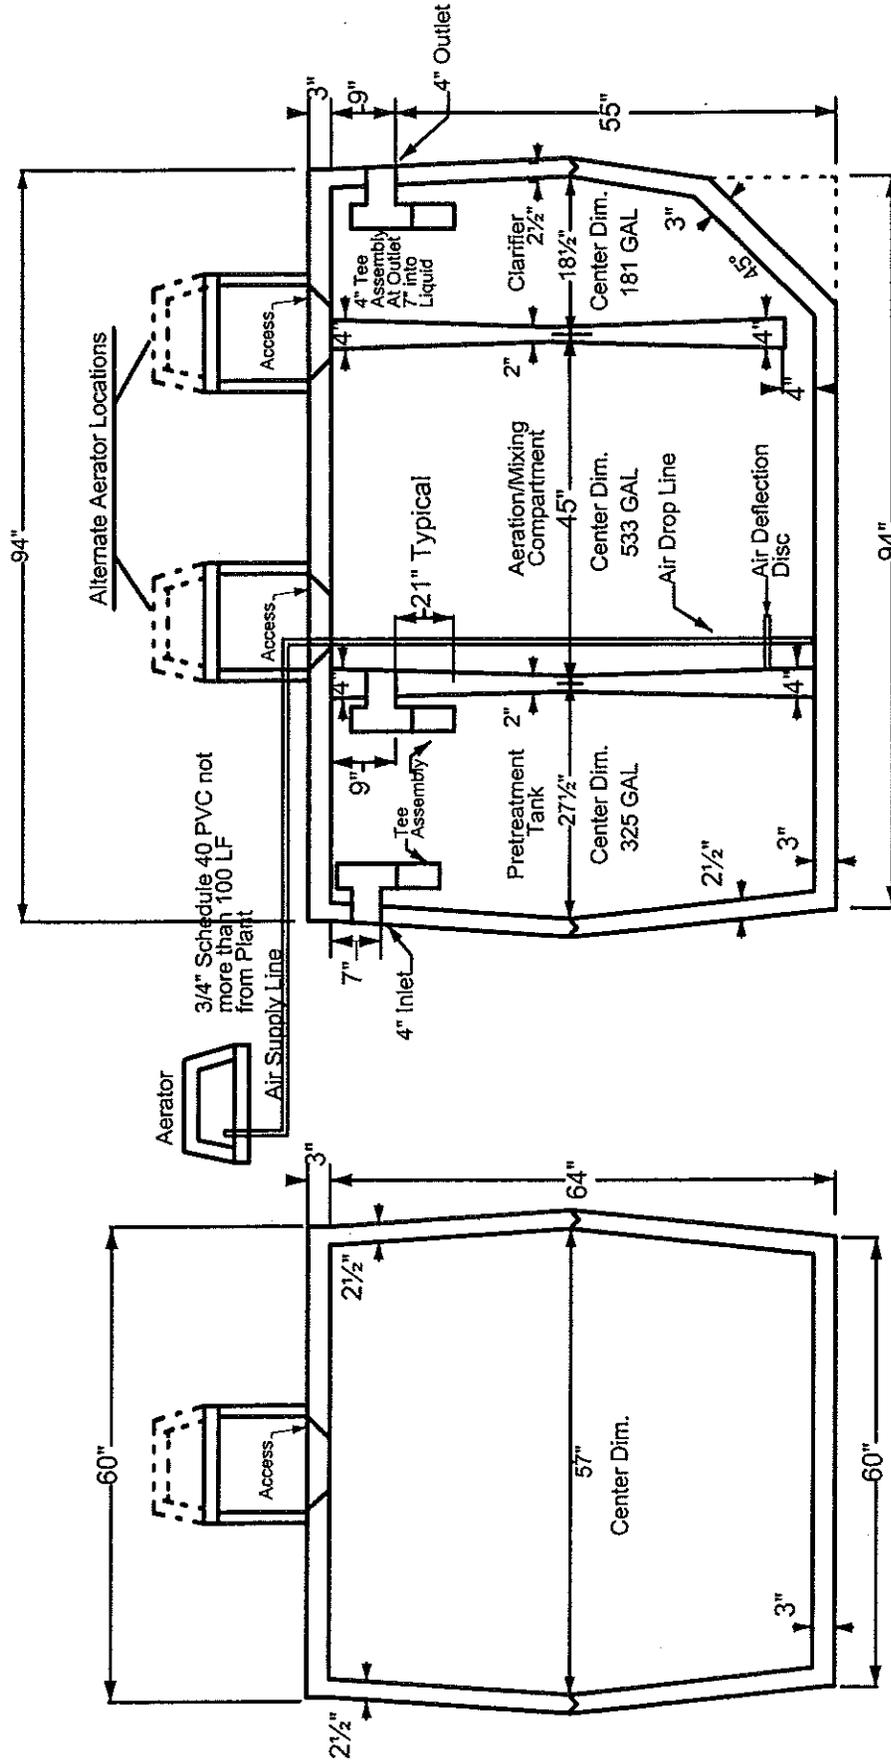

AquaAire Sewage Treatment System

Models AA500-3575, AA500-4075, AA500-4050


One Piece with Lid

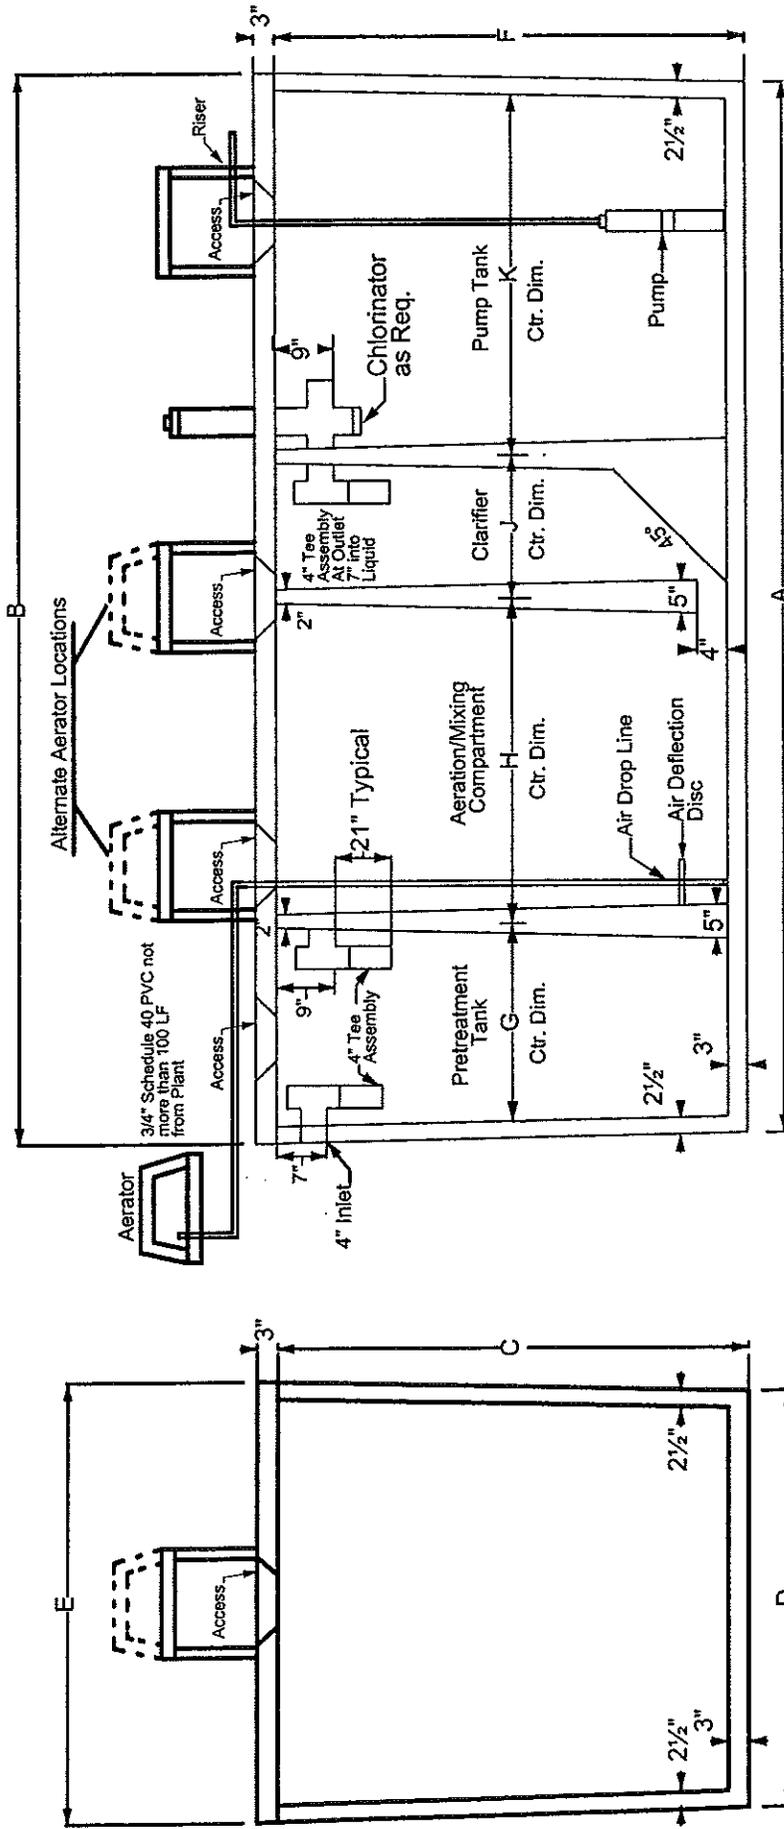

Schedule

Designation	Treat. Capacity	Total Volume	Aeration Volume	Clarifier Volume	A	B	C	D	E	F	G	H	J	K	Pre Tank Volume	Pump Tank Volume
AA500-3575	500 GPD	748	560	188	162 1/2	165 1/2	64	60	63	64	29 1/4	47 1/4	20 1/2	61 1/4	350 GAL	750 GAL
AA500-4075	500 GPD	748	560	188	167 1/2	170 1/2	64	60	63	64	34 1/4	47 1/4	20 1/2	61 1/4	400 GAL	750 GAL
AA500-4050	500 GPD	748	560	188	148	151	64	60	63	64	34 1/4	47 1/4	20 1/2	42 1/4	400 GAL	500 GAL


AA800-00110
AquaAire Sewage Treatment System
AA800 One Piece with 1096 Attached Pump Tank

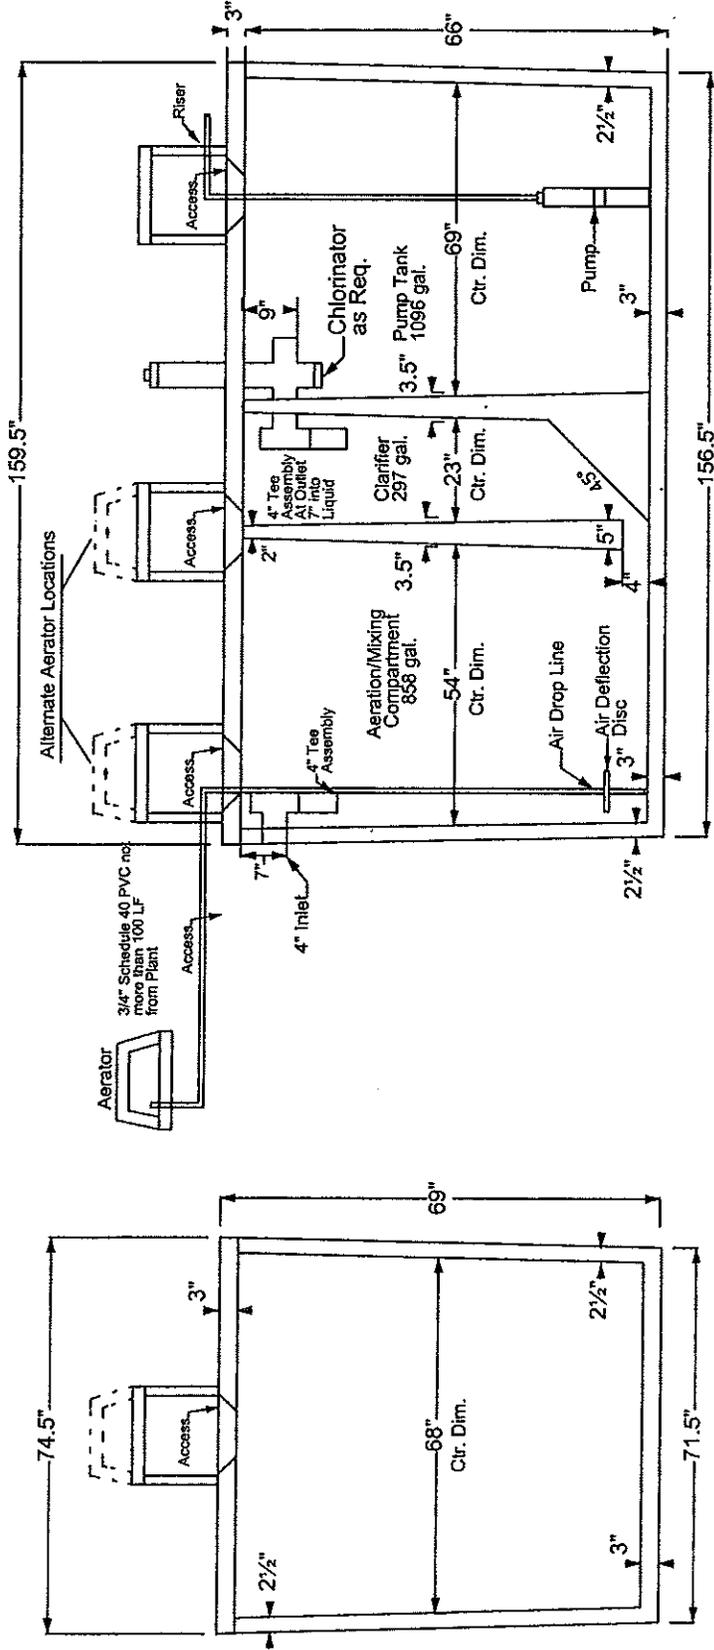

Schedule

Designation	Tritmt Capacity	BOD Loading	Plant Volume	Aeration Volume	Clarifier Volume	Pump Tank Volume
AA800-00110	800GPD	2.0	1155 gal	858 gal	297 gal	1096 gal

AA1200-00160
AquaAire Sewage Treatment System
AA1200 One Piece with 1625 Attached Pump Tank

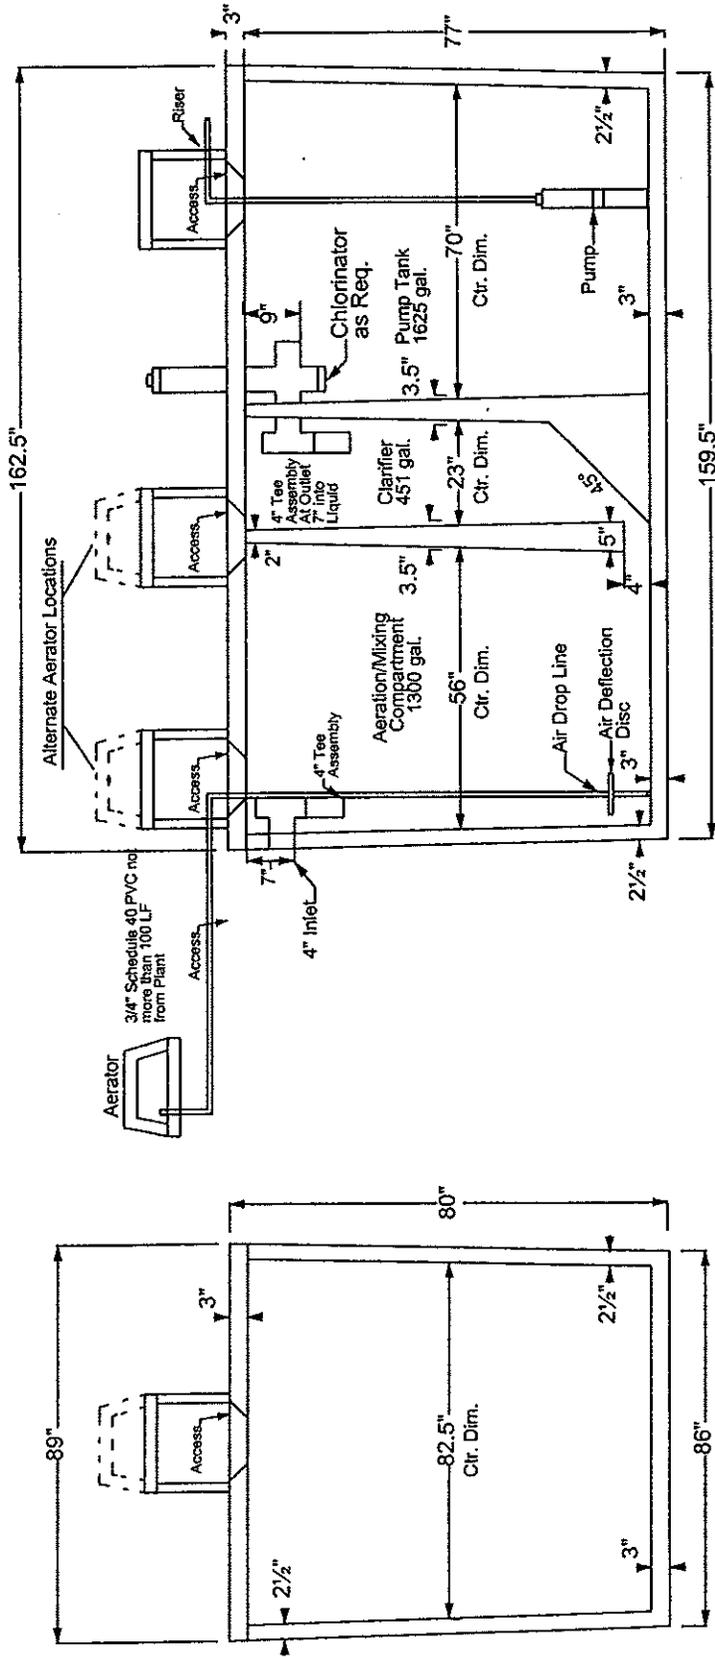


Schedule


Designation	Treatm Capacity	BOD Loading	Plant Volume	Aeration Volume	Clarifier Volume	Pump Tank Volume
AA1200-00160	1200 GPD	3.0	1751 gal	1300 gal	451 gal	1625 gal

Aqua Aire Diffusion System For AA500, 600, 750, 800 1000, 1200 and 1500


Patent Pending

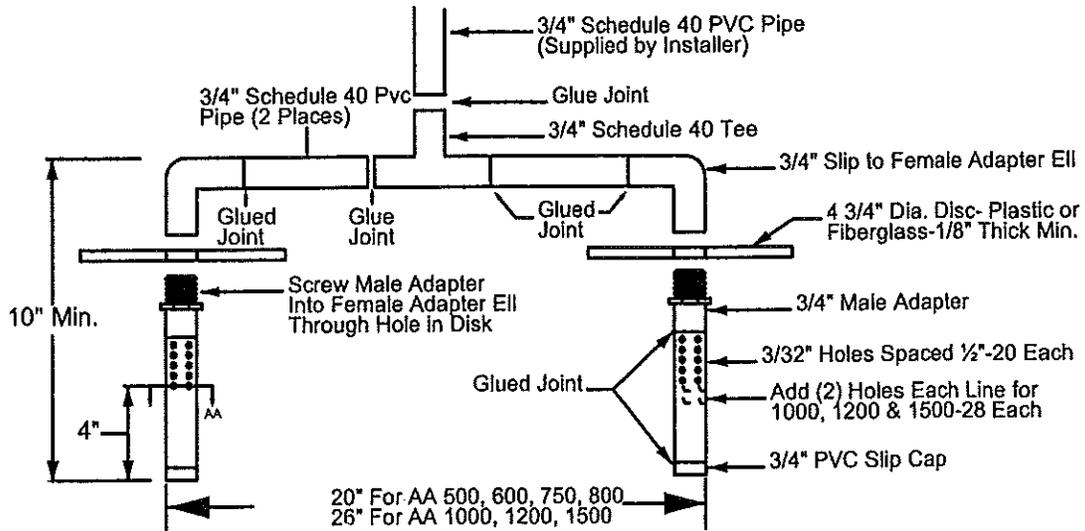

View AA



In-Tank View

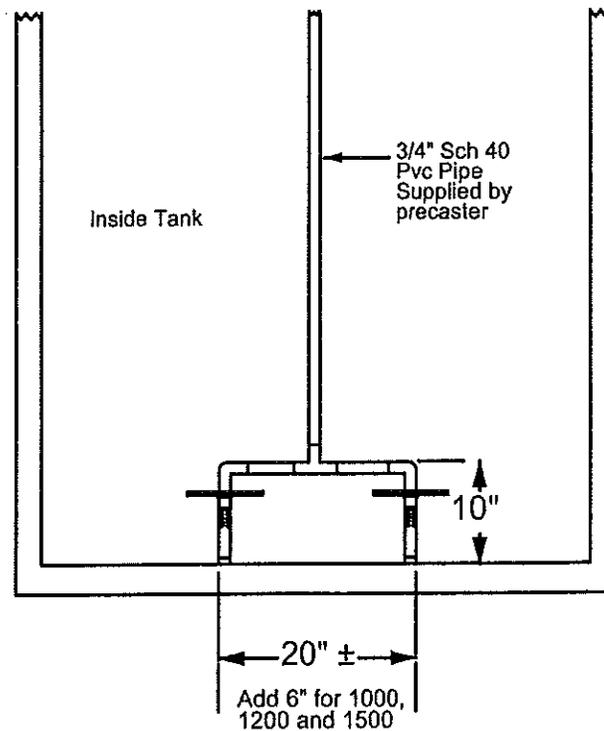

III. AQUA AIRE RECOMMENDED PLANT INSTALLATION INSTRUCTIONS

1. Inspect entire treatment plant and component parts including pre-caster installed in-tank PVC piping, Polylok Seal at inlet invert, outlet coupling and lid for tank sealant.
2. Select location of plant site which is accessible to the home sewer discharge line, at least ten (10) feet from the home foundation, in an area that will not receive vehicular traffic. Prepare an excavation site by digging a hole at least one (1) foot larger than the treatment plant and a depth that will allow for sufficient coverage leaving approximately three (3) inches of the inspection port to extend above normal ground level. The depth of the plant will be controlled by the depth of the building sewer outlet line plus the amount of proper fall required from the building sewer outlet line to the inlet invert of the plant. The prepared excavation should have a solid, level bottom that will eliminate plant settling. Additionally, the bottom of the excavated hole should be free of rocks or sharp objects.
3. Carefully lower the concrete treatment plant into the excavation with a designed and tested spreader bar or lifting device. The inlet line should slope down toward the plant and the outlet line should slope down away from the plant. The plant should be level to within one (1) inch, edge to edge. **Aqua Aire** wastewater treatment plants should only be connected to properly trapped and vented plumbing systems in compliance with state and local plumbing codes.
4. Position the inlet and outlet lines and make the necessary connections. Clean-outs should be installed at building sewer tie-in, any changes in direction of flow and at maximum intervals of seventy (70) feet when using four (4) inch piping. Insert the inlet piping through the treatment plant's Polylok Seal inlet invert to extend approximately 4" inside the plant. Install a 4" SDR 35 PVC sanitary tee onto the end of the inlet piping to direct the incoming wastewater flow downward on all models of **Aqua Aire** treatment plants having a pre-treatment compartment. Insert and glue the outlet piping into the plant's outlet coupling.
5. Remove the treatment plant's top access port opening to the forward section of the aeration mixing compartment. Install the factory provided air diffuser/deflector assembly by gluing a joint of 3/4" Sch. 40 PVC pipe (provided by others) to the 3/4" Sch. 40 PVC tee fitting in the center of the diffuser/deflector assembly. The 3/4" Sch. 40 PVC pipe should be of sufficient length to allow the 3/4" pipe to extend through the treatment plant's top. Lower the air assembly through the access opening to the

bottom of the aeration mixing compartment. Adjust the placement of the air diffuser/deflector assembly so that it is in the forward center of the plant's aeration mixing compartment with the deflector discs resting against the treatment plant's forward partition wall. Fill the tank with water to the point of flowing discharge. Backfill evenly around the plant up to the bottom of the inlet and outlet piping. Special care should be taken not to damage the tank or dislodge the piping. Backfill material should be void of heavy clay, large rocks or any type of material which might damage the tank or piping.

6. The aerator compressor must be installed in a well ventilated, relatively clean and dry location. Install the aerator compressor on the treatment plant's tank top or at a remote location no more than one hundred (100) feet from the treatment plant. The aerator compressor is supplied complete with all discharge fittings. Install 3/4" Sch. 40 PVC piping (supplied by others) between the aerator and treatment plant. Be careful not to allow any debris, dirt or mud in the airline during installation. A minimum of twelve (12) inches ground cover is recommended over the 3/4" Sch. 40 PVC air piping.

7. The electrical controls for the aerator compressor, visual and audible alarms for compressor failure and high water conditions, dose/spray pump and/or timer are contained in a weather proof enclosure. (See Figures 8-20). It may be installed in any above ground area where the warning light is visible to the owner during the course of a normal day activities. It is recommended that the control box be a least six (6) inches above ground level and in view of the aerator compressor housing. All electrical wiring must comply with applicable standards and shall conform to the requirements of the most current revision of the National Electrical Code. All electrical components not supplied must comply to U.L. standards. We recommend that all electrical connections be made by a licensed electrician.

8. Install electrical wiring (provided by others) to interconnect the aerator compressor and alarms to the electrical control panel. (See Figures 13-19). A minimum of twelve (12) inches of ground cover is recommended over underground electrical conduit and wiring.

9. If required, install the application pump in the pump tank. (See **Aqua Aire** effluent pump manual). Most aerobic system designs that include as a method of effluent disposal surface spray, subsurface drip, or low pressure dosing should include the proper sized pump for the job. If not, once the pumping conditions are determined, selection of the right pump will be determined by two factors, pump capacity and total

head needed. You must match the pump as closely to your conditions as possible to get maximum pump efficiency and dependable operation. Install and set the float switches to the appropriate level to comply with design and state requirements. (See Figures 8 & 9).

10. Run approved conduit and wiring to the pump tank from the control panel and have a qualified electrician make wiring connections. (See figures 14-19 and **Aqua Aire** pump manual). All conduit running from the pump tank to control panel must be sealed with conduit sealant to prevent moisture or gases from entering the panel.

11. The aerator compressors used on **Aqua Aire** wastewater treatment plants run continuously. They provide relatively quiet, energy efficient operation. Once properly connected, the electrical control box is to be closed. Operate the aerator compressor by placing the on/off electrical circuit (provided by others) in the "ON" position.

12. Turn on aerator compressor and check all air piping and fittings for leaks. This can be accomplished by preparing a saturated solution of soap and water and applying to entire run of pipe and fittings. If a leak is detected, effect repairs.

13. Carefully backfill all underground lines and the rest of the plant's excavation in a manner which will not cause damage to the completed installation.

14. The **Aqua Aire** plant is ready to receive incoming sewage.

IV. AQUA AIRE PLANT START UP

Initially the **Aqua Aire** wastewater treatment plant is filled with clean water, usually from an owner's water supply. As stated in the installation instructions, once all proper connections have been completed and it is filled with water and the aerator compressor turned on, the system is now in operation. For the treatment plant to be biologically stable, it will take from four (4) to twelve (12) weeks after first using the plant to develop a population growth of microorganisms (bacteria). It is these bacteria which make the treatment system operate.

V. OWNER MAINTENANCE CARE AND OPERATION INSTRUCTIONS

Aqua Aire home wastewater treatment plants have been designed and built by **Ecological Tanks, Inc.** to provide long term, reliable and cost efficient service. Our treatment plants will operate with a minimum amount of attention.

If service is required, reference the system's **DATA PLATES** located on the **Aqua Aire** control panel or aerator compressor for the plant's model number, the name, address and phone number of the local service person that can provide service. The following procedures should be performed on a routine basis to insure proper plant operation:

DAILY: Check warning light and audible alarm located on the plant's control panel for air supply malfunction or in system high water indication. If an alarm on condition is observed, it is an indication of malfunction. First check the electrical circuit providing power to the system to insure the circuit is closed. Check the aerator compressor to be sure it is operating. Check for over heating, excessive vibrations and unusual noises. If aerator compressor failure is observed, call your service provider for service. After a power outage, an alarm condition may exist. Should an alarm remain on for more than thirty (30) minutes after power is restored, you should call your local service provider to report the alarm.

WEEKLY: Check the treatment plant for offensive odor. If present call for service.

PERIODICALLY: Check and clean the air filter on aerator compressor. Rinse with warm water to clean if necessary. Make sure filter is dry and re-install on aerator compressor.

RECOMMENDED: Frequency of solids removal is no more often than every two (2) to five (5) years. Determination of the need for pumping can be made only by a trained service person by testing the tank contents and/or effluent. The **Aqua Aire** wastewater treatment plant should be pumped when the settled solids are approximately sixty (60) percent of the total volume. **WARNING** - Hydraulic displacement and tank flotation may occur whenever tanks are pumped. Additionally, care should be taken not to damage internal component parts. A certified **Aqua Aire** service technician should oversee tank pumping.

VI. OWNER'S RESPONSIBILITY

It is the *owner's responsibility* to operate the **Aqua Aire** wastewater treatment plant to the best of their ability. To keep maintenance to a minimum and insure high effluent quality, the following items should not be permitted to enter the treatment plant:

1. Strong disinfectants or bleaches, other than small amounts used in day to day house cleaning and laundries. Recommended detergents are low-sudsing, low phosphates and biodegradable. Recommended cleaning products are non-chlorine, non-toxin, non-corrosive and biodegradable. Anti-bacteria soaps should be avoided.
2. Backwash discharge from any type of water softeners.
3. Citrus products, coffee grounds, chemical wastes, paint or paint thinners, oils or grease (such as used cooking grease), pet shampoo, pet dip disinfectant, pesticides, herbicides, automotive fluids or any other toxins.
4. Disposable diapers, tampons, sanitary napkins, large quantities of paper products, tobacco products, or similar items. Home brewery waste, strong medicines and antibiotics.
5. Waste material from a garbage disposal is not recommended without the use of a trash trap or pretreatment tank preceding the **Aqua Aire** plant. Food waste represents additional loading the aerobic treatment unit would have to digest, increasing pump out intervals.
6. The **Aqua Aire** wastewater treatment plant is designed for the treatment of domestic wastewater and nothing else should go into it.

During extended periods of intermittent or non-use, such as vacation time, the aerobic bacteria inside the plant will decrease due to no food in the form of incoming wastewater. The treatment plant will become biologically stable again soon after the resumption of normal loading. The aerator compressor should be left on during periods of vacation time. During extended periods of absolute non-use (3 months or longer) the aerator compressor should be removed, cleaned and stored with the compressor's inlet and outlet sealed. Additionally, the air line piping should also be capped to prevent debris from entering the air distribution system.

The **Aqua Aire** plant will not perform to its fullest capabilities if subject to hydraulic overloading. This condition exist whenever excessive water, above the plants designed treatment capacity, is allowed into the plant. Leaking plumbing fixtures or excessive water use may cause this condition. Hydraulic overload may also occur on wash days, when multiple loads of laundry are washed in succession.

Ecological Tanks, Inc. is not responsible for the infield operation of our plants. The proper operation of this wastewater treatment plant depends upon proper organic and hydraulic loading of the plant. We cannot control the loading of substances in our plants that may upset its biological balance. We can only provide a complete owner's manual which outlines materials that should be kept out of the treatment plant. User operation instructions must be followed or warranties are subject to invalidation.

WARNING! Ants and rodents are destructive to the mechanical and electrical equipment on wastewater treatment plants. Care should be taken to prevent infestation of ants near the plant. Damage or destruction of mechanical or electrical equipment by ants or rodents is not covered under manufacturer's warranty.

Any and all safety requirements such as the electrical wiring, blower operation or plant discharge concerning the owner, their families, friends, or guests is the sole liability of the owner (see warranty and service policy).

The electrical control panel contains a schematic for the system. However, the electrical control panel is sealed and contains no user serviceable parts. Test and alarm silence switches are located on the outside of control panel.

WARNING! Service to the electrical control panel by a non-qualified person may result in a electrical shock hazard resulting in serious injury or death. If service is required contact your local authorized installer representative or maintenance

provider.

Many states already require the use of a chlorination unit behind all mechanical treatment plants for total effluent disinfection prior to final discharge. **Ecological Tanks, Inc.** recommends the use of a disinfection device behind its mechanical plants for total effluent disinfection prior to final discharge.

VII. INSTALLER/MAINTENANCE PROVIDER OPERATION, REPAIR AND TROUBLESHOOTING

Previous sections in this manual have covered the **Ecological Tanks, Inc., Aqua Aire** system's functions, specifications, design, proper installation procedure, start up, owner care and operation instructions. If at this point you are not totally familiar with the material already covered, you should read it again.

Please pay particular attention to the preceding section titled "Owner's Responsibility". This section covers information critical to the plants proper loading and function. You will find that this same information is listed in the **Ecological Tanks, Inc., "Aqua Aire Owner's Manual"**. Your assurance of the owner's receipt of their manual and the explanation of it's contents is most critical to the plant's proper operation.

You will find, in the following sections of this manual, the "Initial Service Policy". It covers information required of you as a maintenance provider in order for you to provide service in compliance with ANSI/NFS Standard 40. Additionally, most states have added to the requirements of this policy. You must know and adhere to all other regulatory agency requirements concerning mechanical plant service/maintenance standards. **Ecological Tanks, Inc., Aqua Aire** wastewater treatment plants should be inspected every six months for proper operation. Two years of maintenance is provided as a part of the systems certification requirements. Ongoing maintenance is usually part of a service agreement maintained between an owner and maintenance provider. Inspections should include any necessary adjustment of electrical controls and servicing of the component parts and should include a visual check of hoses, wires, leads, contacts, cleaning of filters, removal of organic particles, and testing of alarms to ensure proper function. An effluent quality inspection consists of a visual check for color, turbidity, scum overflow, and an examination for odors. A mixed liquor inspection may be necessary if the plant is not performing properly or if offensive odors are present. If any improper operation is observed which cannot be corrected at that time, the user shall be notified in writing immediately. This

notification shall advise the owner of the problem, if it is covered by the warranty, if not, the cost related to correcting the problem and estimated date for correction of said problem.

VII-1. EXAMPLE OF A ROUTINE MAINTENANCE SERVICE CALL

First check the system's control panel for any alarm or failure indication. Check the panel to insure proper incoming power by testing the incoming power supply. If you know power is incoming into the control panel, check the circuit feeding the control panel. Next, check the aerator simply to insure that it is running and then go directly to the treatment plant for an effluent quality inspection as outlined in the service policy section. At this point pay particular attention to odors you notice at the plant (or pump tank if applicable). You may notice an earthy smell which is nothing more than carbon dioxide gas emitted by the aerobic bacteria in the plant. There may be a sweet smell or no smell at all and that's good. Should you experience an obnoxious odor, something is wrong. Access the aeration mixing compartment, if necessary, to examine the mixed liquid and air diffuser/deflector assembly.

Return to the control panel, check for proper functions as outlined in this manual (See figures 8-12), note the troubleshooting and repair guidelines covered in the referenced figures. Before servicing the control panel and alarm system, disconnect power to the control panel.

Clean or replace the aerator compressor air filter at this time. If you experienced an offensive odor when at the plant and heard little or no bubbling, finding a clogged or extremely dirty air filter may be the problem. Turn on the aerator at this time and check for any air leak between the aerator and the 3/4" Sch. 40 PVC piping. If a leak is detected, effect repair. If a leak is not detected, the following steps should be taken.

Remove the aerator from the rubber hose connection and install a low pressure gauge (available from **Ecological Tanks, Inc.**) between the PVC piping and aerator. Turn on the aerator and note the pressure. If the line pressure is below 1.5 P.S.I. then there is a leak between the aerator and the air distribution system in the treatment plant or the aerator's diaphragm is ruptured. (See aerator compressor repair section) Determine the cause and effect repairs at this time. If a pressure above 3.5 P.S.I. is noted, the air system piping or diffuser/deflector assembly is blocked. You may be able to clear the air distribution system's blockage by charging the air distribution piping with compressed air (no more than 80 P.S.I.). If necessary, remove and clean or replace the

PVC diffuser bars. Re-check the line pressure after any maintenance procedure to the plant's air distribution piping to insure the correct pressure range.

The **Aqua Aire** aerobic treatment plant was designed and tested with a specific aerator compressor for each of its plant models. Use only the specified aerator for each plant model provided by **Ecological Tanks, Inc.** in accordance with NSF Standard 40.

Returning to the plant, check again for the presence of bubbling and mixed liquid roll from the front to the rear of the aeration mixing compartment.

If this particular system uses a gravity flow overland discharge, check to insure the discharge pipe or manifold is open. Should the system employ spray irrigation or some other method of pumped effluent disposal, you should check that method at this time.

While at the chlorination or pump tank, if applicable, note the condition of the chlorination or other type of disinfection device. Make sure that the disinfection device is designed to insure effluent contact with the disinfection agent during periods of final effluent flow into the pump tank. Note the chlorine supply and check to insure that chlorine tablets are not "caking" inside the chlorinator resulting in no tablet effluent contact. Effect necessary repairs if needed.

Continue at the pump tank by checking the condition of the application pump and its electrical connections. Note the positions of the pump on, off, override and high water float switches. Make sure they are properly positioned, operable and secured. Note the condition of the application pump's inlet screen. Clean or replace as necessary. Check to insure the pump is properly seated in the pump tank and note the condition of the pump's drop pipe as it extends from the pump discharge opening to its exit point out of the pump tank. Refer to "Troubleshooting Guide" found on-back page of **Aqua Aire** effluent pump manual if application pump problems warrant corrective action or repair.

Some counties require the use of a spin or disc filter in line between the pump tank and spray application area. If subsurface drip application is used, you should always have a filter assembly in line between the pump tank and drip field. Counties that require the use of in-line spin or disc filters, as well as drip tubing manufactures alike, prescribe the use of the filter size and micron rating (normally 100 microns). Only approved filters should be used. If spin or disc filters are used they should be removed and cleaned or replaced and re-installed at this time.

Continue by checking the condition of the final effluent distribution piping system to include the surface spray or subsurface drip application area. Be sure that the distribution piping system and any repairs to the system conform to the applicable rules governing the construction of that system. Note any ponding or run off from the disposal area; determine the cause if either of these conditions exist. Probable cause would be either hydraulic overload of system or improperly sized disposal area. If water is ponding in the disposal area, it may flow back into the pump tank if the in-line check valve between the pump tank and disposal area is not completely closing after each pump cycle. Note any non-compliance conditions that may exist in the effluent disposal area and arrange for corrective measures.

Activate the application pump and check the spray pattern and condition of the spray heads in the surface application area. Strainer screens if used in the spray heads may require cleaning. Any irregular spray pattern or damaged spray head must be noted on

the reporting record and repaired. Also note the condition of the vegetation growth in the surface application area. Tall grass, weeds or bushes should be cut or trimmed. Notify the person responsible for performing that task and insure that it is done.

If a subsurface drip application field is used, the system should be flushed at each regular service visit. Systems must be equipped to flush the contents of the lines back to the pretreatment tank when intermittent flushing is used. If continuous flushing is used during the pumping cycle, the contents of the lines must be returned to the pump tank. Check the atmospheric vents in the drip field to insure that they will open to vent and are readily accessible for inspection or service.

Recommended procedures for taking effluent samples are outlined in Section VIII of this manual, titled "Effluent Sampling Requirements".

Be sure to follow the steps outlined in the "Initial Service Policy", number 3, should you observe any improper condition affecting the plants proper operation which cannot be readily repaired.

VII-2 AERATOR COMPRESSOR REPAIR

Linear aerator compressors (See Figure 22-24) are used on all models of the **Aqua Aire** wastewater treatment plants. They provide quite energy efficient operation. Additionally, rotary vane compressors (See Figures 25-28) are provided upon request, in-lieu of linear aerator compressors. All aerator compressors on all models of the

Aqua Aire aerobic wastewater treatment plants run continuously.

Periodical aerator compressor maintenance will help you to operate the aerator in the optimum condition and insure longer aerator life. Air filters should be cleaned every four months and replaced as necessary. **Ecological Tanks, Inc.** recommends that the air filters be replaced once a year. The plant's air distribution piping pressure should be measured at least once per year. Aerator compressors should be operated at the recommended output pressure range which is between 1.5 and 3.5 P.S.I.. Aerator life is shortened if operations outside of the specified pressure ranges occur.

Ecological Tanks, Inc. recommends the diaphragm blocks on linear aerator compressors be replaced every three years. We also recommend that the vanes be replaced every four years on rotary vane aerator compressors. Referring to figures 22-

28, note the following text for diaphragm block and vane replacement procedures:

LINEAR COMPRESSOR HEAD AND DIAPHRAGM REPLACEMENT

1. Remove linear blower from electrical power and move to a well lit spot.
2. Remove the top plastic cover and discard the filter element.
3. Turn the blower over and remove (4) screws using either a #2 Phillips screwdriver or a 10 mm socket.
4. Remove the top housing and internal filter.
5. On Secoh, Thomas, and Gast HP series, remove the drive cover by taking out (4) Phillips screws.
6. Carefully, inspect the shuttle assembly and electric coils. Any damage to these components will require replacing the linear blower.
7. Using a pair of pliers, slide the hose clamp down the discharge hose and remove the hose from the head assembly.
8. Remove the head assembly by taking out (4) Phillips screws and separating the head from the diaphragm casing by prying the two pieces apart at the notch in the head.

9. Remove the diaphragm lock nut and washer. Slide the diaphragm block off the shuttle stud. NOTE: On the Gast units only, the diaphragm ring will also be removed during this operation.
10. Install the new diaphragm and casing by sliding the diaphragm over the shuttle stud and centering the diaphragm casing in the housing. Install the washer. Place (1) small drop of Loctite thread lock on the end of the stud and install the nut. Tighten to 14 in. lbs.
11. Install a new head assembly by locating the head over the diaphragm casing and tightening the (4) Phillips screws.
12. Slide the discharge hose back on the head and replace the clamp.
13. Follow procedure #7 thru 12 for the opposite side.
14. Install the internal filter and replace the blower cover.
15. Install the (4) Phillips screws, replace the filter element, and replace the filter cover.
16. Return unit to service.

ROTARY COMPRESSOR VANE REPLACEMENT

1. Unplug compressor, disconnect piping and move to a suitable work area.
2. Remove (5) 7/16" hex bolts and remove front cover and gasket (if present).
3. Remove vanes while paying particular attention to the proper orientation of vanes in the rotor.
4. Using low pressure compressed air, blow out any dust or carbon particles from rotor and cylinder. (Always used safety glasses when performing this procedure).
5. Inspect the rotor, cylinder, and front cover for any signs of metal contact or cracks.
6. Rotate the rotor by hand to be sure the motor and bearings are free.

7. Install a new set of (4) vanes into the rotor slots.
8. With the motor resting on its base, rotate the rotor by hand to insure the vanes move freely.
9. Install the front cover and torque the (5) hex bolts to 10 ft.-lbs.
10. Replace the felt washers on the inlet filter.
11. Prior to installing compressor back on system, plug the unit in and let it run for a couple of minutes. Unit should have a constant hum and should not exhibit any excess vibration.
12. Unplug the unit and listen for the coast down of the compressor. The compressor should coast down to a dead stop. If the unit stops immediately, go back to step #2 and check for any metal to metal rubbing.
13. Install unit back on plant.

VII-3. METHODS FOR EVALUATION OF EFFLUENT AND MIXED LIQUOR

Problem	Possible Cause	Corrective Action
Offensive odor from plant and effluent.	Aerator or air piping defective, leaking or or clogged	Check aerator, air piping and alarm system.
Murky to gray mixed liquor with semi-clear effluent having a sour odor.	Plant starving due to infrequent loading, hydraulic overloading, or oversized pretreatment tanks resulting in totally anaerobic, or low BOD influent.	Confer with homeowner regarding loading. Remember it may take 4 to 12 weeks for a new plant to start.
Black colored mixed liquor & effluent having a totally septic odor void of dissolved oxygen, having a approximate pH between 6.5 & 8.	Plant receiving little or no aeration due to defect in aerator or air piping.	Check aerator, air piping & alarm system.

Problem	Possible Cause	Corrective Action
Black colored mixed liquor & black tinted effluent having an offensive odor & acidic pH.	Plant loaded or dosed with influent that prohibits growth of aerobic bacteria	Confer with homeowner regarding loading. Adjust pH to between 6.5 & 8.5 dose system with approved bacterial additives to help restart micro-bacterial growth or pump tank for fresh start.
Brown mixed liquor with a viscous, brown foam having an obnoxious odor in the mixing zone with semi-clear effluent high in TSS	Developed population of filamentous microorganisms in aeration zone due to low food to microorganism ratios, the presence of toxins or improper pH level.	Confer with homeowner regarding proper plant loading. Adjust pH to 6.5 & 8.5. Dose plants mixing zone with approved bacterial additive.
Chocolate brown mixed liquor with clear effluent quality having only a slight earthy smell in mixing zone.	Plant working properly with effluent pH between 6.5 & 8.5 and D.O. level between 1 and 5.5 mg/L.	None required

VIII. EFFLUENT SAMPLING REQUIREMENTS

When properly loaded, operated and maintained the **Aqua Aire** wastewater treatment plant should provide an effluent quality consistent with the E.P.A. secondary treatment guideline parameters. The expected final discharge from the plant should provide an effluent quality of:

less than	25 mg/l.	CBOD ₅
less than	30 mg/l.	TSS
	pH of	6 to 9

Test results conducted by Baylor University's Department of Environmental Studies in accordance with ANSI/NSF Standard 40 requirements showed the **Aqua Aire** wastewater treatment plant to have a 30 day effluent average of:

2.89	mg/l.	CBOD ₅
4.43	mg/l.	TSS

Ecological Tanks, Inc. recommends that ALL final effluent samples be taken in the effluent discharge line or the effluent pump discharge line at a sampling port designed for that purpose, but always after the chlorine contact tank. We recommend allowing the effluent to flow through the discharge pipe for a minimum of two (2) minutes before taking the sample.

VIII-1. SAMPLING AND TESTING PROCEDURE FOR BOD₅ OR TSS

1. Effluent grab samples to be analyzed for BOD₅ or TSS should be done by a certified testing lab. The certified lab should provide you with information concerning proper sample collection to include volume, storage and labeling of sample. For a fee, most labs will provide the glass or plastic bottles to be used.
2. Always follow your testing lab's instructions concerning proper sample labeling, collection, and storage.

For the referenced sample collection in this section, the testing lab's minimum instructions should be:

A) Label each sample to include:

- * Name and physical address of owner
- * Time and date of collection
- * Desired test
- * Name of person collecting sample

B) Collect samples only in clean glass or polyethylene bottle or jar at a volume specified by the lab.

C) Store samples in a cooler to near freezing temperature as soon as samples are collected.

D) Deliver samples for analysis within six (6) hours of collection.

3. Activate the application pump and collect the sample from the sample port in the pump tank or from fresh flow in the effluent discharge line after the disinfection device.

VIII-2. TESTING FOR SOLIDS REMOVAL

1. As previously noted in other sections of this manual a sample of mix liquor should be taken from the aerobic plant's aeration mixing compartment to determine the

suspended solids content of the aeration compartment.

2. Using a clear glass or plastic graduated cylinder, let the sample settle for thirty (30) minutes. If the settled amount of suspended solids is greater than sixty percent (60%) after thirty (30) minutes, the aerobic tank should be pumped out.

VIII-3. OTHER TESTING

1. To determine the composition of the aerobic plant's influent wastewater strength, collect a grab sample from the flow between the pre-treatment tank and aerobic treatment plant.

2. Samples should be taken from fresh flow directly out of the pre-tank's outlet baffle. Refer to information covered earlier in this section for proper handling of a sample from the job site to a certified testing lab.

3. Influent grab samples, at a minimum, should be analyzed for BOD₅, TSS, COD, and pH. A pH test can be done on the job site by following the simple instructions with your pH test kit. However, BOD₅, TSS, and COD tests should be conducted by a certified lab.

4. The need to determine the concentration of other influent contaminants may arise. Collect, handle and test the samples in the same manner as outlined in this section.

5. The typical composition of untreated residential wastewater for the suggested parameters are:

BOD ₅	180 to 200 mg/l
TSS	180 to 200 mg/l
COD	75 to 150 mg/l
pH	6 to 9

IX. ORDERING OF SYSTEMS, PARTS, AND MANUALS

Ecological Tanks, Inc., Aqua Aire maintains ample supplies of parts to meet the needs of new sales, replacement parts, warranty parts, and manuals. Please feel free to call us or your local distributor so we can help meet these needs.

SOURCES FOR OBTAINING REPLACEMENT PARTS OR COMPONENTS


Replacement parts or components may be obtained from your local installer/distributor or from:

Ecological Tanks, Inc.
2247 Hwy 151 N.
Downsville, LA 71234
Office: 318-644-0397
Fax: 318-644-7257


PARTS LIST

Refer to system, aerobic control and aerator compressor schematics.

DATA PLATE / SERVICE LABELS INFORMATION

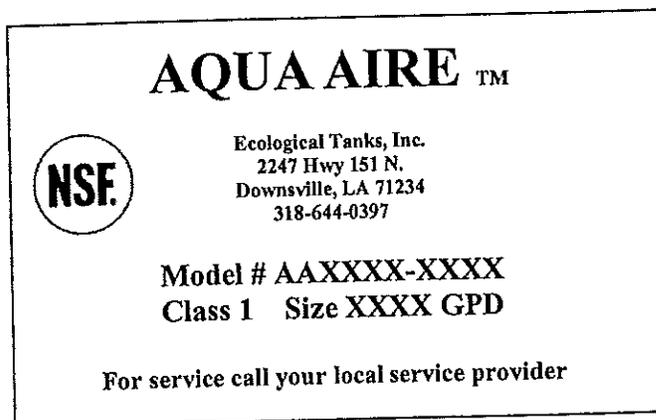

The above weatherproof vinyl label is permanently affixed to the front of the electrical control panel.

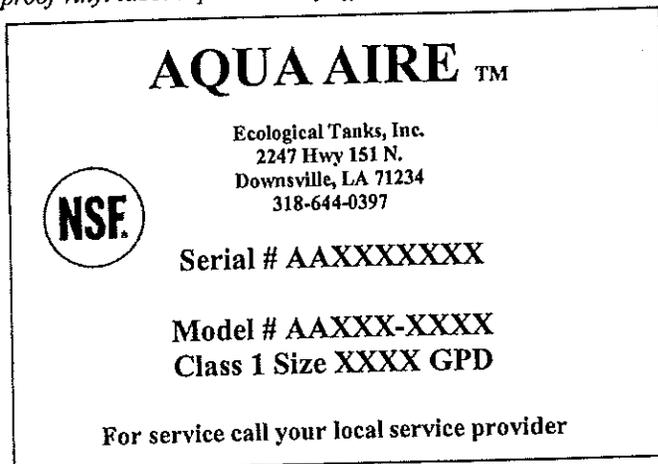

The above weatherproof vinyl label is permanently affixed to the aerator compressor

TROUBLESHOOTING

NOTE: Power must be on to test horn and alarm light.

Alarm Horn

Pressing the alarm test switch, turning the compressor circuit breaker OFF, or activating the alarm float should turn on the alarm horn. If the horn does not sound, replace with horn of same type.

Alarm Light

Pressing the alarm test switch, activating the alarm float, or turning the compressor circuit breaker off should turn on the alarm light. If the light does not activate, replace bulb with the same type.

Circuit Breakers

Check the circuit breaker for proper resistance reading using the following procedure.

1. With power OFF, isolate the circuit breaker by disconnecting the load side wires.
2. Place the ohmmeter leads across the corresponding line and load terminals.
3. With the ohmmeter on the R X 1 scale and the breaker in the OFF position, the reading should be infinity (very high resistance). With the breaker in the ON position, the reading should be nearly zero ohms (very low resistance). If the readings are not as stated, replace the circuit breaker with one of the same ratings.

NOTE: Readings may vary slightly depending on the accuracy of the measuring device.

Air Switch

If lamp and horn are on and pump in pump tank is performing normal:

1. Disconnect air line at fitting at bottom of control panel and feel for air coming out of line.
2. If air supply is normal, then air switch is malfunctioning. Replace switch through manufacturers' stock.

24 Hr. Clock Timer

Clock not running

1. Check for input power to the control panel.
2. Check all terminals for secure connections.
3. Check breaker for on position.
4. If no circuit fault is evident, replace clock. Clock may be obtained through manufacturers immediate stock.

Pump Test Switch

Switch not working

1. Turn OFF power. Disconnect both leads to the switch.
2. Connect one test lead from an OHM meter set on RX1 to one post on the pump test switch.
3. Connect the other lead from the same OHM meter to the other post of the pump test switch.
4. Pull on the toggle of the pump test switch.

Note: The meter needle should deflect across the entire scale. If the needle does not deflect or reads open, replace the switch with one of the same type and rating.

Test / Mute Switch

Switch not working.

1. Turn OFF power. Disconnect all leads from the "test/mute" switch.
2. Connect one lead from an OHM meter set on RX1 to the center post on circuit 1.
3. Connect the other lead from the OHM meter to the lower or second post in circuit 1.
 - A. With the toggle in the off or mute position there should be no deflection of the needle on the OHM meter.
 - B. With the toggle in the center position, the needle on the OHM meter should deflect across the entire scale.
 - C. By pulling the toggle into the "test" position the needle on the OHM meter should stay in the full deflection position.
4. Disconnect both leads from the switch
5. Connect one lead from an OHM meter set to RX1 to the center post of circuit 2 on the "test/mute" switch.
6. Connect the other lead from the same OHM meter to the lower or second post of circuit 2.
 - A. With the toggle on the off or mute position there should be no deflection of the needle on the OHM meter.
 - B. With the toggle in the center or normal position there should be no deflection of the needle on the OHM meter.
 - C. By pulling the toggle into the "test" position, the needle on the OHM meter should deflect across the entire scale.

NOTE: If results other than those just described are attained, replace the "test/mute" switch.


Float Controls

Check the floats throughout their entire range of operation. Clean, adjust, or replace damaged floats. Check the float resistance - The float resistance can be measured to determine if the float is operating correctly or is defective. Use the following procedure to measure the float resistance:

1. Isolate the float by disconnecting one or both of the float leads from the float terminals.
2. Place one Ohmmeter lead on one of the float wires, and the other ohmmeter lead on the other float wire.
3. Set the ohmmeter dial to read ohms and place on the RX1 scale. With the float in the OFF position the scale should read infinity (very high resistance). Replace the float if you do not get this reading. With the float in the ON position the scale should read nearly zero (very low resistance). Replace float if you do not get this reading.

NOTE: Readings may vary slightly depending on the length of wire and accuracy of the measuring device.

Pump test switch will bypass pump float switch and operate pump.

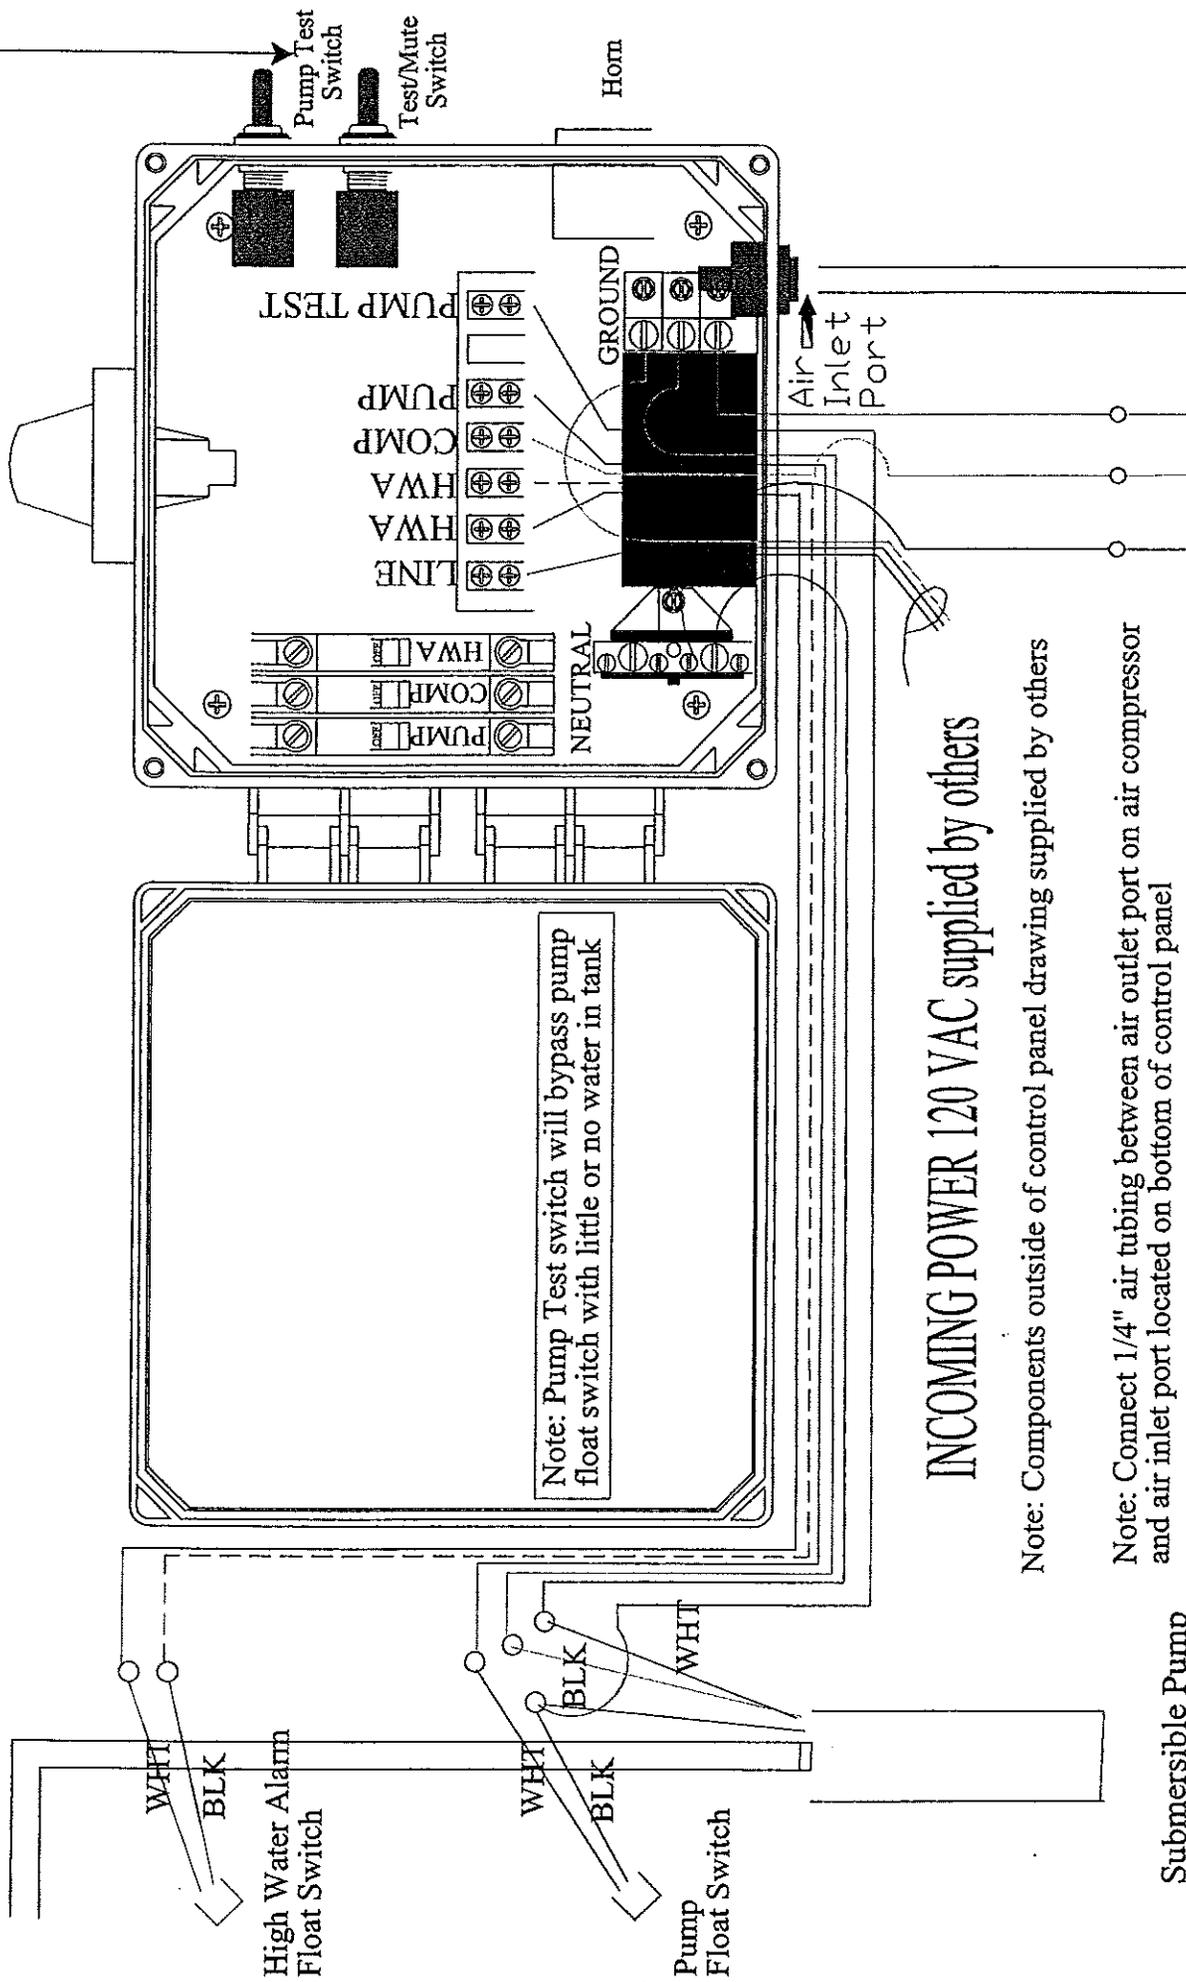

Note: Pump Test switch will bypass pump float switch with little or no water in tank

INCOMING POWER 120 VAC supplied by others


Note: Components outside of control panel drawing supplied by others

Note: Connect 1/4" air tubing between air outlet port on air compressor and air inlet port located on bottom of control panel

Submersible Pump
(Must be a U.L. recognized thermal protected motor)

Compressor
(Must be a U.L. recognized thermal protected motor)

Model 202 (PC-3BAP)

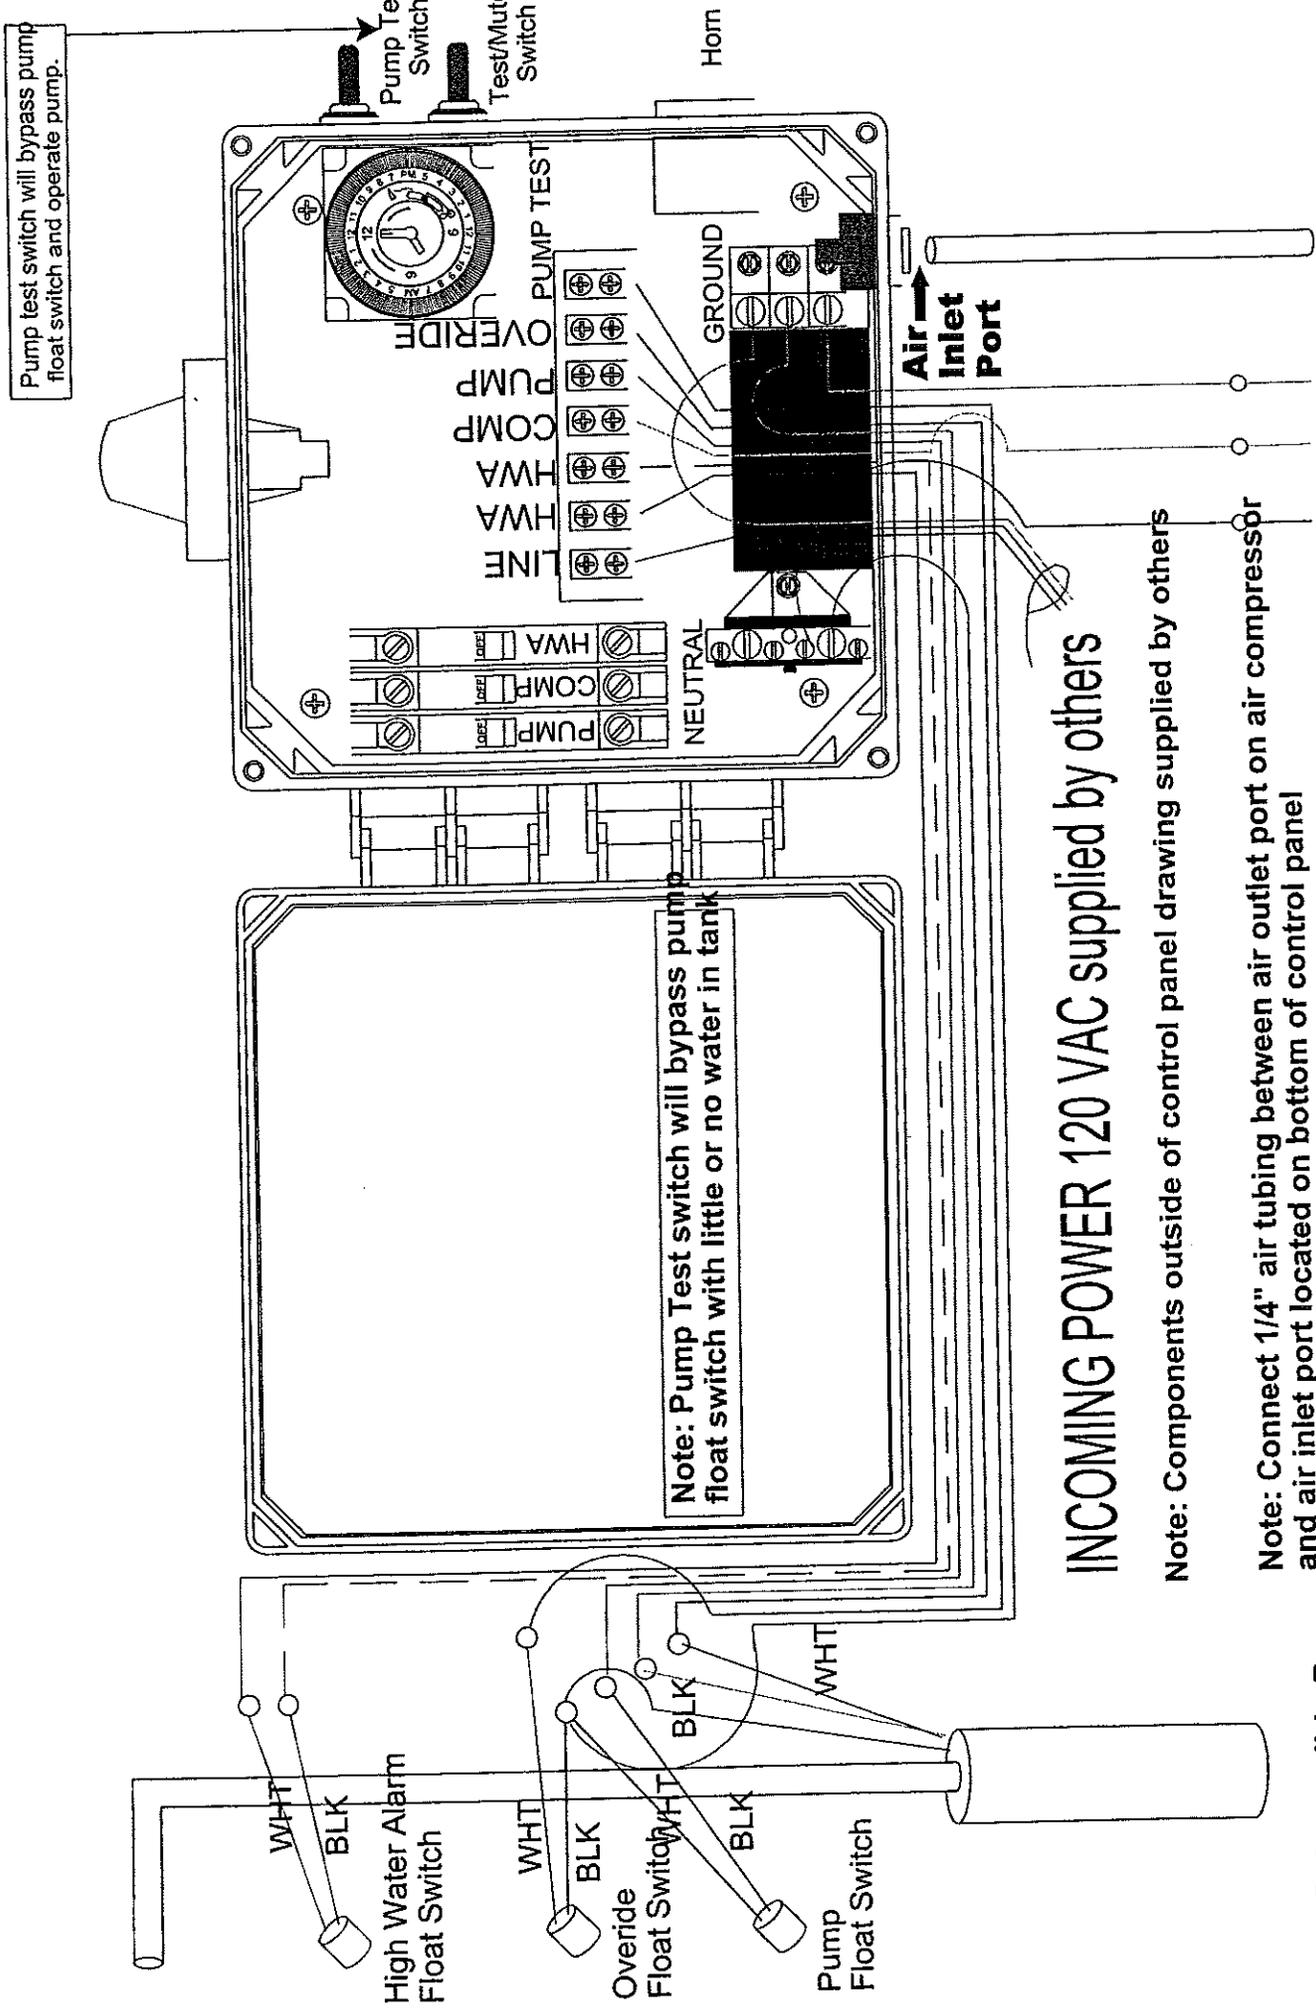

Pump test switch will bypass pump float switch and operate pump.

Note: Pump test switch will bypass pump float switch with little or no water in tank

INCOMING POWER 120 VAC supplied by others

Note: Components outside of control panel drawing supplied by others

Note: Connect 1/4" air tubing between air outlet port on air compressor and air inlet port located on bottom of control panel

Submersible Pump
 (Must be a U.L. recognized thermal protected motor)

Compressor
 (Must be a U.L. recognized thermal protected motor)

Model 203 (PC-3BTAP)

REFER TO DIA. # 2 FOR LOW CHLORINE SENDING UNIT WIRING INSTRUCTIONS

High Water Alarm Float Switch


Override Float Switch

Pump Float Switch

Submersible Pump
(Must be a U.L. recognized thermal protected motor)

Note: Pump Test switch will bypass pump float switch with little or no water in tank

Pump test switch will bypass pump float switch and operate pump.

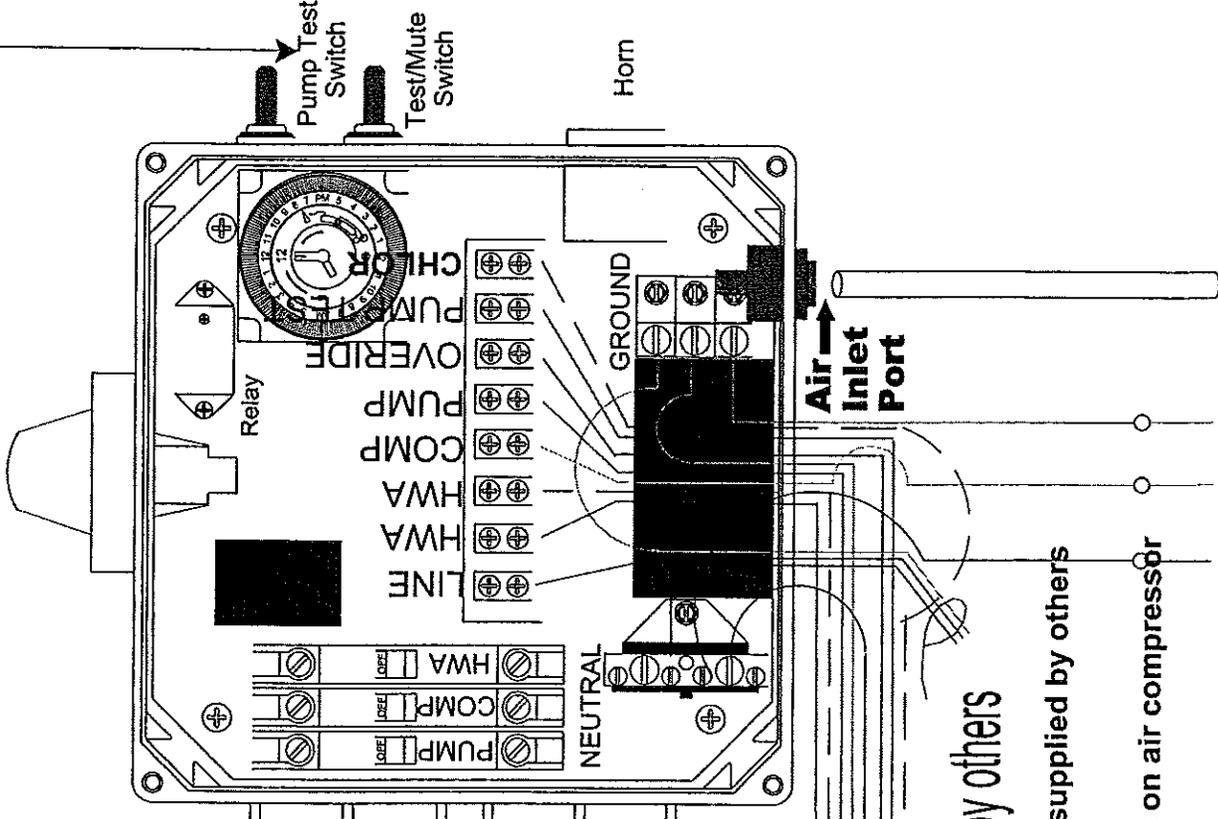

INCOMING POWER 120 VAC supplied by others

Note: Components outside of control panel drawing supplied by others


Note: Connect 1/4" air tubing between air outlet port on air compressor and air inlet port located on bottom of control panel

Compressor
(Must be a U.L. recognized thermal protected motor)


Model 205 (PC-3BTAPL)

REFER TO DIA. #2 FOR LOW CHLORINE SENDING UNIT WIRING INSTRUCTIONS

Chlorine Alarm Switch Patent Pending

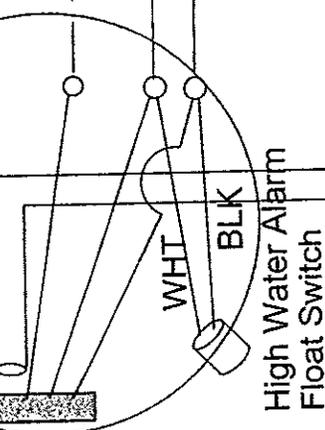


High Water Alarm Float Switch

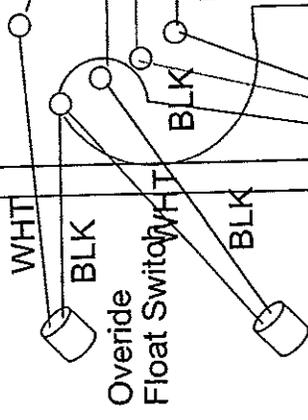


Override Float Switch

Pump Float Switch

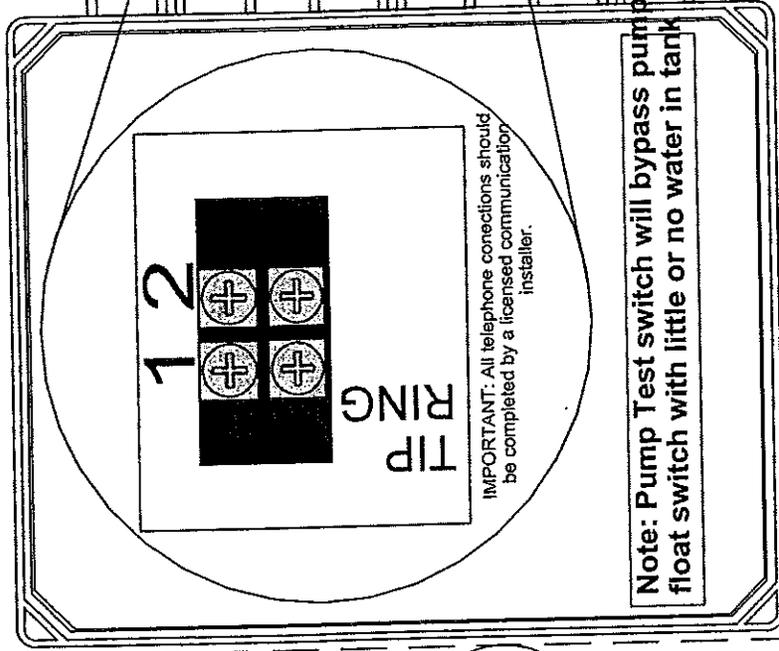

Note: Pump Test switch will bypass pump float switch with little or no water in tank

IMPORTANT: All telephone connections should be completed by a licensed communication installer.

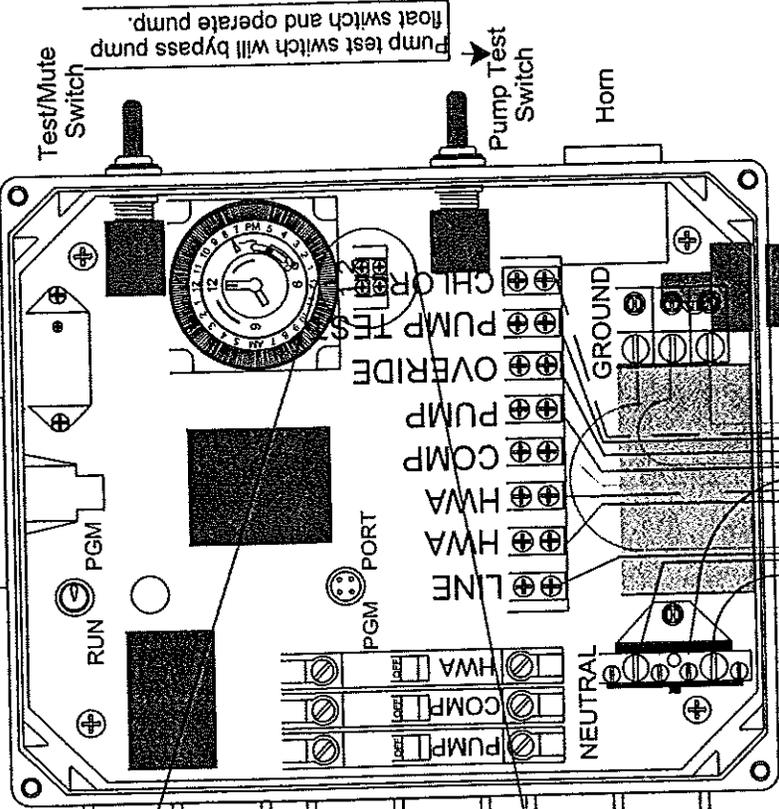

Test/Mute Switch

Pump Test Switch

Pump test switch will bypass pump float switch and operate pump.

Air Inlet Port

INCOMING POWER 120 VAC supplied by others

Note: Components outside of control panel drawing supplied by others

Note: Connect 1/4" air tubing between air outlet port on air compressor and air inlet port located on bottom of control panel


Compressor

(Must be a U.L. recognized thermal protected motor)

Model 206 (PC-3BTAPC)

Submersible Pump
(Must be a U.L. recognized thermal protected motor)

REFER TO DIA. #2 FOR LOW CHLORINE SENDING UNIT WIRING INSTRUCTIONS

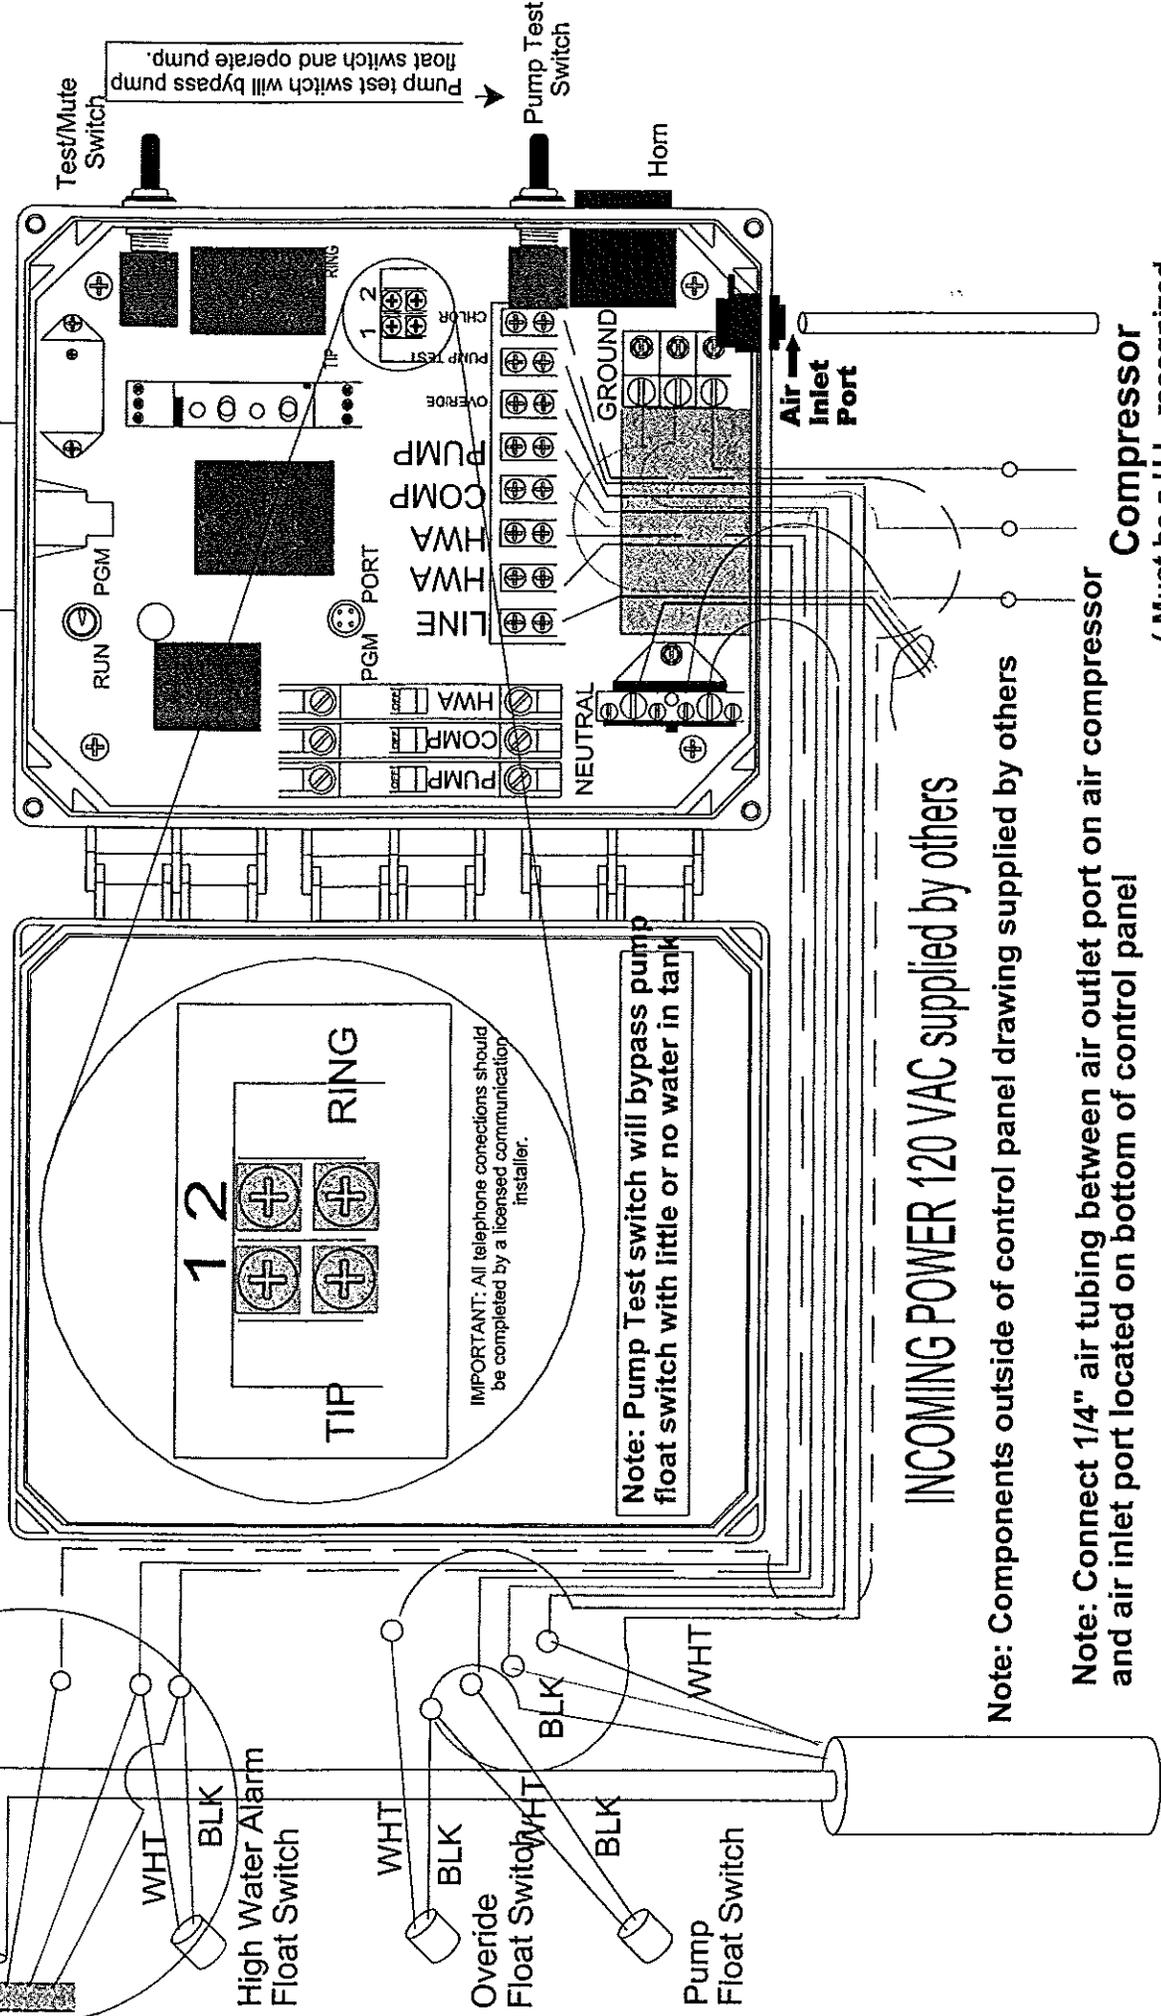

Chlorine Alarm Switch Patent Pending

High Water Alarm Float Switch

Override Float Switch

Pump Float Switch

WHT BLK WHT BLK WHT BLK

WHT BLK WHT BLK

WHT BLK WHT BLK

WHT BLK WHT BLK

WHT BLK WHT BLK

WHT BLK WHT BLK

WHT BLK WHT BLK

WHT BLK WHT BLK

WHT BLK WHT BLK

WHT BLK WHT BLK

WHT BLK WHT BLK

WHT BLK WHT BLK

WHT BLK WHT BLK

WHT BLK WHT BLK

WHT BLK WHT BLK

1 2 TIP RING

IMPORTANT: All telephone connections should be completed by a licensed communication installer.

Note: Pump Test switch will bypass pump float switch with little or no water in tank

INCOMING POWER 120 VAC supplied by others

Note: Components outside of control panel drawing supplied by others

Note: Connect 1/4" air tubing between air outlet port on air compressor and air inlet port located on bottom of control panel

Submersible Pump (Must be a U.L. recognized thermal protected motor)

Compressor (Must be a U.L. recognized thermal protected motor)

Model 214-1

DIAGRAM # 1

Test/Mute Switch

Pump Test Switch

Hom

Air Inlet Port

Compressor

(Must be a U.L. recognized thermal protected motor)

Model 214-1

DIAGRAM # 1

Test/Mute Switch

Test/Mute Switch

Pump Test Switch

Hom

Air Inlet Port

Compressor

(Must be a U.L. recognized thermal protected motor)

Model 214-1

DIAGRAM # 1

Test/Mute Switch

Pump Test Switch

Hom

Air Inlet Port

Compressor

(Must be a U.L. recognized thermal protected motor)


Model 214-1

DIAGRAM # 1

Test/Mute Switch

Pump Test Switch

Hom

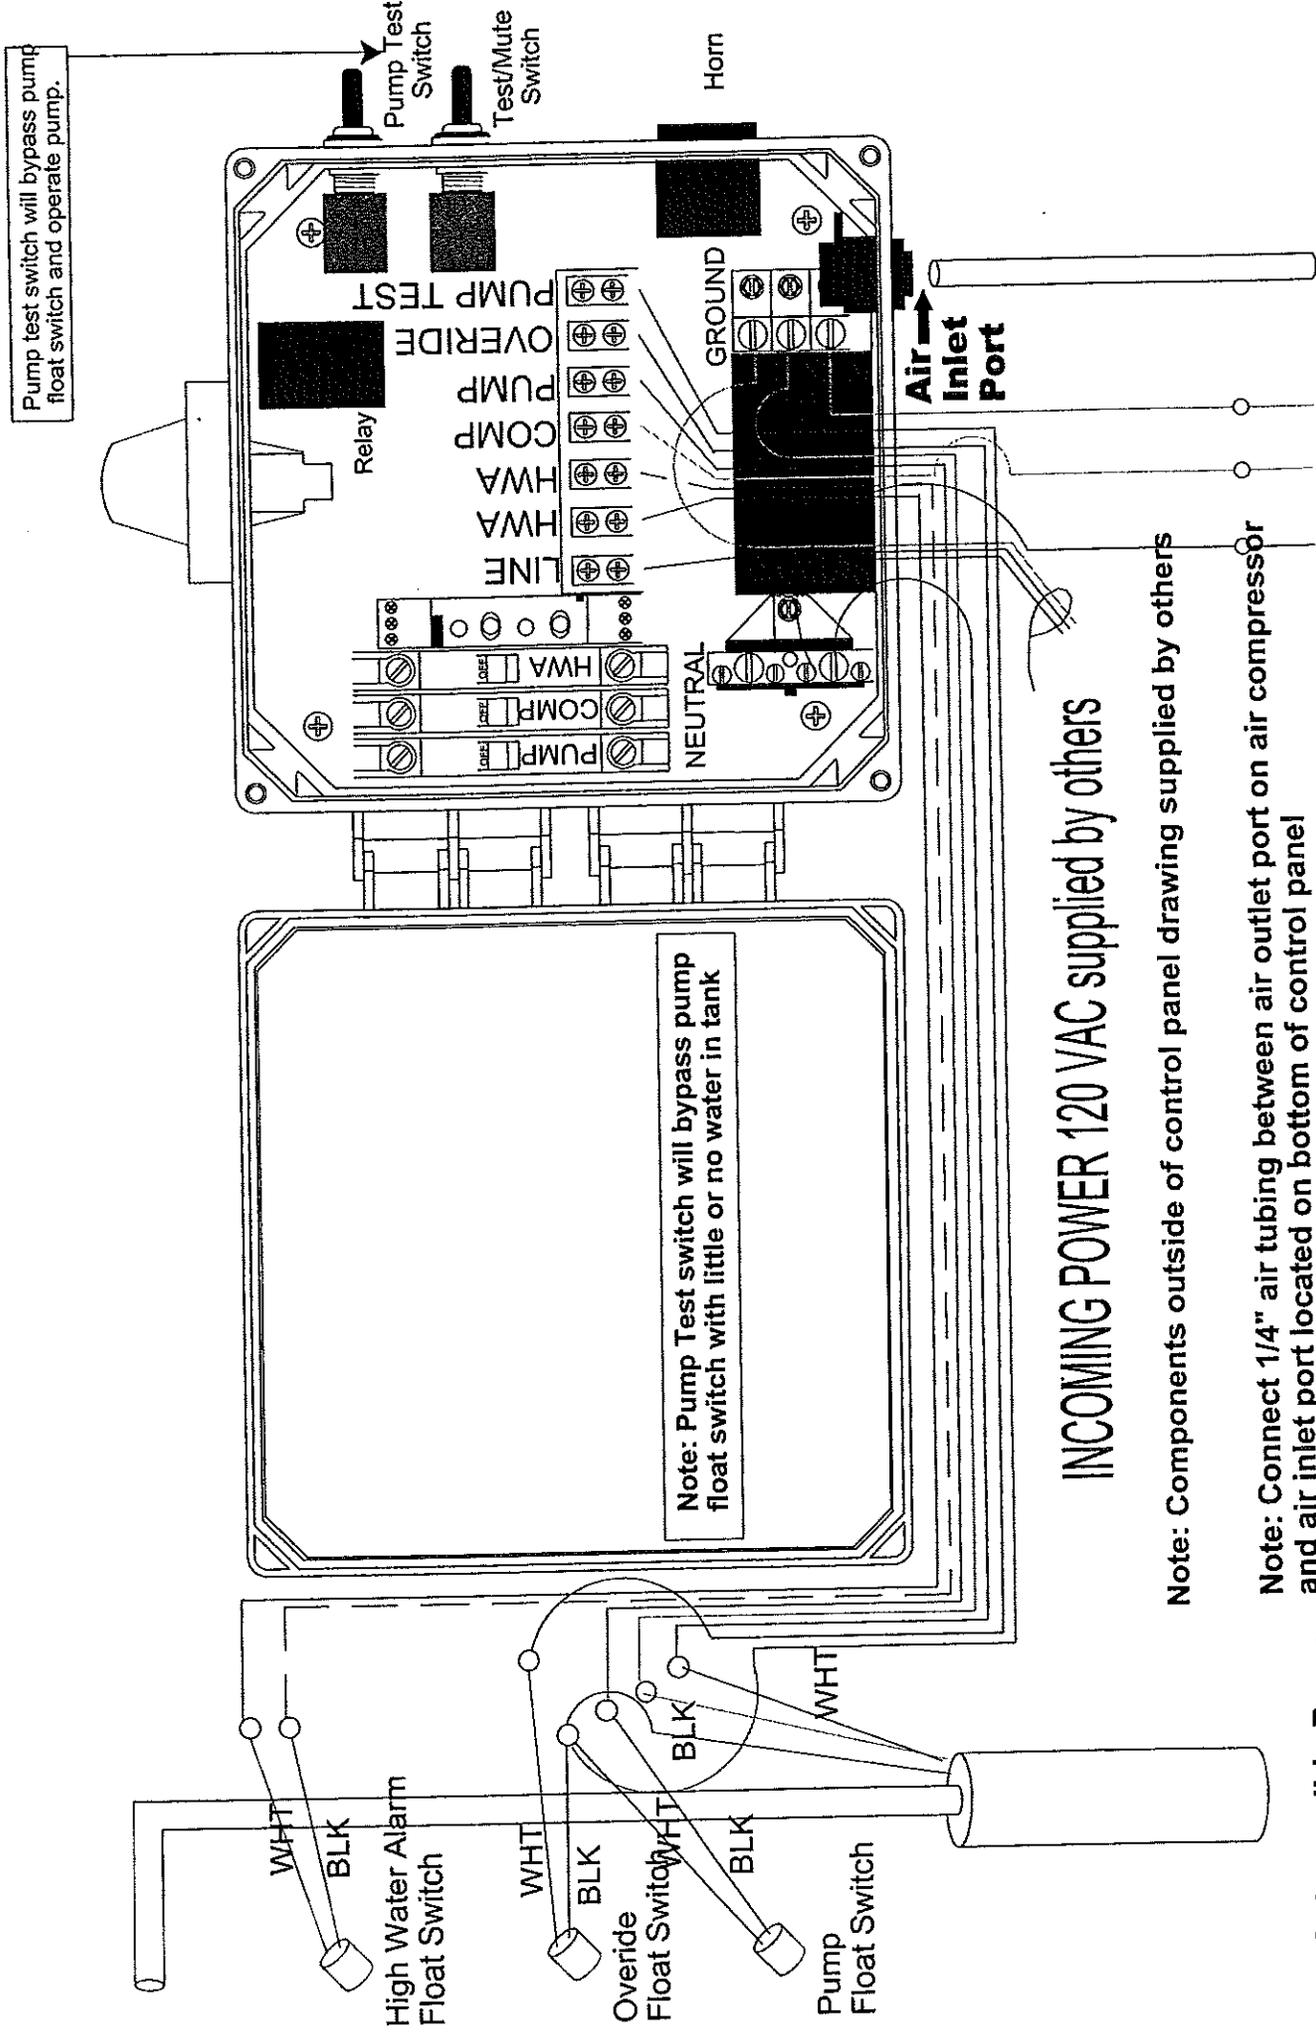

Pump test switch will bypass pump float switch and operate pump.

Note: Pump Test switch will bypass pump float switch with little or no water in tank

INCOMING POWER 120 VAC supplied by others

Note: Components outside of control panel drawing supplied by others

Note: Connect 1/4" air tubing between air outlet port on air compressor and air inlet port located on bottom of control panel

Submersible Pump
(Must be a U.L. recognized thermal protected motor)

Compressor
(Must be a U.L. recognized thermal protected motor)

Model 217-1(PC-3BRAP)

CAUTION: IT IS IMPORTANT TO CONNECT LINE(1) IN THE JUNCTION BOX TO THE H.W.A.(1) IN THE CONTROL PANEL AND LINE(2) IN THE JUNCTION BOX TO THE H.W.A.(2) IN THE CONTROL PANEL.

INSTRUCTIONS FOR Chlorine EWDS (Early Warning Detection System)

Patent Pending


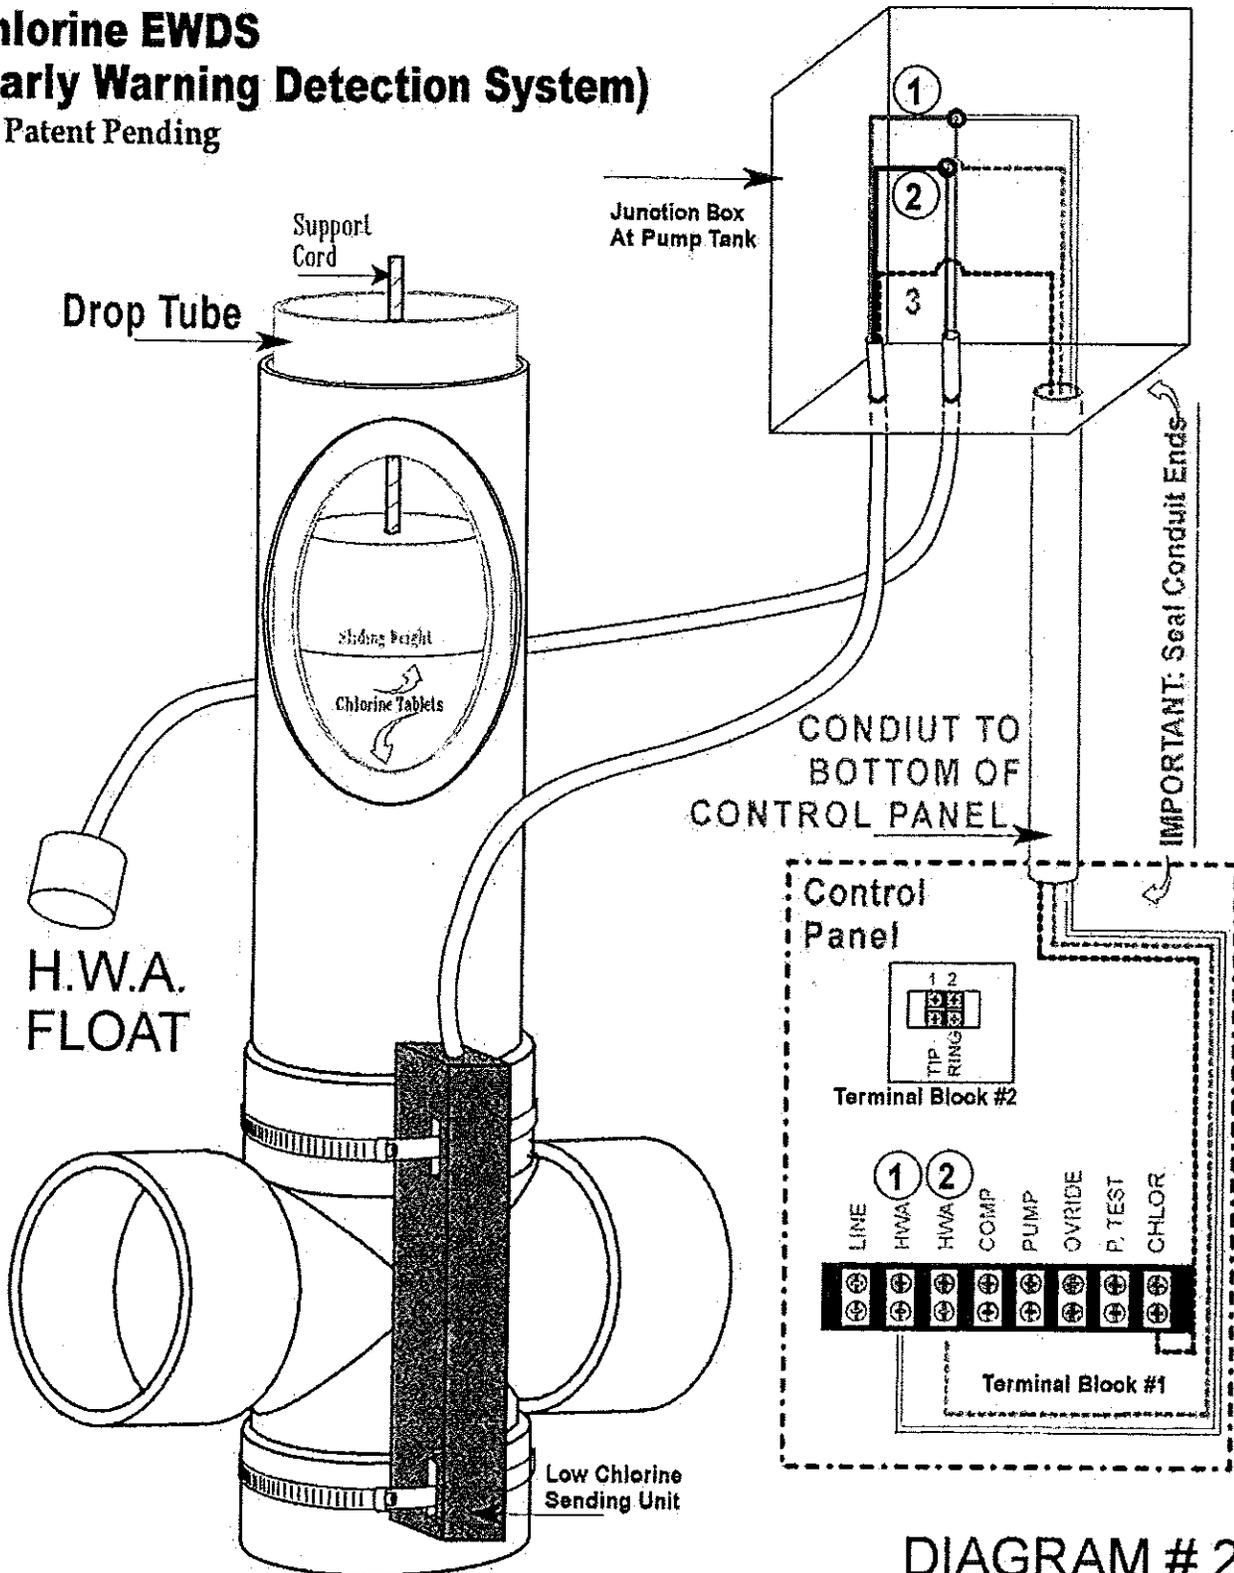


DIAGRAM # 2

Model 203 (PC-3BTAP)

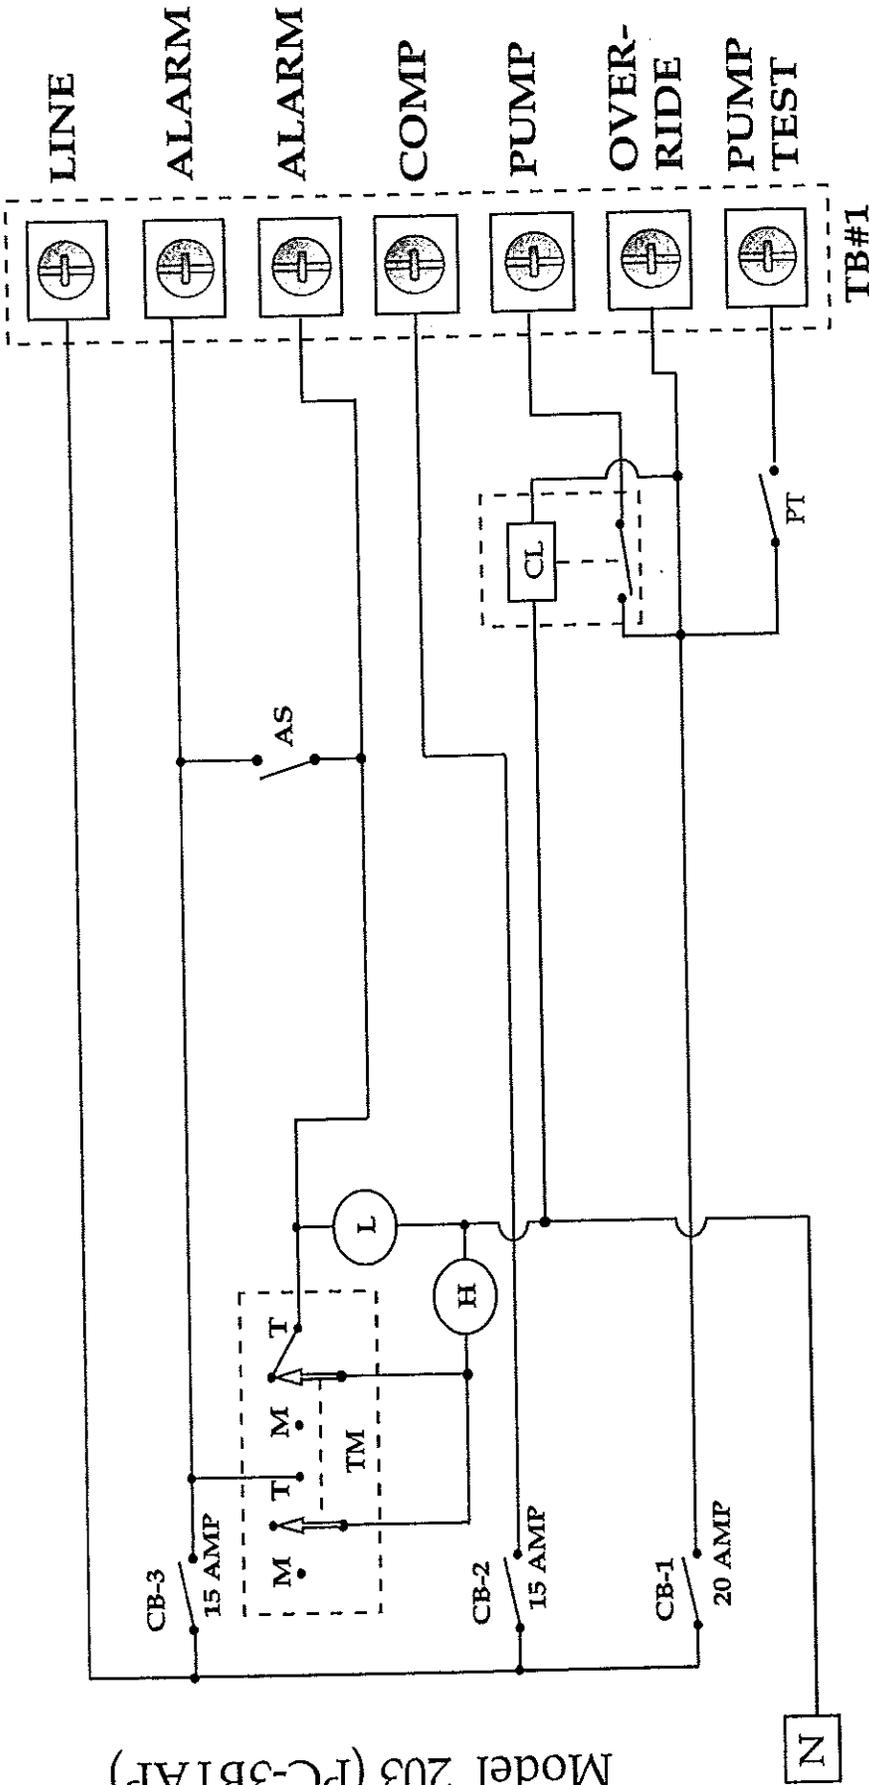

20 Amps max Full Load, 1 HP max


CB= circuit breaker G= ground bus
 L= warning light H= horn C= common bus
 CL= clock AS= air switch PT= pump test switch
 MT=mute/ test switch TB= terminal block
 AC= 120V, 60HZ, Single Phase

**Main Disconnect and 30 Amp
 Circuit Breaker Provided
 By Others**

Use Copper, 60°C wire insulation minimum
External components (compressors and/or pumps)
supplied by others and must be U.L. Recognized
Thermal Protect type motors

TORQUE REQUIREMENTS FOR SLOTTED SCREWS			
	Min.	Max.	
14 - 10 AWG	32	35	LB-IN
8	36	40	LB-IN

Model 205 (PC-3BTAPL)

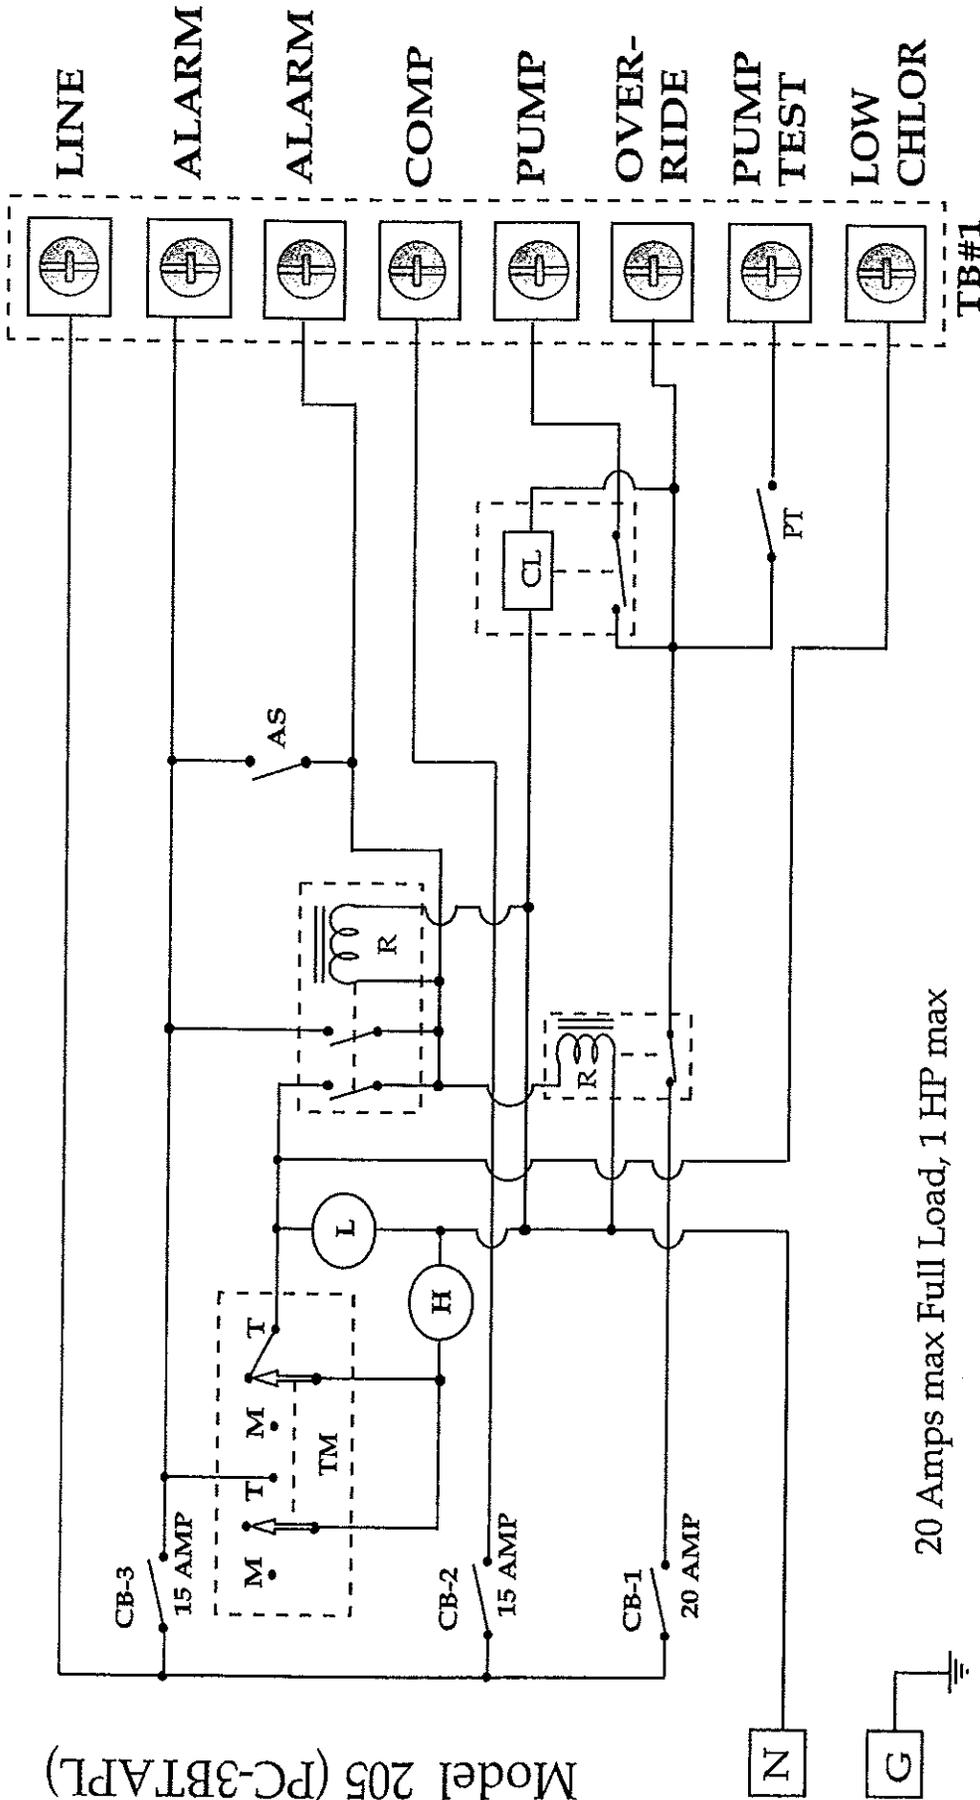

20 Amps max Full Load, 1 HP max

CB= circuit breaker G= ground bus
 L= warning light H= horn C= common bus
 CL= clock AS= air switch PT= pump test switch
 MT=mute/ test switch TB= terminal block
 AC= 120V, 60HZ, Single Phase R= relay


Use Copper, 60°C wire insulation minimum
 External components (compressors and/or pumps)
 supplied by others and must be U.L. Recognized
 Thermal Protect type motors

Main Disconnect and 30 Amp
 Circuit Breaker Provided
 By Others

TORQUE REQUIREMENTS FOR SLOTTED SCREWS

SCREWS	Min.	Max.
14 - 10 AWG	32	35 LB-IN
8 AWG	36	40 LB-IN

Model 206-4 (PC-3BTAPC)

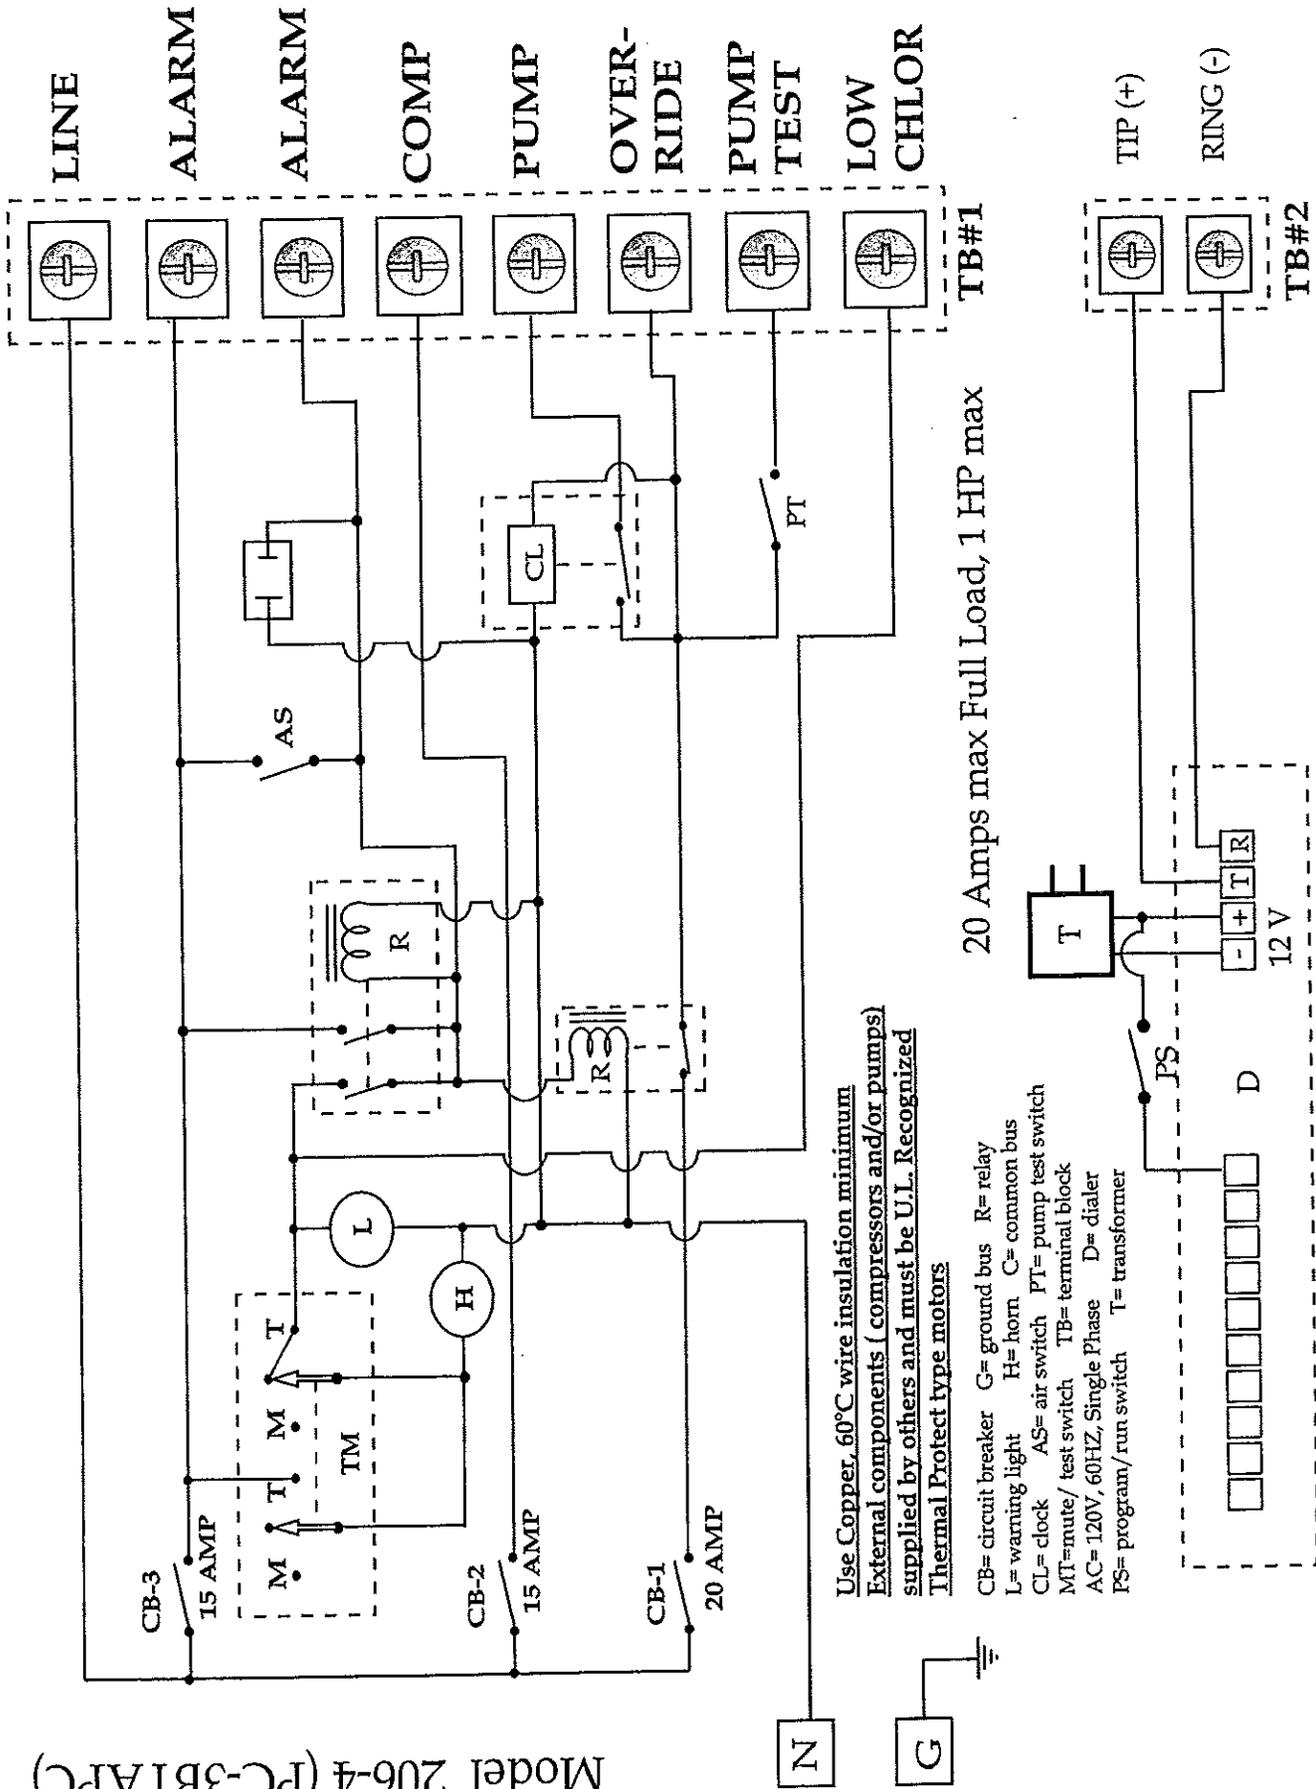

20 Amps max Full Load, 1 HP max

Use Copper, 60°C wire insulation minimum
 External components (compressors and/or pumps) supplied by others and must be U.L. Recognized Thermal Protect type motors


- CB= circuit breaker G= ground bus R= relay
- L= warning light H= horn C= common bus
- CL= clock AS= air switch PT= pump test switch
- MT=mute/ test switch TB= terminal block
- AC= 120V, 60HZ, Single Phase D= dialer
- PS= program/run switch T= transformer

TORQUE REQUIREMENTS FOR SLOTTED SCREWS

	Min.	Max.
14 - 10 AWG	32	35
8 AWG	36	40

Main Disconnect and 30 Amp Circuit Breaker Provided By Others

Model 217 (PC-3BRAP)

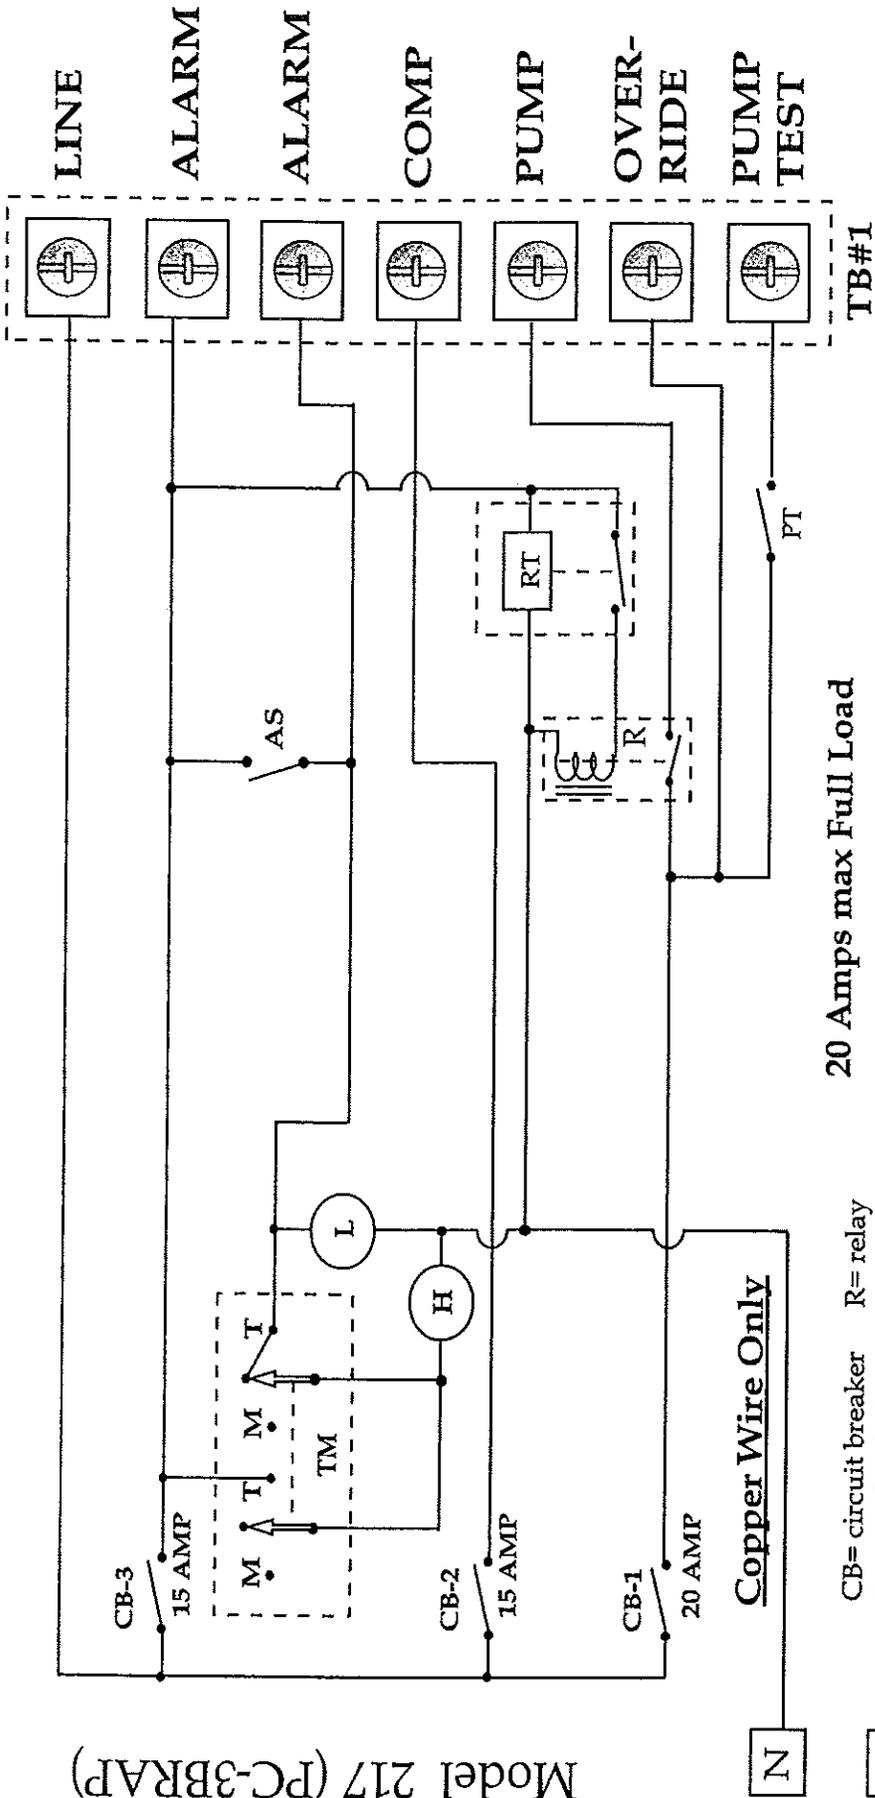

20 Amps max Full Load


Copper Wire Only

- CB= circuit breaker R= relay
- L= warning light H= horn
- G= ground bus AS= air switch PT= pump test switch
- TM= test/mute switch TB= terminal block
- LINE= 120V AC N= neutral
- RT= recycle timer

Main Disconnect Protection
Provided By Others

TORQUE REQUIREMENTS FOR SLOTTED SCREWS			
	Min.	Max.	
14 - 10 AWG	32	35	LB-IN
8 AWG	36	40	LB-IN

Model 214 (PC-3BRAPC)

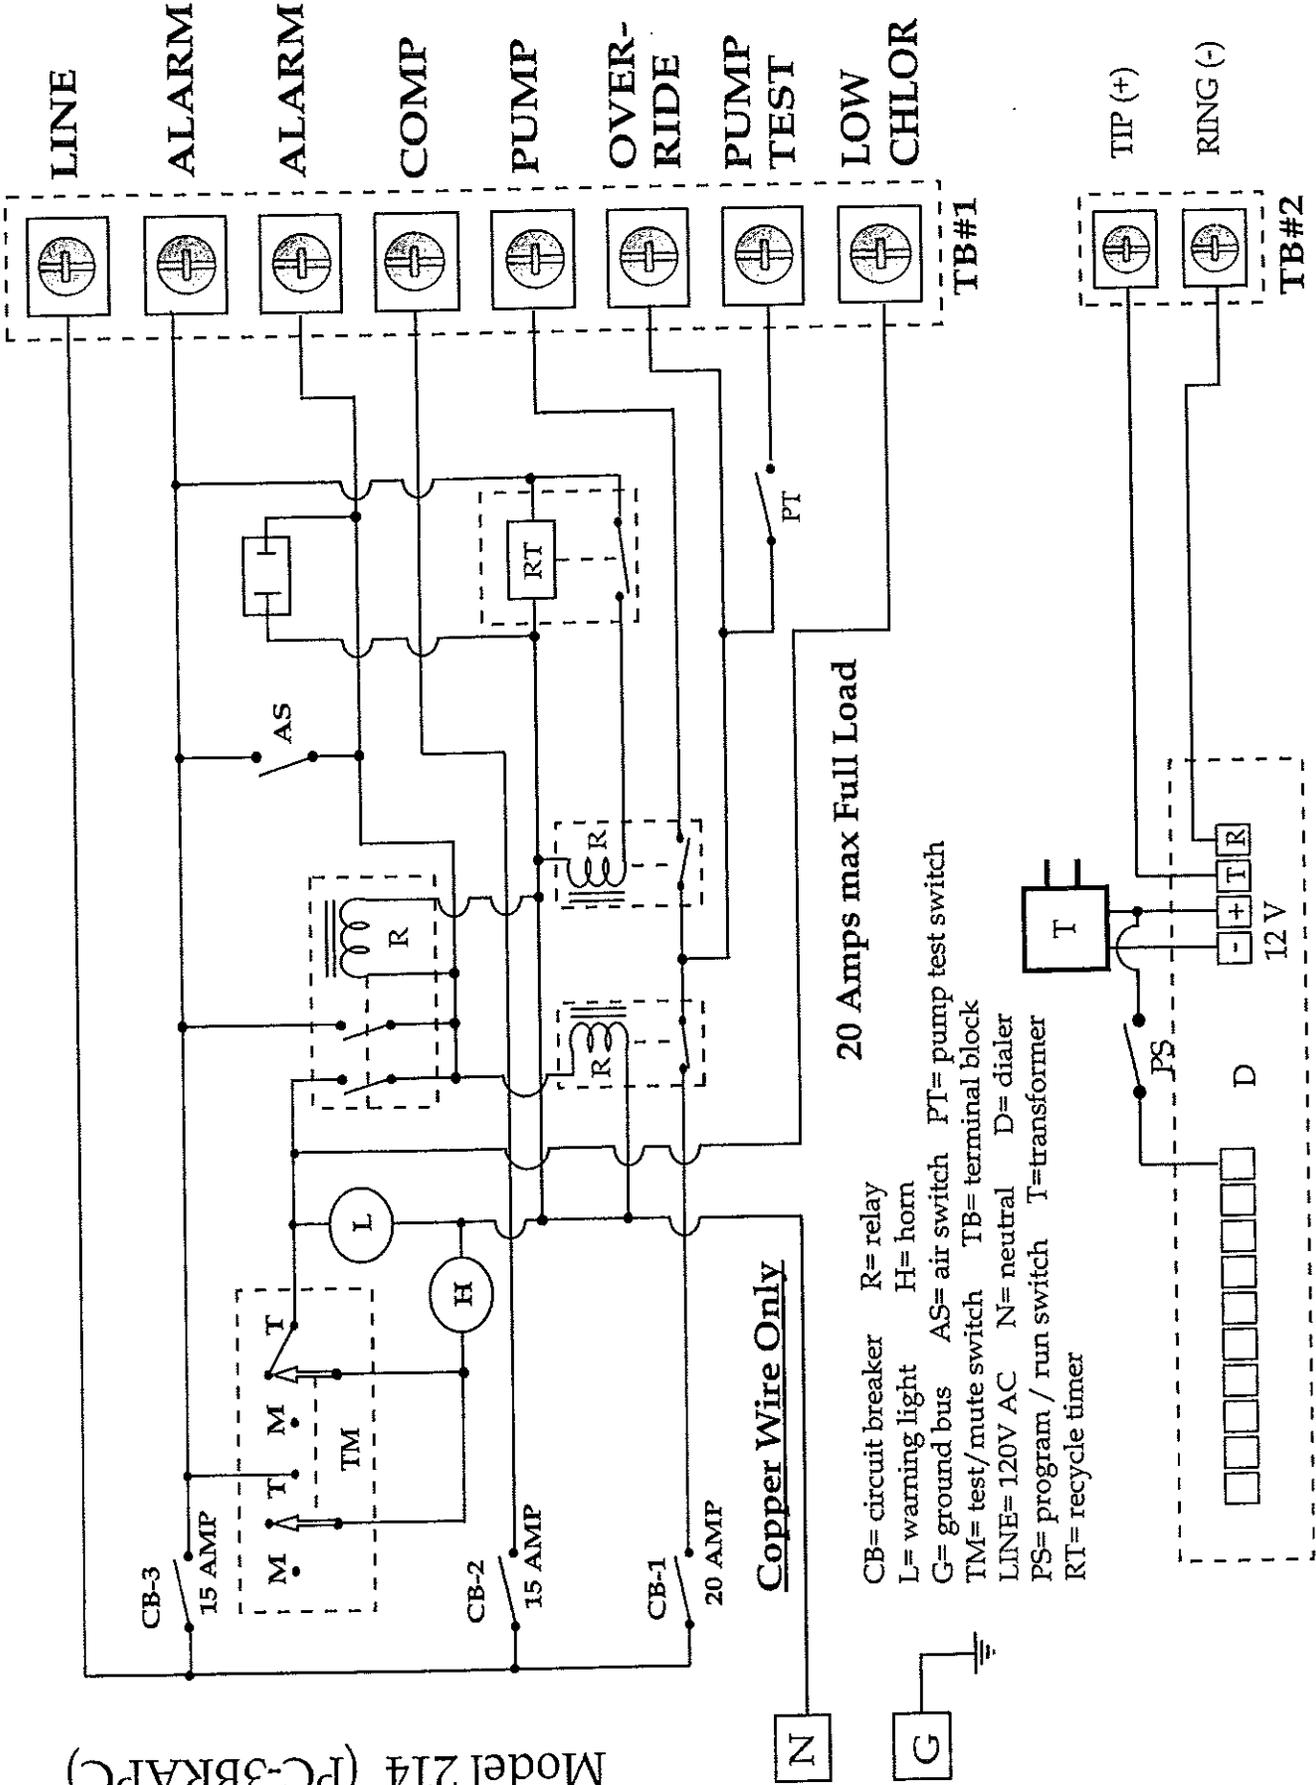

Copper Wire Only

20 Amps max Full Load


- CB= circuit breaker R= relay
- L= warning light H= horn
- G= ground bus AS= air switch PT= pump test switch
- TM= test/ mute switch TB= terminal block
- LINE= 120V AC N= neutral D= dialer
- PS= program / run switch T=transformer
- RT= recycle timer

**Main Disconnect Protection
Provided By Others**

TORQUE REQUIREMENTS FOR SLOTTED SCREWS

	Min.	Max.
14 - 10 AWC	32	35 LB-IN
8	36	40 LB-IN

Model 224 (R1PS/120V)

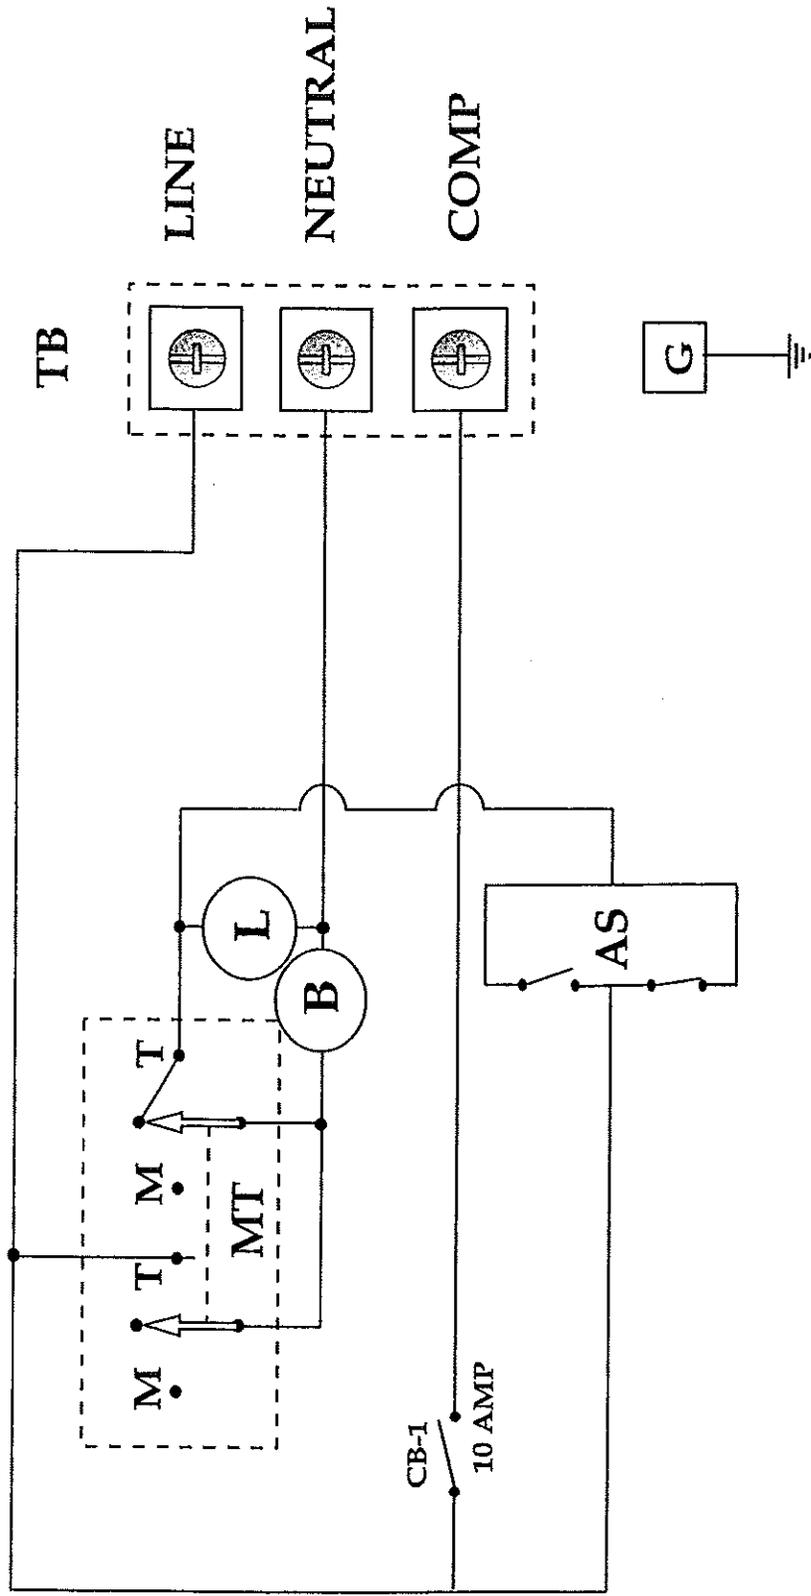

20 Amps max Full Load

Copper Wire Only


CB= circuit breaker AS= air switch
 L= warning light B=buzzer
 MT= mute/test switch TB= terminal block
 AC= 120V, 60HZ C= common bus G= ground bus

**Main Disconnect Protection
 Provided By Others**

TORQUE REQUIREMENTS FOR SLOTTED			
SCREWS	Min.	Max.	
14 - 10 AWG	32	35	LB-IN
8 AWG	36	40	LB-IN

HIBLOW HP80-013A Compressor Alarm Module Operating Instructions

- ⚠ Danger: Do not attempt to open the alarm module. If the unit is connected to electricity, opening of the alarm module can result in a risk of electric shock.
- ⚠ Danger: Service of the alarm module should only be done by a qualified electrician or serviceman.
- ⚠ Danger: If the outside of the alarm module or light lens becomes cracked or damaged, unplug or shut-off the electric power immediately and contact an electrician or serviceman.
- ⚠ Caution: Do not carry the unit by the alarm module or electrical cord. It could damage the alarm module.

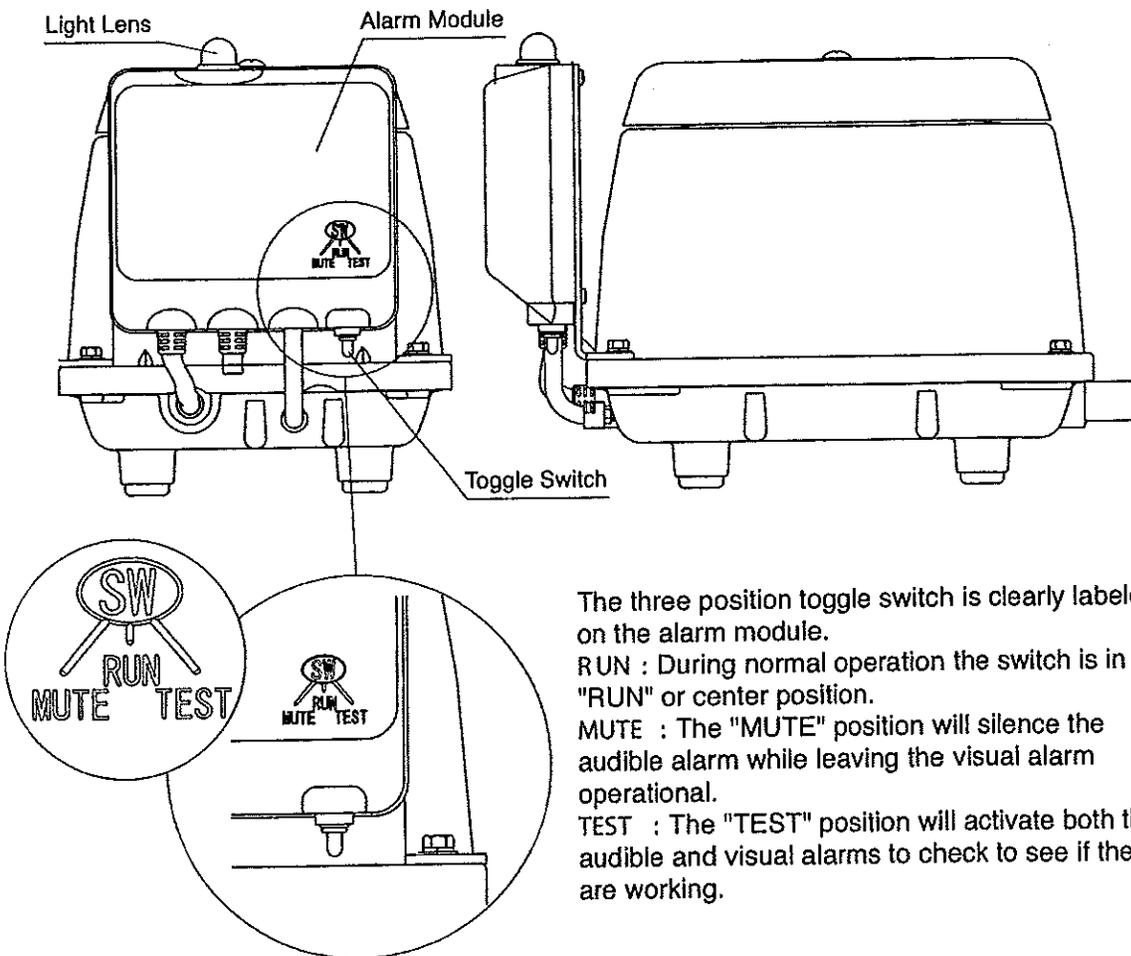

The three position toggle switch is clearly labeled on the alarm module.

RUN : During normal operation the switch is in the "RUN" or center position.

MUTE : The "MUTE" position will silence the audible alarm while leaving the visual alarm operational.

TEST : The "TEST" position will activate both the audible and visual alarms to check to see if they are working.

In Case of an Alarm :

The alarm module audible alarm (buzzer) and visual alarm (light) are intended to signal a system malfunction. Contact your service provider whenever you hear or see the alarm when the switch is in the "RUN" or center position. The "MUTE" position can be used to silence the audible alarm until the service provider arrives.

AERATOR SPECIFICATIONS

Aqua Aire aerators for use with all models:

All aerators listed are 115 Volt, 60 Hertz and Single Phase

Models: AA500, AA500T, AA500-32, AA500-35, AA500-3575, AA500-4075, AA500-4050

SECOH Model EL80-15 - Linear - 2.6 amps / 106 watts / 3.4 CFM open flow

GAST Model RV03 - Rotary - 3.0 amps / 120 watts / 3.8 CFM open flow

Hiblow Model HP80 - Linear - 2.0 amps / 76 watts / 3.9 CFM open flow

Model AA600

SECOH EL80-17 - Linear - 1.8 amps / 131 watts / 4.6 CFM open flow

GAST Model RV03 - Rotary - 3.0 amps / 120 watts / 3.8 CFM open flow

Hiblow Model HP80 - Linear - 2.0 amps / 76 watts / 3.9 CFM open flow

Models AA750T and AA750

GAST Model RV05 - Rotary - 3.0 amps / 120 watts / 4.8 CFM open flow

SECOH Model EL100 - Linear - 2.5 amps / 174 watts / 5.3 CFM open flow

Hiblow Model HP120 - Linear - 2.1 amps / 105 watts / 5.6 CFM open flow

Model AA800

GAST Model RV05 - Rotary - 3.0 amps / 120 watts / 4.8 CFM open flow

SECOH Model EL100 - Linear - 2.5 amps / 174 watts / 5.3 CFM open flow

Hiblow Model HP120 - Linear - 2.1 amps / 105 watts / 5.6 CFM open flow

Model AA1000

GAST Model 0823 - Rotary - 8.6 amps / 700 watts / 7.2 CFM open flow

SECOH Model EL150 - Linear - 3.6 amps / 262 watts / 9.7 CFM open flow

Hiblow Model HP150 - Linear - 2.1 amps / 125 watts / 6.4 CFM open flow

Model AA1200

GAST Model 0823 - Rotary - 8.6 amps / 700 watts / 7.2 CFM open flow

SECOH Model EL150 - Linear - 3.6 amps / 262 watts / 9.7 CFM open flow

Hiblow Model HP200 - Linear - 4.3 amps / 225 watts / 8.3 CFM open flow


Model AA1500

Hiblow Model HP200 - Linear - 4.3 amps / 225 watts / 8.3 CFM open flow

SECOH Model EL200 - Linear - 5.2 amps / 350 watts / 11.6 CFM open flow


GAST Model 1023 - Rotary - 10.0 amps / 950 watts / 10 CFM open flow

Secoh EL-80 Parts List

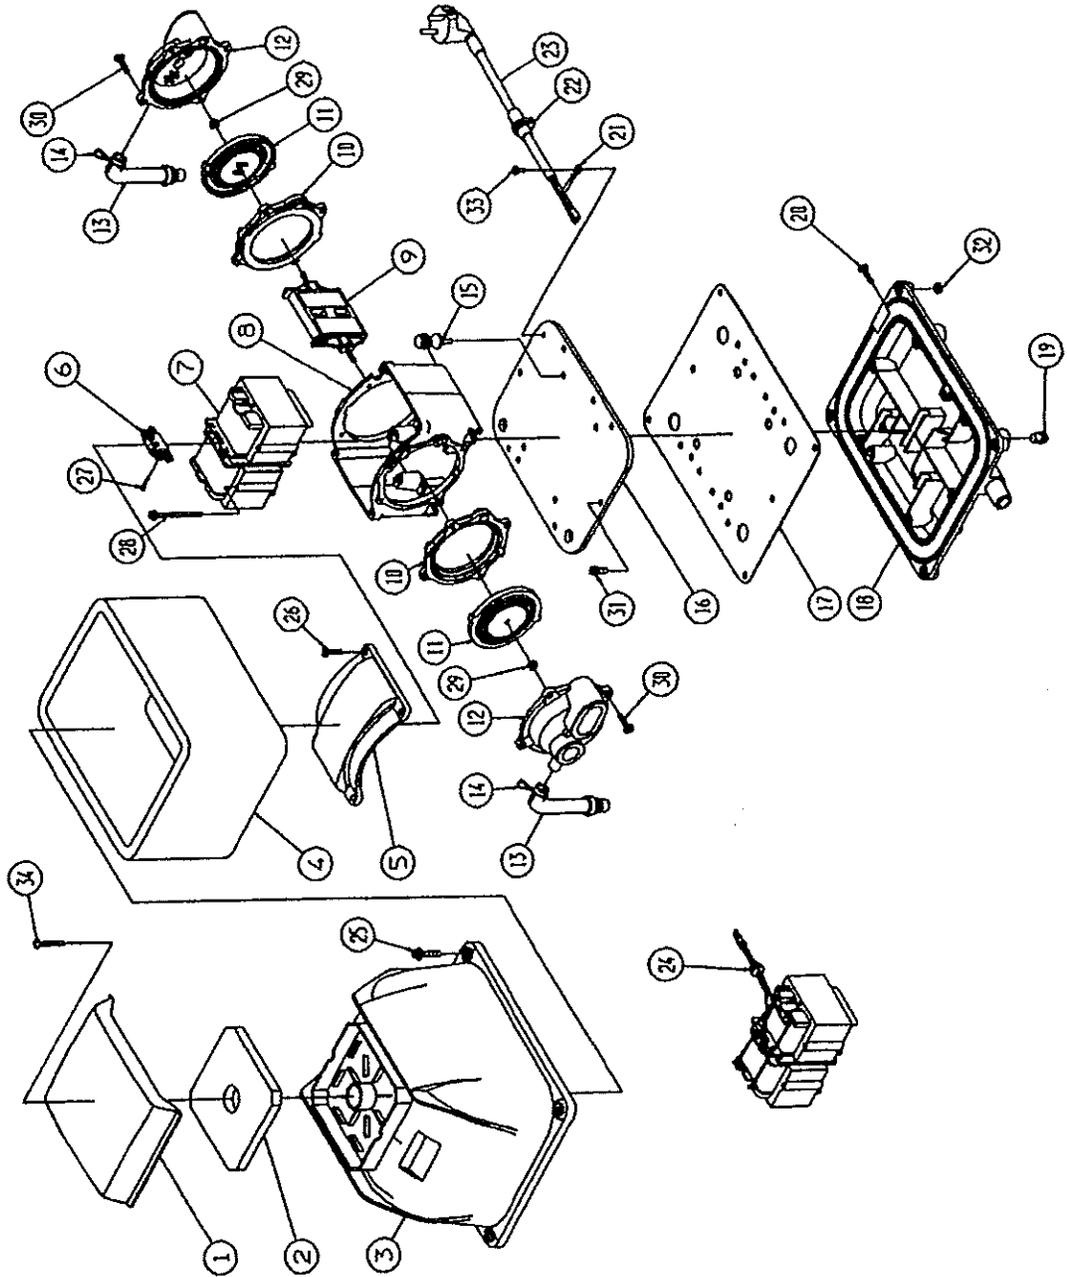

No	Parts name	Qty (pcs)
1	Filter Cover	1
2	Filter Element	1
3	Overall Cover	1
4	Shock Absorber	1
5	Holder Cover	1
6	Auto Stopper	1
7	Solenoid	2
8	Solenoid Holder	1
9	Magnet	1
10	Diaphragm Holder	2
11	Diaphragm	2
12	Valve Box	2
13	Connecting Pipe	2
14	Hose Band	2
15	Vibration Isolating Rubber	4
16	Tank Base Cover	1
17	Tank Base Packing	1
18	Tank Base	1
19	Rubber Foot	4
20	Earth Screw	1
21	Terminal	1
22	Rubber Bush	1
23	Power Supply Cord	1
24	Lead-in Wire Bush	1
25	Bolt	4
26	Screw	4
27	Screw	2
28	Bolt	6
29	Hex.Nut	2
30	Screw	8
31	Bolt	6
32	Hex.Nut	4
33	Screw	1
34	Screw	1


EL-150.200

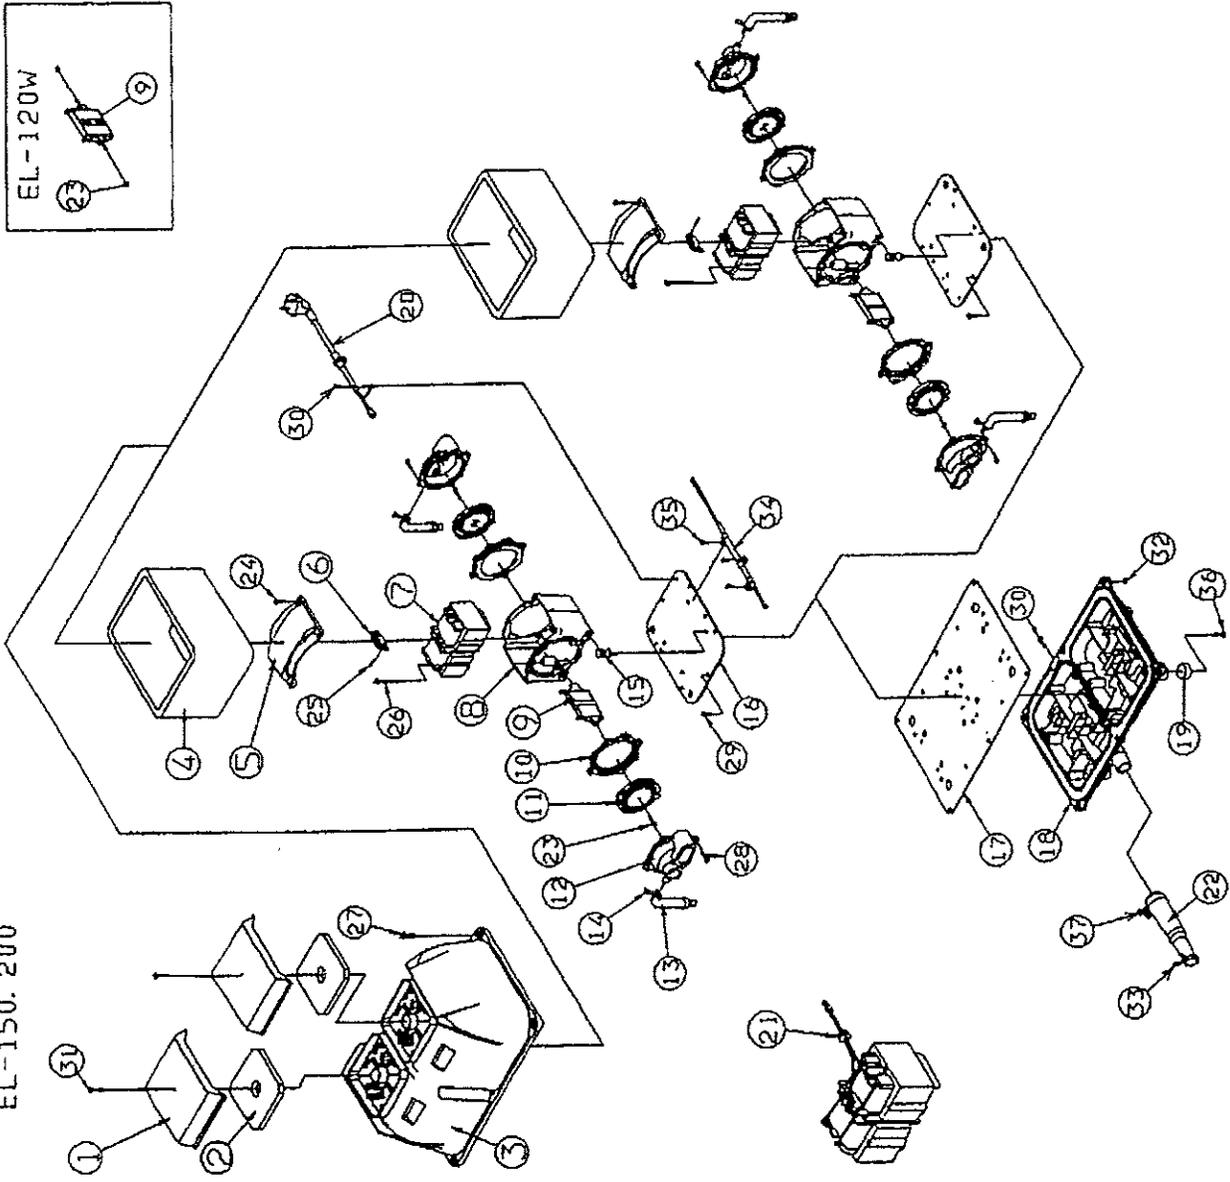


37	Hose Band
35,36	Screw
34	Connecting Cord
33	Hose Band
32	Hexagonal nut
24,31	Screw
23	Hexagonal nut (EL-120W, Screw (EL-150, 200))
22	Air Supply Hose
21	Lead-in Wire Bush
20	Power Supply Cord
19	Rubber Foot
18	Tank Base
17	Tank Base Packing
16	Tank Base Cover
15	Vibration Isolating Rubber
14	Hose Band
13	Connectings Pipe
12	Valve Box
11	Diaphragm
10	Diaphragm Holder
9	Magnet
8	Solenoid Holder
7	Solenoid
6	Auto Stopper
5	Holder Cover
4	Shock Absorber
3	Overall Cover
2	Filter Element
1	Filter Cover
No.	
ED G009 01.4.3	
EL-120W~200	
CE marking	
FREE	
AS	10

HIBLOW/GAST Spare Parts

HP SERIES

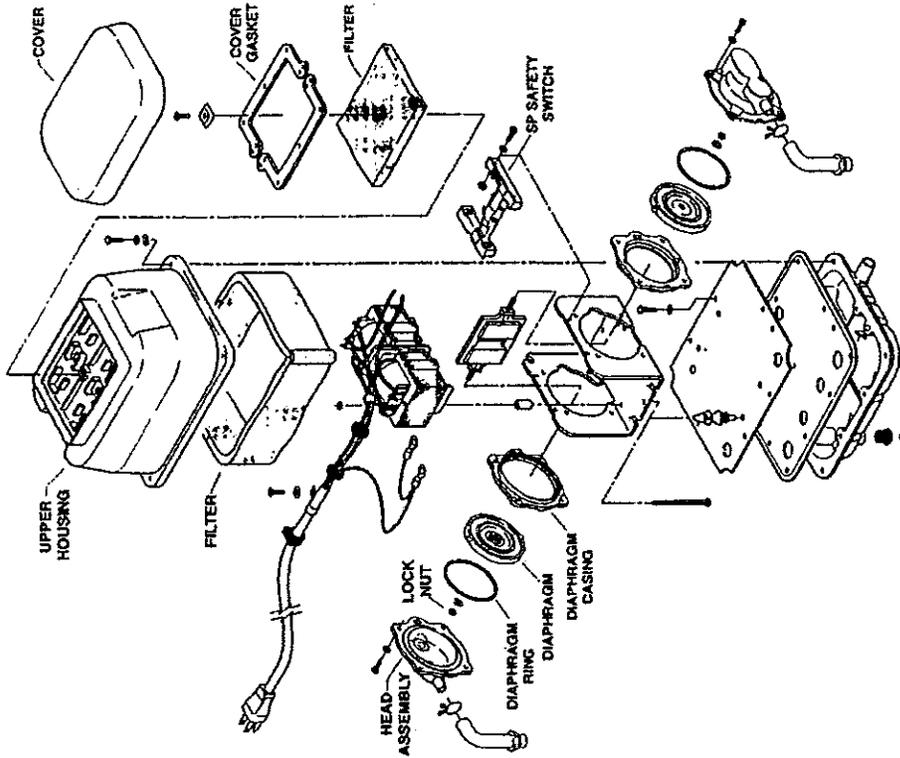


GJL, GJH SERIES

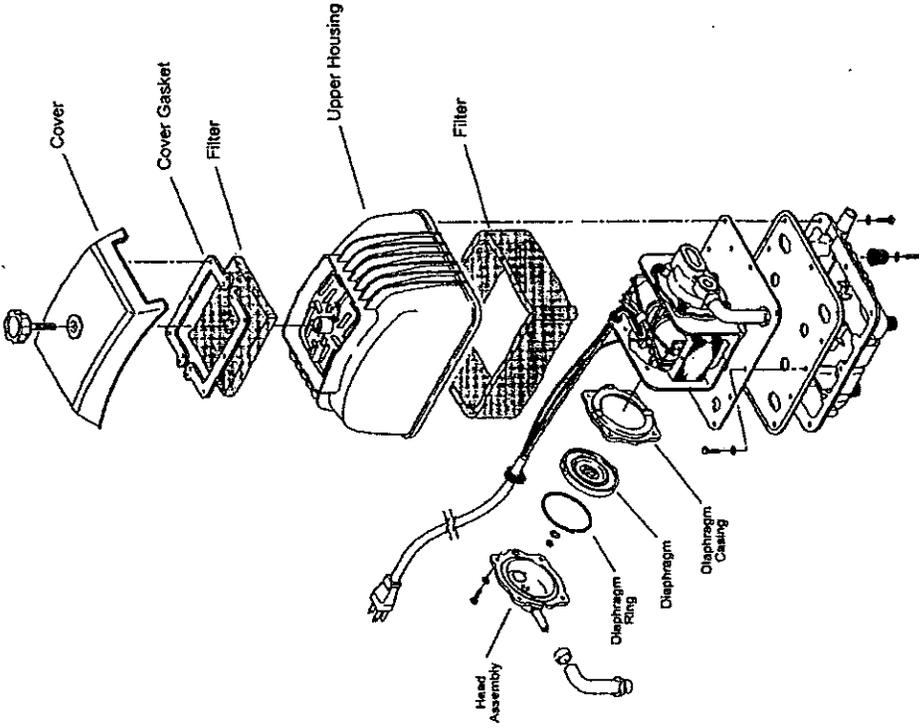

DESCRIPTION	80GJL	150GJH, 200GJH	HP100
FILTER PAD	K701	K702	K631
HEAD ASSEMBLY	K621	K711	K652
DIAPHRAGM ASSEMBLY	K620	K710	K653
SAFETY SWITCH BAR/SCREW	NA	K703	K654

EXPLODED PRODUCT VIEW, PARTS & ORDERING INFORMATION

REF	DESCRIPTION	QTY	RV03-101	RV05-101
1	BODY	1	AK504	AK500
2*	VANE	4	AH850A	AH850A
3	SHROUD	1	AK502B	AK502B
4	END PLATE	1	AK501	AK501
5*	GASKET	1	AK521	AK521
6	MUFFLER BOX	1	AK519	AK519
7*	O-RING	2	AK473	AK473
8*	FELT	2	AK524	AK524
9	END CAP	2	AK510	AK510
10	END CAP FILTER ASSEMBLY	2	AK526	AK526
11	FILTER / MUFFLER	1	B343B	B343B
12	FOOT SUPPORT KIT	1	AC136	AC136
13	FELT SUPPORT	1	B347	B347
14*	FELT FILTER	2	B344A	B344A
15	SCREEN CAP	1	AJ571	AJ571
16	ROTOR	1	AH775B	AH775B
17	TOLERANCE RING	1	AF105	AF105
	SERVICE KIT	1	K882	K882

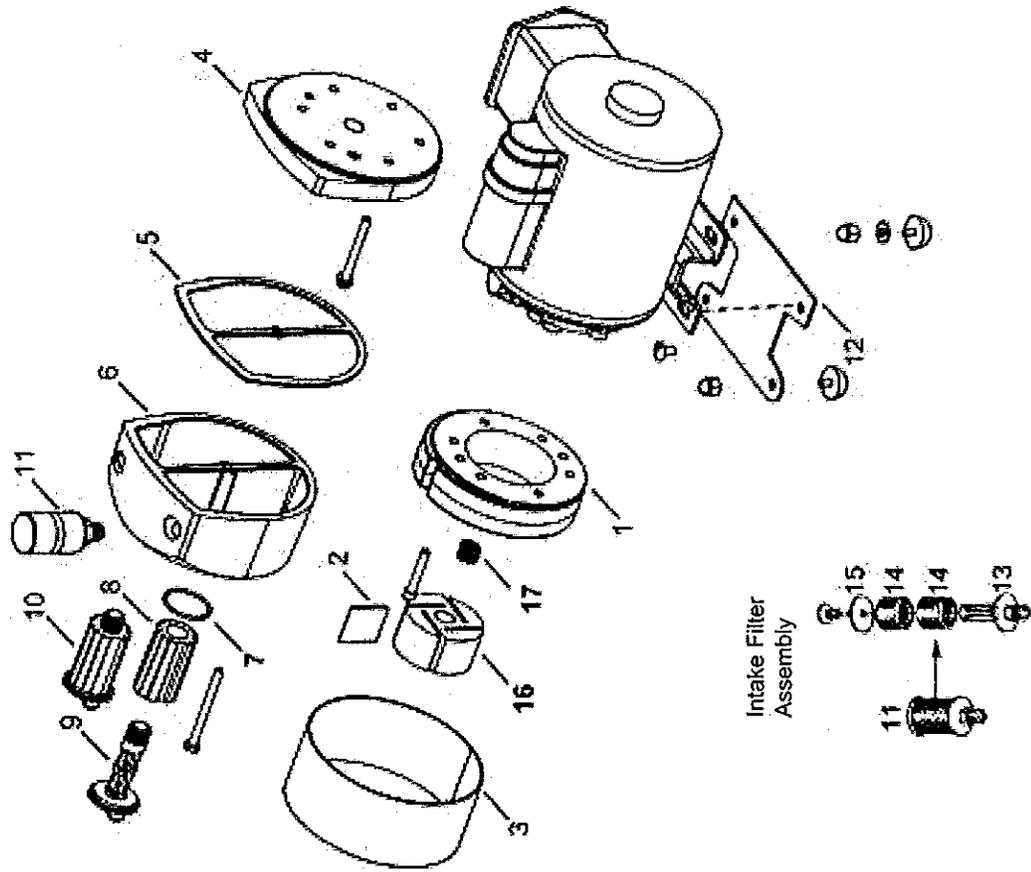

* Denotes parts included in the Service Kit. Parts listed are for stock models.
 ** No Service Kit available, order parts separately. For specific OEM models, please consult the factory. When corresponding or ordering parts, please give complete model and serial numbers.


EXPLODED PRODUCT VIEW, PARTS & ORDERING INFORMATION

REF	DESCRIPTION	QTY	0823-101	1023-101Q	1023-101	1023-101Q	1023-V103	1423-101	1423-101Q
1	BODY	1	AK517	AK518	AK518	AK518	AK518	AL283	AL283
2*	VANE	4	AK513	AK513	AK513	AK513	AK513	AL284	AL284
3	SHROUD	1	AK511	AK511	AK511	AK511	AK511	AL281	AL281
4	END PLATE	1	AK515A	AK514	AK515A	AK514	AK515A	AK515A	AK514
5*	GASKET	1		AK522		AK522		AK522	
6	MUFFLER BOX	1		AK520		AK520		AK520	
7*	O-RING	2		AK473		AK473		AK473	
8*	FELT	2		AK524		AK524		AK524	
9	END CAP	2		AK510		AK510		AK610	
10	END CAP ASSEMBLY	2		AK526		AK526		AK526	
11	FILTER / MUFFLER	1		AK840		AK840		AD432	AC432
12	ELBOW	1						BA206	BA206
12	ELBOW ***	2					AF272		
13	MUFFLER ASSEMBLY	1					AB599B		
13a	NIPPLE	2						BA714	BA714
14	JAR	2					AA805		
15	COVER GASKET	2					AA405		
16	COVER ASSEMBLY	1					AV805BPC		
17	MUFFLER ASSEMBLY	1					AC434-1		
18	COUPLING	2					AC391		
19	CARTRIDGE	2					AC393		
20	END CAP ASSEMBLY	2					AC394		
21	MUFFLER PLATE	1					AC395		
22	STUD	2					AC396		
23	FILTER ASSEMBLY	1					AB599		
24	COVER ASSEMBLY	1					AV805APC		
25	FILTER ASSEMBLY	1					AC433-1		
	SERVICE KIT	1	K479A	K479	K479A	K479	**	K575A	K575A

* Denotes parts included in the Service Kit. Parts listed are for stock models.

** No Service Kit available, order parts separately. *** Not shown.


For specific OEM models, please consult the factory. When corresponding or ordering parts, please give complete model and serial numbers.

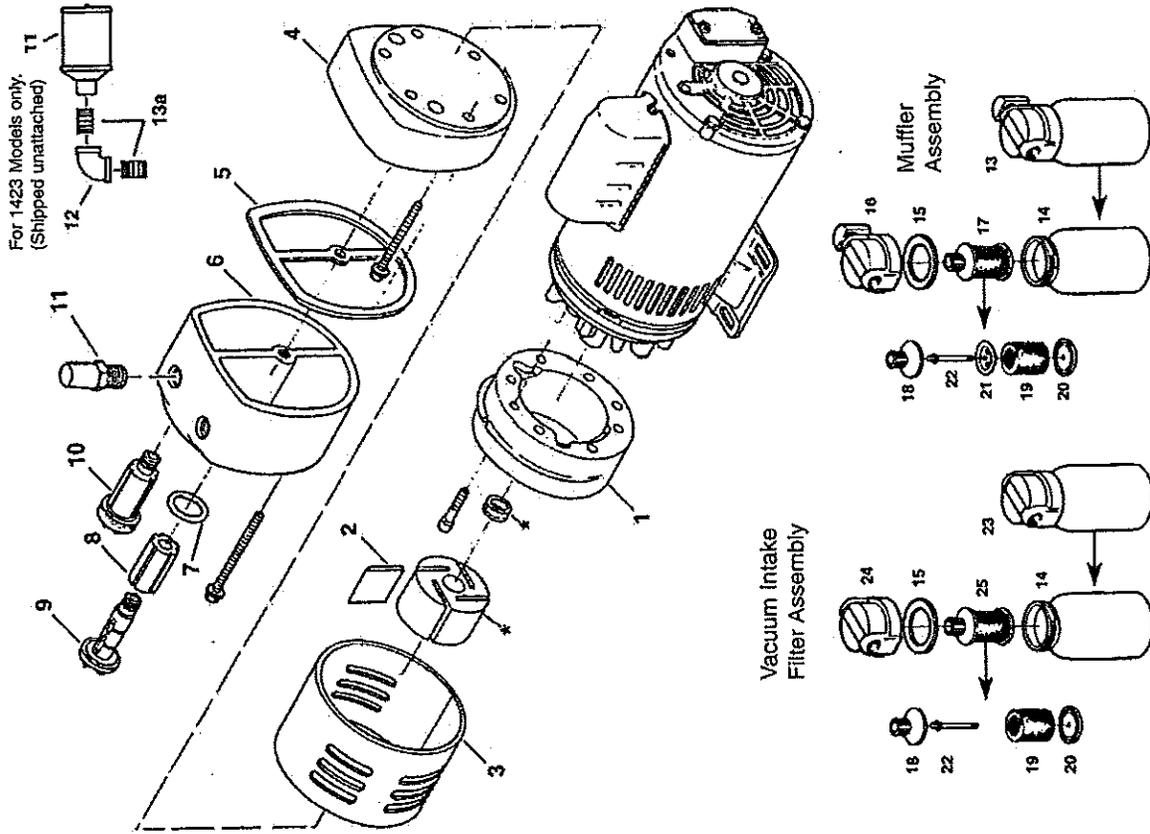

Aqua Aire

Ecological Tanks, Inc.
Downsville, LA 71234

OWNER'S MANUAL
**4" Submersible
High-Pressure Effluent Pump**

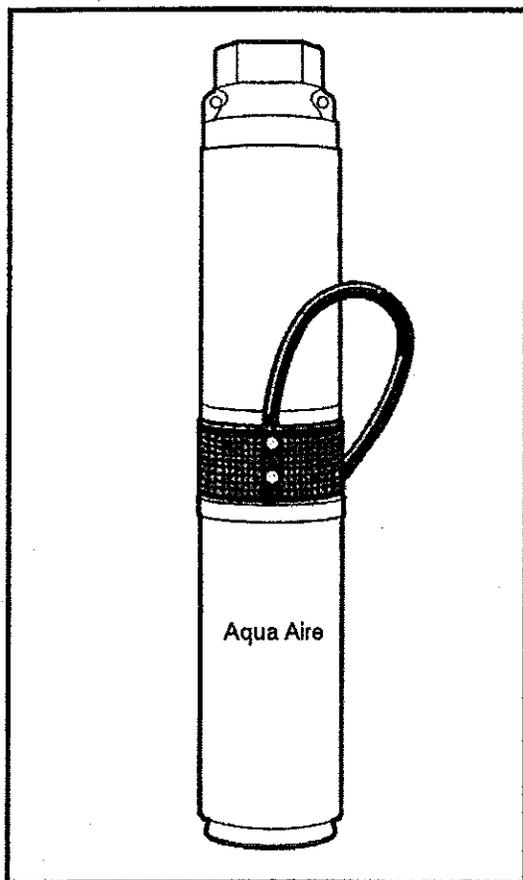

Installation/Operation/Parts

For further operating, installation, or maintenance assistance:

Call 1-318-644-0397

TABLE OF CONTENTS

Safety Instructions.....	2
General.....	2
Electrical.....	2-3
Operation.....	3
Troubleshooting Guide.....	4
Warranty.....	4

Carefully read and follow all safety instructions in this manual or on pump.

⚠ This is the safety alert symbol. When you see this symbol on your pump or in this manual, look for one of the following signal words and be alert to the potential for personal injury!

⚠ DANGER DANGER warns about hazards that will cause serious personal injury, death or major property damage if ignored.

⚠ WARNING WARNING warns about hazards that can cause serious personal injury, death or major property damage if ignored.

⚠ CAUTION CAUTION warns about hazards that will or can cause minor personal injury or property damage if ignored.

The word **NOTICE** indicates special instructions which are important but not related to hazards.

To avoid serious or fatal personal injury and possible property damage, carefully read and follow the safety instructions.

- ⚠ WARNING** Hazardous pressure. Under certain conditions, submersible pumps can develop extremely high pressure. Install a pressure relief valve capable of passing entire pump flow at 75 PSI.

⚠ Do not allow pump, piping, or any other system component containing water to freeze. Freezing may damage system, leading to injury or flooding. Allowing pump or system components to freeze will void warranty.

- ⚠ WARNING** Hazardous voltage. Can shock, burn or cause death. To avoid dangerous or fatal electric shock hazard, use pump only in an effluent system. DO NOT install pump in an open body of water (a lake, swimming pool, etc.).

⚠ Install, ground and wire pump according to local and Canadian Electrical Code or National Electrical Code requirements that apply.

⚠ Disconnect electrical power supply before installing or servicing pump.

⚠ Make sure motor nameplate voltage and frequency match line voltage and frequency of power supply.

- Install pump according to all plumbing, pump and well code requirements.
- Install an all leg disconnect switch in the power supply near the pump.
- Two-wire motors are equipped with automatic thermal overload protection which will open the circuit and stop the motor when a thermal overload (excessive heating) exists. When motor cools, overload will reset and motor will restart automatically. *This can cause the motor to start unexpectedly and without warning.*

GENERAL

Inspect pump and motor for delivery damage. Report any damage immediately to shipping carrier or to AquaAire immediately.

Have any installation, repair, or service work done by your AquaAire dealer.

Never run pump dry.

During system operation, pump must be submerged at all times.

Pipe joint compound can cause cracking in plastics. Use only teflon tape when sealing joints in plastic pipe.

Warranty is void in the following conditions:

- Water is highly corrosive.

- If entrained gas or air present in water being pumped reduce the flow and cause cavitation (which can damage the pump).

- Pump has been operated with discharge valve closed (severe internal damage will result).

ELECTRICAL

WIRING/GROUNDING

⚠ WARNING Hazardous voltage. Can shock, burn, or cause death. Permanently ground pump, motor and control box before connecting power supply to motor.

Ground pump and motor in accordance with all codes and ordinances that apply. All wiring must meet National Electrical Code and Canadian Electrical Code (whichever applies). Use copper ground wire at least as large as wires carrying current to motor.

Motor is supplied with copper ground wire. Splice to copper conductor that matches motor wire size specified in Table 2. Use only copper wire for connections to pump.

Permanently ground pump and motor before connecting power cable to power supply. Connect ground wire to approved ground first, then connect to equipment being installed.

Do not ground to a gas supply line.

Float switches or any other approved motor control must match motor input in full load amperes.

For more information, contact your local code officials.

INSTALLATION WIRING INSTRUCTIONS-

Single Phase, 2 Wire

2-Wire pumps have two power supply wires (Red/Black) and one ground wire (Green).

1. Fasten power supply wire leads securely to pump discharge section; leave 4-5" of slack in leads at this point. Securely fasten leads to plastic pipe within 6" of the pump discharge section.

2. Ground wire must be as large as wires supplying current to motor. Consult current National Electrical Code or Canadian Electrical Code (as applicable) and local codes for grounding information.

3. Use only submersible power supply wires supplied by pump manufacturer. When installing pump, secure supply wires to discharge pipe with Scotch #33 electrical tape. DO NOT damage pump wires.

NOTICE: To avoid dropping pump or damaging wires or splices, NEVER allow pump wires to support weight of pump.

EFFLUENT APPLICATIONS

Effluent applications must meet the following:

⚠ WARNING Risk of electrical shock. Do not remove cord and strain relief. Do not connect conduit to pump.

1. Only qualified personnel should install the pump and associated control equipment.
2. Vent sewage tank according to local code.
3. Do not install pump in any location classified as hazardous by National Electrical Code, ANSI/NFPA 70-1984.
4. These pumps are intended for permanent connection only. Provide strain relief at control box for power supply cord connection to box. All control components must be UL listed and suitable for end use application.

PUMP INSTALLATION

1. Make sure that pump and motor are free to rotate by turning the shaft by hand.

2. To prevent dropping pump, lower it by the drop pipe, not by the cables. The electrical cables will not hold the pump weight.

3. Discharge outlet is 1-1/4" NPT threaded.

NOTICE: Pump discharge is left-hand thread into pump shell. If installing external check valve, hold discharge with pipe wrench to prevent loosening discharge in shell.

4. If pump is to be operated with an open discharge, a discharge valve *must be installed.* Before startup, open this valve about 1/3

pump. Slowly open valve until the desired flow rate is reached. Final setting must be within pump's recommended operating range.

2. Make sure that the float switches are set so that the pump stops before the pump runs dry or breaks suction. If necessary, adjust float switches to achieve this.

OPERATION

1. The pump must be submerged at all times during normal operation. Do not run pump dry.

3. The motor bearings are lubricated internally. No maintenance is required or possible on the pump or the motor.

Table 1: Recommended Fusing Data
60 Hz/1 Phase 2-Wire Cable

HP	Voltz/Hz/ Phase	Motor Winding Resistance Ohms	Max Load Amps	Locked Rotor Amps	Fuse Size Standard? Dual Element
1/2	115/60/1	1.0-1.3	12.0	64.8	30/15

Table 2: Power Supply Wire (Cable) Length in Feet
1 Phase, 2 Wire Cable, 60Hz (Copper Wire Size - Service to motor)

Volts	HP	14 AWG	12 AWG	10 AWG	8AWG	6 AWG	4 AWG	3 AWG	2 AWG	1 AWG	0 AWG
115	1/2	100	160	250	390	620	960	1190	1460	1780	2160

1. Maximum wire lengths shown maintain motor voltage at 95% of service entrance voltage, running at maximum nameplate amperes. If service entrance voltage will be at least motor nameplate voltage under normal load conditions, 50%

additional length is permissible for all sizes.

2. Sizes given are for copper wire. For aluminum wire go two sizes larger (i.e. if table lists #12 copper wire, use #10 aluminum wire.)

Motor Insulation Resistance Readings

Normal Ohm/Megohm readings for all motors, between all leads and ground. Set ohmmeter to 100K scale.

Condition of Motor and Leads	Ohm Value	Megohm Value
New motor, without power cable	20,000,000 (or more)	20.0
Used motor, which can be reinstalled in tank	10,000,000 (or more)	10.0
Motor in tank - Readings are Power Cable plus Motor		
<i>Do not pull pump for these reasons:</i>		
New Motor	2,000,000 (or more)	2.0
Motor in reasonably good condition	500,000 to 2,000,000	0.5-2.0
Motor which may be damaged or have damaged power cable	20,000 to 500,000	0.02-0.5
<i>Pull pump; replace pump or cable:</i>		
Motor definitely damaged or with damaged power cable	10,000 to 20,000	0.01-0.02
Failed motor or power cable	Less than 10,000	0-0.01

Important Electrical Grounding Information

⚠ WARNING Hazardous voltage. Can shock, burn, or kill. To reduce the risk of electrical shock during pump operation, ground and bond the pump and motor as follows:

A. To reduce risk of electrical shock from metal parts of the assembly other than the pump, bond together all metal parts accessible at the tank top (including metal discharge pipe, metal tank top, and the like). Use a metal bonding conductor at least as large as the power cable conductors running down the well to the pump's motor.

B. Clamp or weld (or both if necessary) this bonding conductor to the grounding means provided with the pump, which will be the equipment-

grounding terminal, the grounding conductor on the pump housing, or an equipment-grounding lead. The equipment-grounding lead, when provided, will be the conductor have green insulation; it may also have one or more yellow stripes.

C. Ground the pump, motor, and any metallic conduit that carries power cable conductors. Ground these back to the service by connecting a copper conductor from the pump, motor, and conduit to the grounding screw provided within the supply-connection box wiring compartment. This conductor must be at least as large as the circuit conductors supplying the pump.

Save these instructions.

INITIAL SERVICE POLICY

The local dealer/installer from whom you purchased your Aqua Aire wastewater treatment plant is responsible for routine inspections for the first two years from the original date of installation. The plant will be checked for proper operation at each inspection. If a problem exist, service will be performed at no charge to the owner

unless the required maintenance is not warranty related. These service call/inspections shall include at least four inspections over the two year period and shall include the following:

1. Adjustment of the electrical control, if applicable, and servicing of the mechanical component parts to ensure proper function.
2. An effluent quality inspection consisting of a visual check for color, turbidity, scum overflow, and an examination for odors.
3. Immediate notification to the owner/warrantee in writing of any improper observation which cannot readily be repaired. This notification will or shall advise said owner of the problem, if it is covered by warranty and estimated date for correction of said problem.

Pumping of sludge build up from the treatment plant, if necessary, **IS NOT INCLUDED** in the initial service policy.

An annually renewable service policy affording the same coverage as the initial service policy is available. Consult your local dealer for pricing information.

LIMITED WARRANTY

Ecological Tanks, Inc., Aqua Aire (hereinafter identified as manufacturer) warrants each aerobic wastewater treatment plant to be free from defects in workmanship and materials from the date of installation by an authorized dealer/installer for the following periods: Manufacturer warrants system aerator for a limited prorated 5 year period thus: First two years - 100%, 2nd to 3rd year - 75%, 3rd to 4th year - 50% and 4th to 5 year period - 25% of manufacturer's list price. Third, fourth and fifth year limited prorated portion of this warranty applies only if system owner carries a continuous maintenance policy in full effect and proof is provided with return. Aerators for the AA1000, AA1200 and AA1500 only are warranted for 2 years. Electrical controls, float switches and application pumps 2 years. When properly installed and **registered** with the manufacturer, the manufacturer's sole obligation under this **limited warranty** is as follows:

To repair or exchange any components, F.O.B. factory, that in the manufacturer's judgment is defective, provided that said component part has been paid for and is returned through an authorized dealer, prepaid. The warrantee must specify the nature of the defect in writing to the manufacturer. The **limited warranty** makes no provision for any informal dispute settlement agreement.

The **limited warranty** does not cover any aerobic wastewater treatment plant that has not been properly installed, damaged due to altered or improper wiring or overload protection, flooded by any external means, disassembled by any unauthorized person, filled with anything other than normal household wastewater or damaged by an act of nature. The limited warranty does not cover damages or defects caused by ants, insects or rodents to any component part of the aerobic wastewater treatment plant.

No warranty is made as to the field performance of any system. The **limited warranty** applies only to the aerobic wastewater treatment plant itself and does not include any of the purchaser's plumbing, drainage and/or disposal system, house wiring or installation of the plants.

The manufacturer reserves the right to replace any component part covered under this **limited warranty** with a component part, which in manufacturer's judgment, is equivalent to the part replaced. The manufacturer claims no responsibility for any delays or damages caused by defective components or materials which cause losses incurred by interruption of service or for repairs or replacements of component parts covered by the **limited warranty**.

MANUFACTURER'S WARRANTY REGISTRATION CERTIFICATE

It is the authorized dealer/installer's responsibility to fill out the registration certificate and mail it within 30 days of installation to the address below. The owner/purchaser should verify that this is done to insure proper registration for warranty purposes.

**ECOLOGICAL TANKS, INC.
2247 HIGHWAY 151 NORTH, DOWNSVILLE, LA 71234
OFFICE: 318-644-0397 FAX: 318-644-7257**

**PLEASE PRINT
AQUA AIRE PURCHASER'S RECORD**


Serial# _____ Model# _____ Installation Date _____
Installer's Name _____
Mailing Address _____
_____ Phone _____


AQUA AIRE INSTALLER'S RECORD


Serial# _____ Model# _____ Installation Date _____
Owner's Name _____
Physical Address/City _____
_____ Phone _____

**AQUA AIRE REGISTRATION CERTIFICATE
(Must be returned to manufacturer)**

Serial# _____ Model# _____ Installation Date _____
Owner's Name _____
Physical Address/City _____
_____ Phone _____
Dealer's Name _____
Mailing Address _____
_____ Phone _____
Installer's Name _____
Mailing Address _____
_____ Phone _____







Aqua Aire® R1PS Compressor/High Water Alarm

OPERATING INSTRUCTIONS

The Aqua Aire® R1PS alarm was designed to give an audio/visual alarm when the air pressure falls below or rises above the normal operating pressure. The alarm will be activated if the compressor fails to maintain the minimum operating pressure or during a high water condition that causes a significant rise above the normal operating pressure. The alarm will remain on until a normal operating pressure is restored, the battery is disconnected, or the life of the battery has been exceeded. The expected life of a fresh alkaline battery during a continuous alarm condition is approximately 48 hours. The R1PS control is for gravity flow applications.


INSTALLING THE ALARM

1. Remove cover from back of the alarm (4 screws).
2. Remove 9-volt battery from inside the alarm.
3. Route air line tubing from bulkhead connector at compressor to the bulkhead connector at the alarm.
4. Slide air line over bulkhead connectors.
5. Plug in air compressor.
6. Remove protective cover from 9-volt battery terminals. Attach battery strap and install battery between side of enclosure and clear plastic airline. (See Figure A for battery placement). The alarm will not sound if a normal operating pressure has been reached.

CAUTION: Do not place battery on or near horn, wires or terminals.

7. Unplug air compressor. Alarm should be activated.
8. Plug in air compressor. Alarm should be silenced.
9. Simulate a high pressure condition by blocking the airflow from the compressor manifold to the treatment plant. Alarm should be activated.
10. If alarm functions properly as described above, install the back cover and mount alarm with bulkhead fitting pointing down.

FIGURE A

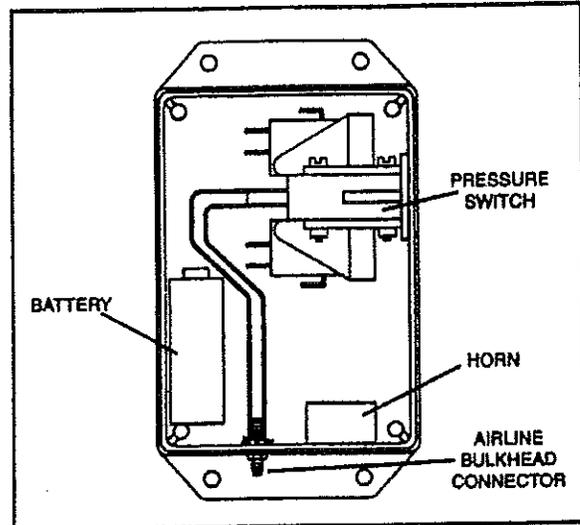

MAINTENANCE

NOTE: The battery should be replaced every 6 months during scheduled maintenance routines or after an alarm condition has occurred. Failure to do so could result in an inoperable alarm.

The alarm can be tested for proper low-pressure operation by unplugging the air compressor or removing the air line from the bulkhead fitting. The alarm can be tested for proper high-pressure operation by blocking the airflow from the compressor manifold to the treatment plant.

LOCAL SERVICE REPRESENTATIVE

Name:

Address:

Phone:

Aerobic Control Aqua Aire®

Installation Instructions and Operation/Troubleshooting Manual



Control panels must be installed and serviced by a licensed electrician in accordance with the National Electric Code NFPA-70, state and local electrical codes.

All conduit running from the tank to the control panel must be sealed with conduit sealant to prevent moisture or gases from entering the panel.

Installation

The aerobic treatment system panel is designed to operate an air compressor and effluent pump, in addition to providing air compressor fail and high water level alarm functions.

NOTE: Options ordered may affect the number of floats and their functions. Please reference the schematic provided with the control panel for proper installation.

Installation of Floats

CAUTION: If float switch cables are not wired and mounted in the correct order, the pump system will not function properly.

WARNING: Turn off all power before installing floats in pump chamber. Failure to do so could result in serious or fatal electrical shock.

1. Label floats for specific operation (high water alarm, pump on/off and timer override). See schematic for float options.
2. Determine your normal operating level as illustrated in Figure 1.
3. Mount float switches at appropriate levels via stationary device as illustrated in Figure 2 & 3. Be sure that floats have free range of motion without touching each other or other equipment in the basin.

Aqua Aire®

Mounting the Control Panel

1. Determine mounting location for panel. If distance exceeds the length of either the float switch cables or the pump power cables, splicing will be required. For outdoor or wet installation, we recommend the use of a liquid-tight junction box with liquid-tight connectors to make required connections.

Installation Instructions

2. Mount control panel.
3. Route 1/8" airline tubing from "T" at compressor manifold to control panel.
4. Slide 1/8" airline tubing over bulkhead connector on bottom of control panel.
5. Determine conduit entrance locations on control panel.

NOTE: Be sure the power supply voltage and phase are the same as the motors being installed. If in doubt, see the identification plates for voltage/phase requirements.

6. Knock out proper size holes for type of connectors being used.

NOTE: If using conduit, be sure that it is of adequate size to pull the pump and switch cables through.


7. Attach cable connectors and/or conduit connectors to control panel.

**FOR INSTALLATION REQUIRING A SPLICE,
FOLLOW STEPS 8-11;
FOR INSTALLATION WITHOUT A SPLICE,
GO TO STEP 12.**


8. Determine location for mounting junction box according to state and local code requirements. Mount junction box to proper support. Do not mount the junction box inside the tank.
9. Run conduit to junction box. Drill proper size holes for the type of conduit used. Attach connectors to junction box.
10. Identify and label each wire before pulling through conduit into control panel and junction box. Make wire splice connections at junction box.
11. Firmly tighten all fittings on junction box.
12. If a junction box is not required, identify and label pump cable before pulling through conduit into control panel.
13. Connect pump and switch wires to terminals as seen on wiring diagram.
14. Connect "power-in" conductors to proper locations: 120 volt AC power (Hot (L1) and Neutral (N)) to terminals as seen on wiring diagram provided with control panel.

**VERIFY CORRECT OPERATION OF CONTROL PANEL
AFTER INSTALLATION IS COMPLETE.**


NOTE: The compressor fail alarm will sound until the system has reached normal operating pressure.

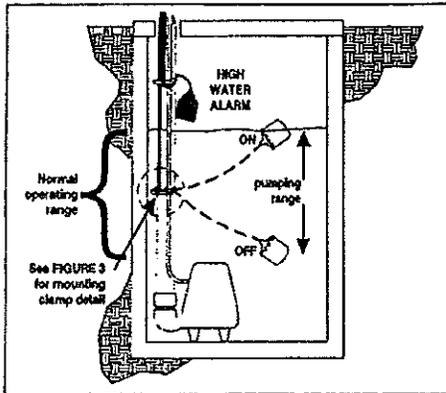

**FIGURE 1 -SJE wide angle* float system
*Junior Super Single®
(See chart below to determine
pumping range)**

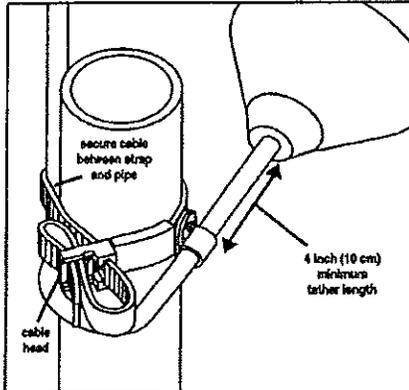

**FIGURE 2 -Pipe clamp mounting detail
for high water alarm float**

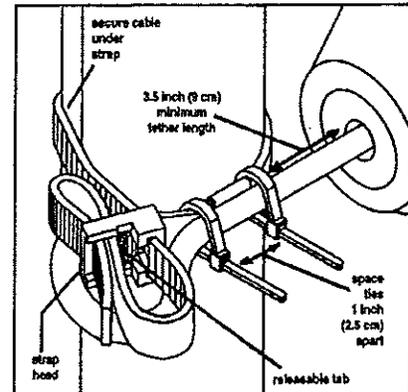

**FIGURE 3 -Pipe clamp mounting detail
for pump on/off float.**

Determining Pumping Range in Inches (1 inch = 2.5 cm)

Use only as a guide. Pumping ranges are based on testing in non-turbulent conditions. Range may vary due to water temperature and cord shape.
Note: As the tether length increases, so does the variance of the pumping range.

**Junior Super Single®
pumping range**

tether length	6	10	15	17
pumping range	8.5	13	17	

Installation Instructions

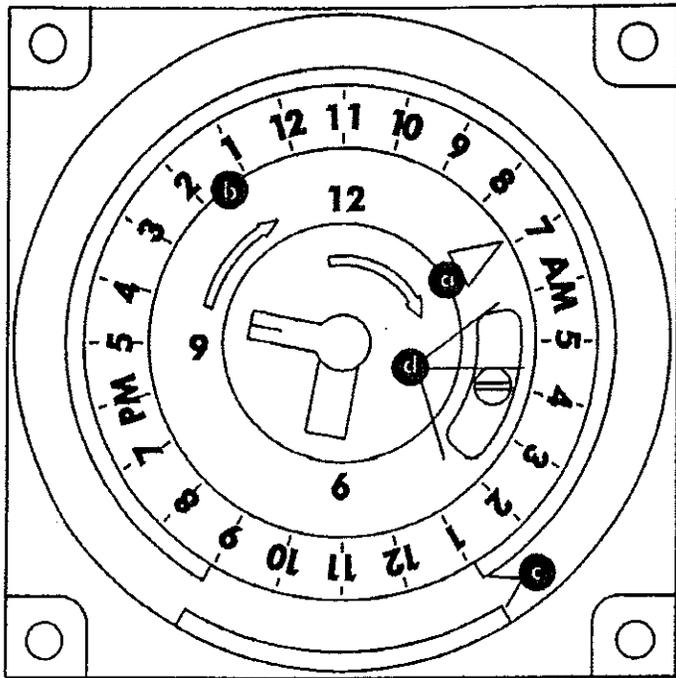


FIGURE 3 - Timer detail

Setting the timer (optional)

The timer is a 24 hour time clock with 15 minute increment settings. The captive trippers change the SPDT relay state when pushed toward the outside.

1. Setting time of day

(a) Synchronize the timer by aligning arrow at the 2:00 position of inner face with the corresponding time of day printed on the outer ring. NOTE: Power must be ON to keep time synchronization.

2. Setting ON time and duration

Locate desired activation time(s) on outer ring (b) and push trippers to the outside (c). Each tripper represents 15 minutes activation time. Push as many trippers back as desired for duration time. When the timer reaches the first tripper, the timer SPDT contacts will change state and turn ON. It will remain ON for as long as the following trippers are pushed out. When timer goes past last tripper, the timer will return to the OFF mode. The timer has a selector for (d) OFF(O), AUTOMATIC (blank), and MANUAL OVERRIDE (I) modes.

Operations

The Aqua Aire aerobic control was designed to operate a single-phase air compressor and effluent pump. The control incorporates an audio/visual alarm for high water conditions and air compressor fail. A test/normal/silence switch, which is located on the side of the enclosure, allows the user to test the alarm horn and light, or silence the horn while keeping visual indication. The alarm indication will remain active until the condition is cleared. The high water alarm is activated via a normally open float switch. The air compressor fail alarm is activated either by a circuit breaker trip or a low air pressure condition.

NOTE: If the horn is silenced in an alarm condition, the switch must be returned to the "normal" or center position once the problem has been cleared.

The alarm circuit, compressor circuit, and effluent pump circuit each contain a thermal-magnetic circuit breaker for branch circuit protection and disconnect.

Certain models of the aerobic control utilize a 24-hour timer to control the effluent pump. The effluent pump is controlled by a pump switch for dosing sizes and a timer for selecting periods of the day to allow dosing or spraying. A timer override float may be included as an option to allow dosing/spraying in high demand situations.