





Connecticut Department of Energy and Environmental Protection



Connecticut Department of
**ENERGY &
ENVIRONMENTAL
PROTECTION**

State Presentation - Connecticut

October 19, 2016

Karl Baker

2016 Pipeline Safety Seminar

Portland, ME



Connecticut Department of Energy and Environmental Protection

Personnel

- Program Manager – Karl Baker – 23 years
- Engineer 3 – Bruce Benson – 19 years
- Engineer 3 – Daniel Nivison – 18 years
- Engineer 2 – John DePaolo – 6 years
- Engineer 1 – Daniel Tomasino – 3 years
- Engineer 1 – Kevin Dowling – 2 years



Cast Iron & Unprotected Steel

Start of Year	Cast Iron Main	Unprotected Bare or Coated Steel Main	Unprotected Bare or Coated Steel Services
	Miles	Miles	Quantity
2011	1509	250	77404
2012	1467	236	73160
2013	1426	221	69731
2014	1381	218	60929
2015	1349	205	58683
Mains – 20% leak prone		Services – 15% leak prone	



Accelerated Infrastructure Replacement

- Yankee Gas – last rate case – 20 year program
- CNG – last rate case – 20 year program – tracker mechanism
- SCG – merger agreement – 61 years down to 31 year
- Norwich – municipal – ≈ 14 years to go



Civil Penalties

Year	Number Assessed	Dollars Assessed	Number Collected	Dollars Collected
2011	0	\$0	0	\$0
2012	3	\$105,000	2	\$75,000
2013	10	\$292,000	11	\$309,479
2014	3	\$31,500	2	\$19,021
2015	16	\$447,250	16	\$462,250
2016 to date	6	\$102,000	7	\$112,000



Recent Civil Penalties

- \$10,000 – inadequate electrofusion scraping



Recent Civil Penalties

- \$10,000 – not OQ'ed for taping
- \$50,000 – not qualified or OQ'ed for joining



Recent Civil Penalties

– \$25,000 – trenchless excavation violation



Connecticut Department of Energy and Environmental Protection

Recent Civil Penalties

- \$10,000 – failure to pressure test entire service



Recent Civil Penalties

– \$75,000 – overpressurization



Connecticut Department of Energy and Environmental Protection

Recent Civil Penalties

- \$60,000 – bad plastic fusions/broken joining machine





Recent Civil Penalties

- \$10,000 – service installed without 12" clearance



Recent Civil Penalties

– \$10,000 – improper riser installations

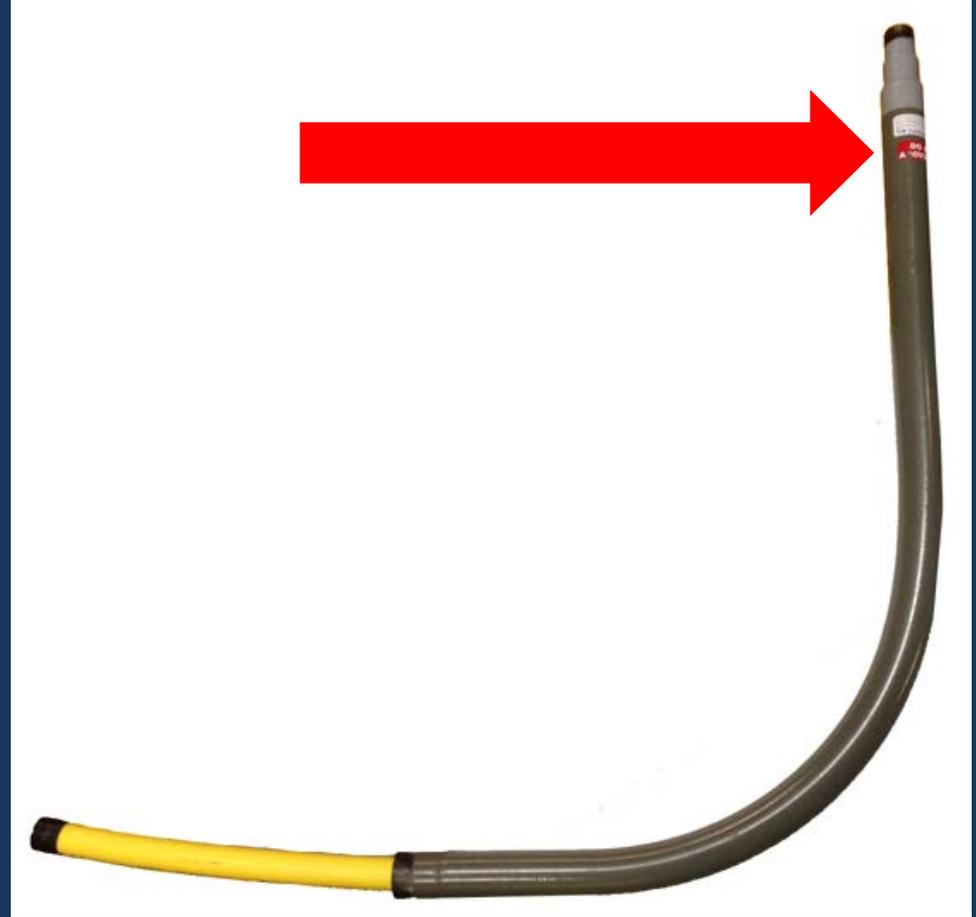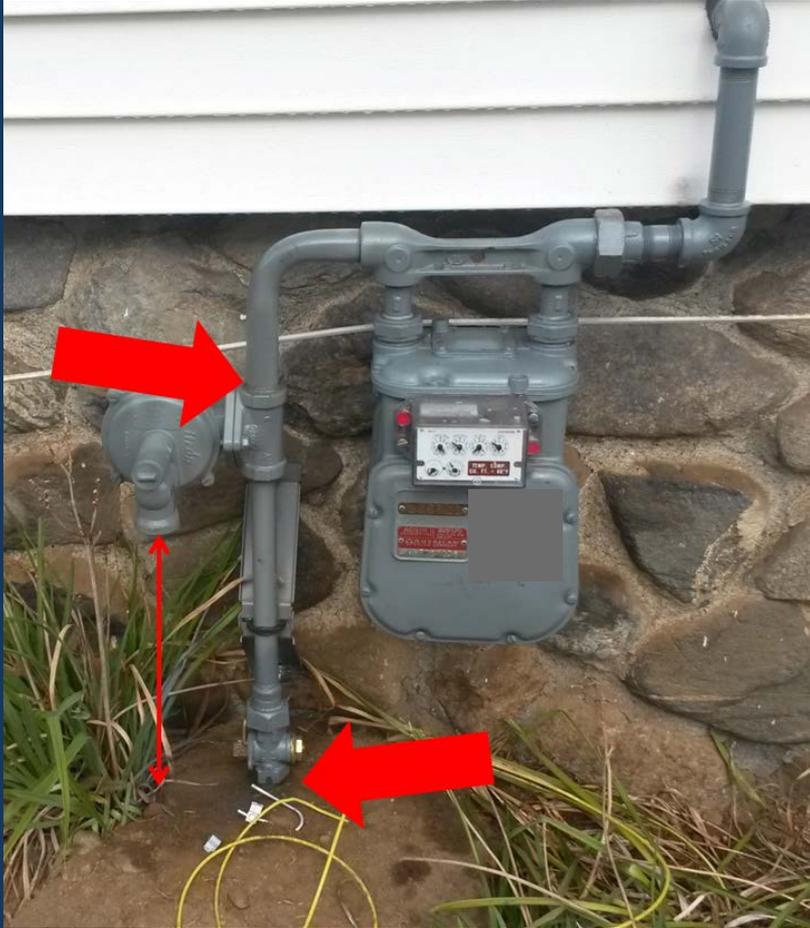

Recent Civil Penalties


– \$10,000 – no split sleeve



Connecticut Department of Energy and Environmental Protection


Recent Civil Penalties

- \$10,000 – tracer wire touching plastic pipe

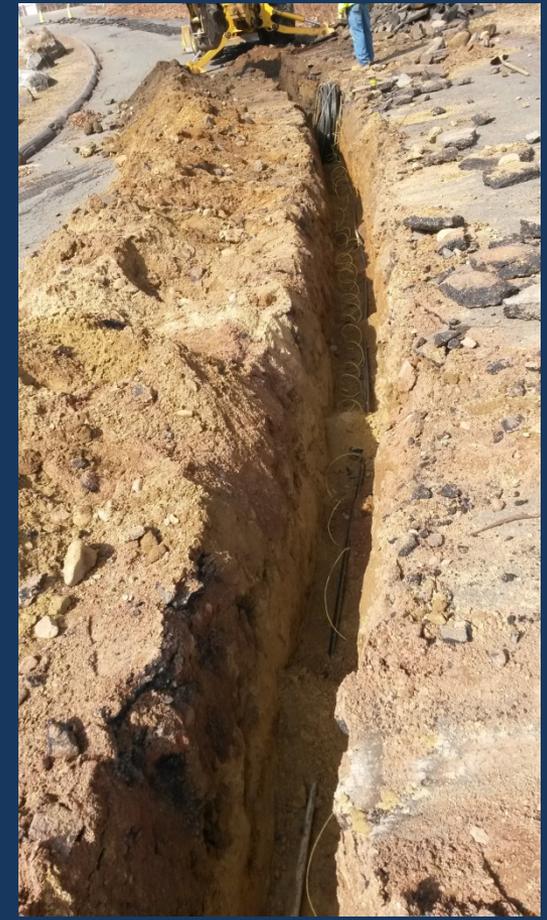

Recent Civil Penalties

- \$15,000 – failure to pressure test entire service

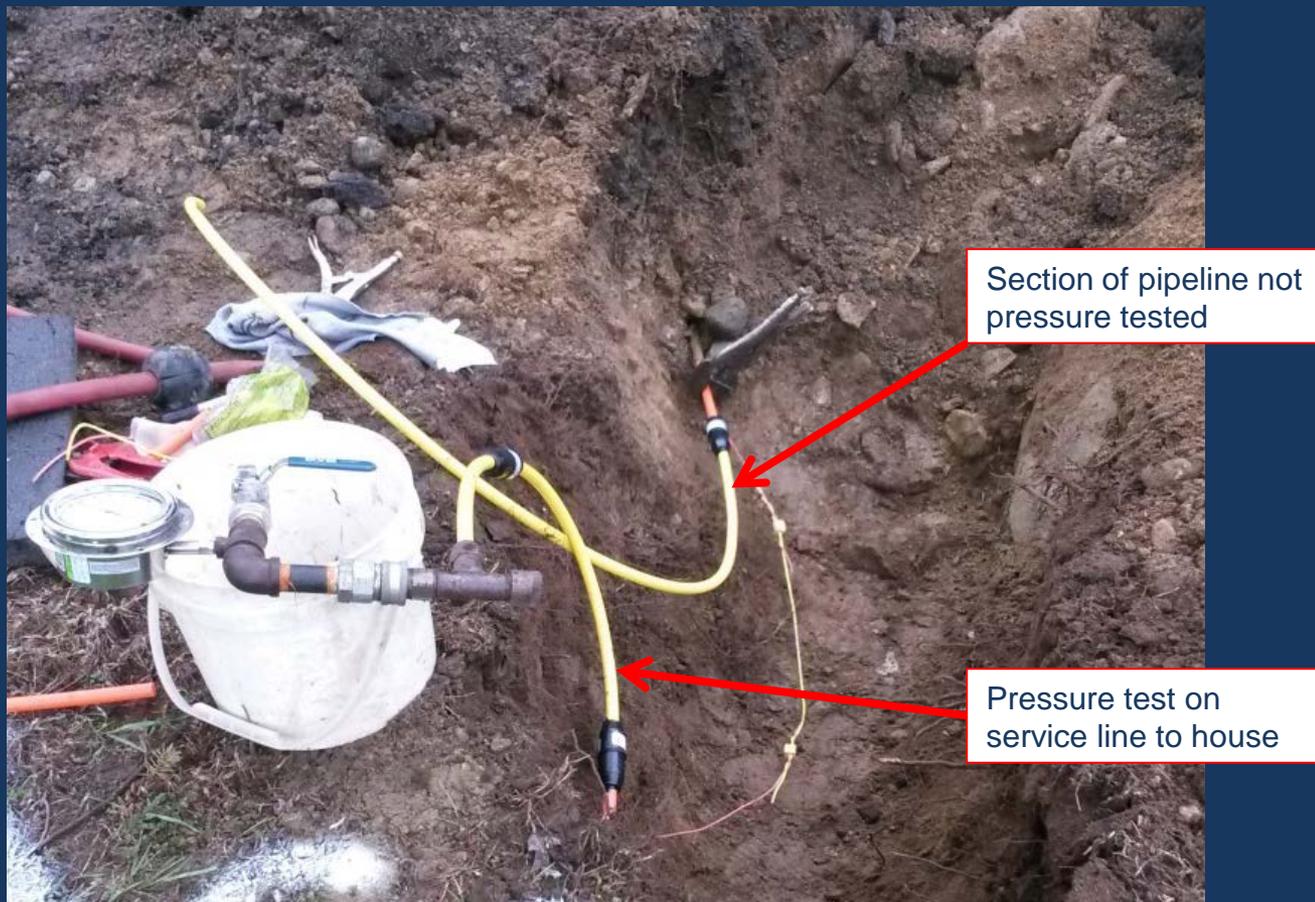

Recent Civil Penalties

– \$7,000 – propane field installation violations



Connecticut Department of Energy and Environmental Protection

Recent Civil Penalties

- \$50,000 – inadequate emergency response



Recent Civil Penalties

- \$26,200 – Interstate – unqualified welders



Recent Civil Penalties

- \$11,500 – Interstate - didn't assess pipe as required by IMP – under appeal



Field Observations

– Use of calibrated equipment

- Gauges
- CGIs
- Half-cells, multimeters
- Odorometer/Odorator
- Torque wrenches



One-Call

Year	Total Locate Requests	Total Damages per 1,000 Locates	Total Gas Damages per 1,000 Locates	Total Gas Damages due to Utility Error per 1,000 Locates	Total Fines Collected
2011	168,467	2.84	1.3	0.3	\$160,500
2012	173,000	3.03	1.6	0.6	\$156,000
2013	182,177	3.11	1.6	0.4	\$117,000
2014	189,366	2.86	1.5	0.4	\$110,350
2015	201,945	2.92	1.4	0.4	\$134,100



Damage Prevention

- One-Call Law Changes
 - New regulations effective 8/2/2016
 - Highlights:
 - Areas of continual excavation
 - Soft digging
 - Trenchless excavation expanded requirements
 - Mandatory call to 911
 - Civil penalty for tampering - \$40,000
 - New markout standards



Propane

- Jurisdictional propane operators – 26
- Jurisdictional systems - ≈ 350
- We have inspected every known operator
 - Please let us know if someone is out there that we do not know about
- We are not going to be your code compliance department!



Incidents

NONE!



Questions?

Karl Baker

Public Utilities Supervisor of Technical Analysis

karl.baker@ct.gov

860-827-2661



Connecticut Department of Energy and Environmental Protection