

# Notice of Agency Rule-making Proposal

**AGENCY:** Department of Professional and Financial Regulation, Office of Licensing and Registration, Manufactured Housing Board

**RULE TITLE OR SUBJECT:**

Chapter 820, Definitions (Manufactured Housing Communities) (amendment)  
Chapter 890, Manufactured Home Installation Standards (new rule)  
Chapter 900, Used Standard – Installation (amendment)

**PROPOSED RULE NUMBER:** 98-P

(LEAVE BLANK - ASSIGNED BY SECRETARY OF STATE):

**CONCISE SUMMARY** (UNDERSTANDABLE BY AVERAGE CITIZEN): The board proposes to adopt Chapter 890, an installation standard for new mobile homes (i.e., HUD Code homes) in order to comply with federal law and rules. Twenty percent of new installations will be subject to a pre-occupancy inspection by board staff.

Currently, installation standards for new and used mobile homes (i.e., HUD Code and pre-HUD Code homes) appear in Chapter 900 of the board's rules. Chapter 900 will be amended to apply to used mobile homes only.

The board also proposes to amend Chapter 820 so as to allow state-certified modular homes to be placed in manufactured housing communities. Modular homes permitted in manufactured housing communities may not be more than one story in height but may have a non-habitable attic space. At least 50% of the homes in a manufactured housing community must be mobile homes.

The statement of economic impact on small business required by 5 MRSA §8052(5-A) may be obtained from the agency contact person.

**THIS RULE WILL  WILL NOT  HAVE A FISCAL IMPACT ON MUNICIPALITIES.**

**STATUTORY AUTHORITY:** 10 MRSA §§9005-A, 9006 and 9085

**PUBLIC HEARING):**

(IF ANY, GIVE DATE, TIME, LOCATION)

May 6, 2009, 10:00 a.m., Department of Professional and Financial Regulation, 122 Northern Avenue, Gardiner, Maine

**DEADLINE FOR COMMENTS:** May 18, 2009

**AGENCY CONTACT PERSON:** Robert V. LeClair, Executive Director

**AGENCY NAME:** Office of Licensing and Registration

**ADDRESS:** 35 State House Station, Augusta, ME 04333

**TELEPHONE:** (207) 624-8678

**EMAIL:** robert.v.leclair@maine.gov

**PROPOSED RULE AVAILABLE ON LINE AT:** [www.maine.gov/professionallicensing](http://www.maine.gov/professionallicensing)

---

Please approve bottom portion of this form and  
assign appropriate MFASIS number.

APPROVED FOR PAYMENT \_\_\_\_\_ DATE: \_\_\_\_\_  
*Authorized signature*

FUND	AGENCY	ORG	APP	JOB	OBJT	AMOUNT
------	--------	-----	-----	-----	------	--------

**02 DEPARTMENT OF PROFESSIONAL AND FINANCIAL REGULATION**

**385 MANUFACTURED HOUSING BOARD**

**Chapter 820: DEFINITIONS**

---

Summary: This chapter defines terms used in the rules relating to manufactured housing communities.

---

**1. Definitions**

As used in the board's rules, unless the context otherwise indicates, the following words have the following meanings:

- 1. Board.** "Board" means the Manufactured Housing Board as described in 10 MRSA §9003.
- 2. Central subsurface sewer system.** "Central subsurface sewer system" means a system designed to collect sewage from two or more individual sites and convey it to another area where the sewage is disposed of in a manner approved by the Department of Human Services, Division of Health Engineering. A central subsurface sewer system may consist of more than one cluster in different areas of the community.
- 3. Community.** "Community" means a manufactured housing community.
- 4. Community water system.** "Community water system" means any system of pipes or other constructed conveyances, structures and facilities owned by the manufactured housing community through which water is obtained for or sold, furnished or distributed to community residents for human consumption that is regulated by the Department of Human Services, Division of Health Engineering, pursuant to the Safe Water Drinking Act, 22 MRSA §2611 *et seq.*
- 5. Home.** "Home" means a manufactured home as defined herein, and does not include a modular home as defined in 10 MRSA §9002(7)(B).
- 6. Manufactured home.** "Manufactured home" means:
  - A.** A structure constructed prior to June 15, 1976, transportable in one or more sections which is 8 body feet or more in width and is 32 body feet or more in length and which is built on a permanent chassis and designed to be used as a dwelling with or without a permanent foundation when connected to the required utilities and includes the plumbing, heating, air conditioning and electrical systems contained therein; and

B. A structure constructed after June 15, 1976, which the manufacturer certifies is constructed in compliance with the United States Department of Housing and Urban Development (“HUD”) standard, meaning a structure, transportable in one or more sections, which, in the traveling mode, is 8 body feet or more in width and 40 body feet or more in length or, when erected on site, is 320 or more square feet, and which is built on a permanent chassis and designed to be used as a dwelling, with or without a permanent foundation, when connected to the required utilities, including the plumbing, heating, air-conditioning and electrical systems contained therein; except that such term shall include any structure which meets all the requirements of this paragraph except the size requirements and with respect to which the manufacturer voluntarily files a certification required by the Secretary of the United States Department of Housing and Urban Development and complies with the standards established under the National Manufactured Housing Construction and Safety Standards Act of 1974, 42 United States Code 5401, *et seq.*

---

C. State-certified modular homes, which are those units that the manufacturer certifies are constructed in compliance with the State’s Manufactured Housing Act and regulations, meaning structures, transportable in one or more sections, that are not constructed on a permanent chassis and are designed to be used as dwellings on foundations when connected to required utilities, including the plumbing, heating air-conditioning or electrical systems contained therein. Such homes may not be more than one story in height but may have a non-habitable attic space.

7. **Manufactured housing community.** “Manufactured housing community” means a parcel or adjoining parcels of land under single ownership, which has been planned and improved for the placement of three or more manufactured homes as defined in section 6, where at least 50% of the homes must comply with section 6(A) or (B) of this chapter, but shall not include a construction camp or a campground. “Manufactured housing community” is synonymous with “mobile home park” as defined in 10 MRSA §9081(2).
8. **Pad.** “Pad” means the area that has been prepared for the placement of a manufactured home.
9. **Potable water.** “Potable water” means water which is satisfactory for drinking, culinary and domestic purposes and meets the requirements of the authority having jurisdiction.
10. **Private Water System.** “Private water system” means any system of pipes or other constructed conveyances, structures and facilities owned by the manufactured housing community through which water is obtained for or sold, furnished or distributed to community residents for human consumption that is

not regulated by the Department of Human Services, Division of Health Engineering, pursuant to the Safe Water Drinking Act, 22 MRSA §2611 *et seq.*

11. **Proprietor.** “Proprietor” means any person, corporation, firm , partnership, municipality or other entity that conducts, controls, manages or operates any manufactured housing community.
  12. **Resident.** “Resident” means a tenant in a manufactured housing community.
  13. **Site.** “Site” means the land surrounding and including the pad that is occupied by a resident.
- 

STATUTORY AUTHORITY: 10 MRSA §9085

EFFECTIVE DATE:

April 1, 1984

AMENDED:

September 1, 1984

May 1, 1986

March 1, 1987

August 19, 1988

March 14, 1990

EFFECTIVE DATE (ELECTRONIC CONVERSION):

January 11, 1997

AMENDED:

March 5, 1997 - Sec. 1(O)

NON-SUBSTANTIVE CORRECTION:

August 6, 1997 - “Rome” corrected to “Home” in Definitions (I).

REPEALED AND REPLACED:

November 8, 2003 - filing 2003-400

02 DEPARTMENT OF PROFESSIONAL AND FINANCIAL REGULATION  
 385 MANUFACTURED HOUSING BOARD

CHAPTER 890 MANUFACTURED HOME INSTALLATION STANDARDS

**SUBCHAPTER A - GENERAL**

I. Administration

A. Scope

<p>Entire chapter is new. Replaces Chapter 900 for installations of <i>new</i> HUD Code homes. Chapter 900 remains in effect for installations of <i>used</i> HUD Code and pre-HUD Code homes.</p>
--

These Installation Standards provide minimum requirements for the initial installation of new manufactured homes, in accordance with Section 605 of the Act (42 U.S.C. 5404). The Installation Standards are one component of the Manufactured Home Installation Program in Part 3286, and upon effect, serve as the basis for developing the manufacturers' installation instructions as required by Section II of this subchapter. The manufacturers' installation instructions, including specific methods for performing a specific operation or assembly, will be deemed to comply with these Installation Standards, provided they meet or exceed the minimum requirements of these Installation Standards and do not take the home out of compliance with the Manufactured Home Construction and Safety Standards (24 CFR part 3280). Work necessary to join all sections of a multi-section home specifically identified in subchapters G, H, and I, or work associated with connecting exterior lights, chain-hung light fixtures, or ceiling-suspended fans, as specifically identified in Subchapter I, is not considered assembly or construction of the home, although design of those elements of a manufactured home must comply with the Manufactured Home Construction and Safety Standards (MHCSS). However, work associated with the completion of hinged roofs and eaves in Subchapter I, Section I and other work done on-site and not specifically identified in this part as close-up is considered construction and assembly and is subject to the requirements of the Manufactured Home Construction and Safety Standards (24 CFR part 3280) and the Manufactured Home Procedural and Enforcement Regulation (24 CFR part 3282). This standard covers the installation of manufactured homes, wherever located.

B. Intended Usage of Manufactured Homes Covered Under this Standard

The provisions of this standard are intended to apply to manufactured homes (single section, multiple section or expanded types) for use as a single family dwelling. The following homes are included:

Those units constructed after June 15, 1976, which the manufacturer certifies are constructed in compliance with the HUD standard, meaning structures, transportable in one or more sections, which in the traveling mode, are 8 body feet or more in width and 40 body feet or more in length or, when erected on site, are 320 or more square feet, and which are built on a permanent chassis and designed to be used as dwellings, with or without permanent foundations, when connected to the required utilities, including plumbing, heating, air conditioning and electrical systems contained therein; except that such term shall include any structure which meets all the requirements of this paragraph

except the size requirements and with respect to which the manufacturer voluntarily files a certification required by the Secretary of the United States Department of Housing and Urban Development and complies with the standards established under the National Manufactured Housing Construction and Safety Standards Act of 1974.

Note 1: This standard does not apply to manufactured housing used for other than dwelling purposes.

Note 2: This standard does not apply to recreational vehicles as defined in NFPA 1192, Standard on Recreational Vehicles, or to park trailers as defined in ANSI A119.5, Standards for Park Trailers.

Note 3: This standard does not apply to the installation of used homes.

### C. Applicability

The standards set forth herein have been established to accomplish certain basic objectives and are not to be construed as relieving manufacturers, retailers, installers, or other parties of responsibility for compliance with other applicable ordinances, codes, regulations, and laws. The new manufactured homes covered by this standard must comply with requirements of the U.S. Department of Housing and Urban Development's (HUD) MHCSS Program, as set forth in 24 CFR part 3280, Manufactured Home Construction and Safety Standards, and 24 CFR part 3282, Manufactured Home Procedural and Enforcement Regulations, as well as, upon effect, the Manufactured Home Installation Program, 24 CFR part 3286, and the Dispute Resolution Program, 24 CFR part 3288. The requirements of this chapter do not apply to homes installed on site-built permanent foundations when the manufacturer certifies the home in accordance with Section 3282.12.

This standard applies only to new manufactured homes as defined in Section V(AA) of this subchapter and to new manufactured housing as defined in 10 MRSA §9002(7)(A) and does not apply to modular or other types of manufactured dwellings. This standard is designed for the safety and health of mobile home users.

This standard does not relieve the manufactured home owner or occupant from responsibilities for the proper use and maintenance of a manufactured home.

## II. Manufacturer Installation Instructions

### A. Instructions Required

A manufacturer must provide with each new manufactured home, installation designs and instructions that have been approved by the Secretary or DAPIA. The approved installation instructions must include all topics covered in the Model Installation Standards for the installation of manufactured homes. These installation instructions and any variations there to that are prepared to comply with paragraph C of this section must provide protection to residents of the manufactured homes that equals or exceeds the protection provided by these Installation Standards and must not take the manufactured home out of compliance with the MHCSS. These instructions must insure

that each home will be supported and anchored in a manner that is capable of meeting or exceeding the design loads required by the MHCSS.

B. Professional Engineer or Registered Architect Certification

A professional engineer or registered architect must prepare and certify that the manufacturer's installation instructions meet or exceed the Installation Standards for foundation support and anchoring whenever:

1. The manufacturer's installation instructions do not conform in their entirety to the minimum requirements or tables or their conditions for foundation support and anchoring of this Standard; or
2. An alternative foundation system or anchoring system is employed, including designs for basements and perimeter support foundation systems, whether or not it is included in the installation instructions; or
3. Materials such as metal piers or alternatives to concrete footing materials are required by the installation instructions; or
4. Foundation support and anchoring systems are designed for use in areas subject to freezing or for use in areas subject to flood damage or high seismic risk; or
5. Foundation support and anchoring systems are designed to be used in special snow load conditions or in severe wind design areas; or
6. Site conditions do not allow the use of the manufacturer's installation instructions; or
7. There are any other circumstances in which the manufacturer's installation instructions would not permit the home to be installed in conformance with the Installation Standards or the MHCSS.

C. Variations to Installation Instructions

1. Before an installer provides support or anchorage that are different than those methods specified in the manufacturer's installation instructions, or when the installer encounters site or other conditions (such as areas that are subject to flood damage or high seismic risk) that prevent the use of the instructions, the installer must:
  - a. First attempt to obtain DAPIA-approved designs and instructions prepared by the manufacturer; or
  - b. If designs and instructions are not available from the manufacturer, obtain an alternative design prepared and certified by a registered professional engineer or registered architect for the support and anchorage of the manufactured home that is consistent with the

manufactured home design, conforms to the requirements of the MHCSS, and has been approved by the manufacturer and the DAPIA.

2. The manufacturer's installation instructions must include an explanation of the requirement in paragraph (C)(1) of this Section.

D. Installer Certification

In making the certification of the installation required under part 3286, upon effect, an installer must certify that it completed the installation in compliance with either the manufacturer's instructions or with an alternate installation design and instructions that have been prepared by the manufacturer or prepared in compliance with paragraph C of this section. The installer will comply with this section for new homes by affixing a completed State of Maine Installation Warranty Seal to the home.

E. Temporary Storage

The installation instructions must provide at least one method for temporarily supporting each transportable section of a manufactured home, to prevent structural and other damage to the home, when those section(s) are temporarily sited at the manufacturer's facility, retailer's lot, or the home site.

III. Alterations during Initial Installation

Additions, modifications, replacement or removal of any equipment that affects the installation of the home made by the manufacturer, retailer or installer prior to completion of the installation must equal or exceed the protections and requirements of these Installation Standards, the MHCSS (24 CFR part 3280) and the Manufactured Home Procedural and Enforcement Regulations (24 CFR part 3282). An alteration, as defined in 3282.7, must not affect the ability of the basic manufactured home to comply with the MHCSS, and the alteration must not impose additional loads to the manufactured home or its foundation, unless the alteration is included in the manufacturer's DAPIA-approved designs and installation instructions, or is designed by a registered professional engineer or registered architect consistent with the manufacturer's design and that conforms to the requirements of the MHCSS.

IV. Incorporation by Reference (IBR)

- A. The materials listed in this section are incorporated by reference in the corresponding sections noted. These incorporations by reference were approved by the Director of the Federal Register in accordance with 5 U.S.C. 552(a) and 1 CFR part 51. These materials are available for purchase at the corresponding addresses noted below, and all are available for inspection at the Office of Manufactured Housing Programs, U.S. Department of Housing and Urban Development, 451 Seventh Street, SW, Room 9164, Washington, DC 20410; or the National Archives and Records Administration (NARA). For information on the availability of this material at NARA, call (202) 741-6030, or go to: <http://www.archives.gov/federal-register/cfr/ibr-locations.html>.

- B. The materials listed below are available for purchase from the Air Conditioning Contractors of America (ACCA), 2800 Shirlington Road, Suite 300, Arlington, Virginia 22206:

ACCA Manual J, Residential Load Calculation, 8<sup>th</sup> Edition, IBR approved for Subchapter F, Section III (A)(1)(a)(i).

- C. The materials listed below are available for purchase from APA-The Engineered Wood Association, 7011 South 19<sup>th</sup> Street, Tacoma, Washington 98411, telephone number (253) 565-6600, fax number (253) 565-7265:

PS1-95, Construction and Industrial Plywood (with typical APA trademarks), 1995 edition, IBR approved for Subchapter D, Section XII (A)(2)(a).

- D. The materials listed below are available for purchase from American Society of Heating, Refrigerating and Air Conditioning Engineers (ASHRAE), 1791 Tullie Circle, NE, Atlanta, Georgia 30329-2305:

ASHRAE Handbook of Fundamentals, 1997 Inch-Pound Edition, IBR approved for Subchapter F, Section III (A)(1)(a).

- E. The materials listed below are available for purchase from American Society for Testing and Materials (ASTM), 100 Barr Harbor Drive, West Conshohocken, Pennsylvania 19428-2959:

1. ASTM C 90-02a, Standard Specification for Loadbearing Concrete Masonry Units, 2002, IBR approved for Subchapter D, Section XII(A)(1)(a).
2. ASTM D 1586-99, Standard Test Method for Penetration Test and Split-Barrel Sampling of Soils, 1999, IBR approved for Subchapter C, Section II(C).
3. ASTM D 2487-00, Standard Practice for Classification of Soils for Engineering Purposes (Unified Soil Classification System), 2000, IBR approved for Subchapter C, Section II(C).
4. ASTM D 2488-00, Standard Practice for Description and Identification of Soils (Visual-Manual Procedure), 2000, IBR approved for Subchapter C, Section II(C).
5. ASTM D 3953-97, Standard Specification for Strapping, Flat Steel and Seals, 1997, IBR approved for Subchapter E, Section II(B)(2) and Note 10 to Table 1 to Subchapter E, Section II.

- F. The materials listed below are available for purchase from American Wood-Preservers' Association (AWPA), PO Box 388, Selma, Alabama 36702:

1. AWPA M4-02, Standard for the Care of Preservative-Treated Wood Products, 2002, IBR approved for Subchapter D, Section XII(A)(2)(c).

2. AWP A U1-04, Use Category System; User Specification for Treated Wood, 2004, IBR approved for Subchapter D, Section III(B)(1), Subchapter D, Section XII(A)(2)(b), and Subchapter F, Section IV(C).

- G. The materials listed below are available for purchase from the Federal Emergency Management Administration (FEMA), 500 C Street, SW, Washington, DC 20472:

FEMA 85/September 1985, Manufactured Home Installation in Flood Hazard Areas, 1985, IBR approved for Subchapter B, Section II(D)(3).

- H. The materials listed below are available for purchase from the National Fire Protection Association (NFPA), 1 Batterymarch Park, Quincy, Massachusetts 02169-7471:

1. NFPA 31, Standard for the Installation of Oil Burning Equipment, 2001 edition, IBR approved for Subchapter J.
2. NFPA 70, National Electrical Code, 2005 edition, IBR approved for Subchapter H, Section II (E)(1) and Subchapter J.
3. NFPA 501A, Standard for Fire Safety Criteria for Manufactured Home Installations, Sites, and Communities, 2003 edition, IBR approved for Subchapter B, Section I.

- I. The materials listed below are available for purchase from the Structural Engineering Institute/American Society of Civil Engineers (SEI/ASCE), 1801 Alexander Bell Drive, Reston, Virginia 20191:

SEI/ASCE 32-01, Design and Construction of Frost Protected Shallow Foundations, 2001, IBR approved for Subchapter D, Section XII(B)(2)(b) and Subchapter D, Section XII(B)(3)(b).

## V. Definitions

The definitions contained in this section apply to the terms used in these Model Installation Standards. Where terms are not included, common usage of the terms applies. The definitions are as follows:

- A. “Act” means the National Manufactured Housing Construction and Safety Standards Act of 1974, 42 U.S.C. 5401-5426.
- B. “Anchor Assembly” means any device or other means designed to transfer home anchoring loads to the ground.
- C. “Anchoring Equipment” means ties, straps, cables, turnbuckles, chains, and other approved components, including tensioning devices that are used to secure a manufactured home to anchor assemblies.

- D. “Anchoring System” means a combination of anchoring equipment and anchor assemblies that will, when properly designed and installed, resist the uplift, overturning, and lateral forces on the manufactured home and on its support and foundation system.
- E. “Approved” means complying with the requirements of the Department of Housing and Urban Development (when used in connection with any material, appliance or construction).
- F. “Arid region” means an area subject to 15 inches or less of annual rainfall.
- G. “Base flood” means the flood having a one percent chance of being equaled or exceeded in any given year.
- H. “Base flood elevation (BFE)” means the elevation of the base flood, including wave height, relative to the datum specified on a LAHJ’s flood hazard map.
- I. “Comfort cooling certificate” means a certificate permanently affixed to an interior surface of the home specifying the factory design and preparations for air conditioning the manufactured home.
- J. “Crossovers” means the utility interconnections in multi-section homes that are located where the sections are joined. Crossover connections include heating and cooling ducts, electrical circuits, water pipes, drain plumbing, and gas lines.
- K. “Design Approval Primary Inspection Agency (DAPIA)” means a state or private organization that has been accepted by the Secretary in accordance with the requirements of Part 3282, Subchapter H, which evaluates and approves or disapproves manufactured home designs and quality control procedures.
- L. “Diagonal tie” means a tie intended to resist horizontal or shear forces, but which may resist vertical, uplift, and overturning forces.
- M. “Flood hazard area” means the greater of either: The special flood hazard area shown on the flood insurance rate map; or the area subject to flooding during the design flood and shown on a LAHJ’s flood hazard map, or otherwise legally designated.
- N. “Flood hazard map” means a map delineating the flood hazard area and adopted by a LAHJ.
- O. “Footing” means that portion of the support system that transmits loads directly to the soil.
- P. “Foundation” means a site-built or site assembled system of stabilizing devices which are capable of transferring design dead loads and live loads required by Federal Regulations and other design loads unique to local home sites due to wind and water conditions, that are imposed by or upon the structure into the underlying soil bedrock without failure.

- Q. “Ground anchor” means a specific anchoring assembly device designed to transfer home anchoring loads to the ground.
- R. “Hurricane-resistive manufactured home” means a manufactured home which meets the wind design load requirements for Zone II.
- S. “Installation” means the process of affixing, assembling or setting up manufactured housing on foundation or supports at the building site.
- T. “Installation instructions” means DAPIA–approved instructions provided by the home manufacturer that accompany each new manufactured home and detail the home manufacturer requirements for support and anchoring systems, and other work completed at the installation site to comply with these Model Installation Standards and the Manufactured Home Construction and Safety Standards in 24 CFR part 3280.
- U. “Installation standards” means reasonable specifications for the installation of a new manufactured home, at the place of occupancy, to ensure proper siting, the joining of all sections of the home, and the installation of stabilization, support or anchoring systems.
- V. “Installer” means any licensed dealer or an employee of a licensed dealer, or a person licensed as a mechanic, who engages in the process of affixing, assembling or setting up of manufactured housing on foundations or supports at a building site.
- W. “Labeled” means a label, symbol, or other identifying mark of a nationally recognized testing laboratory, inspection agency, or other organization concerned with product evaluation that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling is indicated compliance with nationally recognized standards or tests to determine suitable usage in a specified manner.
- X. “Listed or certified” means included in a list published by a nationally recognized testing laboratory, inspection agency, or other organization concerned with product evaluation that maintains periodic inspection of production of listed equipment or materials, and by whose listing states either that the equipment or material meets nationally recognized standards or has been tested and found suitable for use in a specified manner.
- Y. “Local authority having jurisdiction (LAHJ)” means the municipality that has local responsibilities that must be complied with during the installation of a manufactured home and those local responsibilities are outside the jurisdiction of the Manufactured Housing Board.
- Z. “Lowest floor” means the floor of the lowest enclosed area of a manufactured home. An unfinished or flood resistant enclosure, used solely for vehicle parking, home access, or limited storage, must not be considered the lowest floor, provided the enclosed area is not constructed so as to render the home in violation of the flood-related provision of this Standard.
- AA. “Manufactured home” means a structure, transportable in one or more sections, which in the traveling mode, is 8 body feet or more in width or 40 body feet or more in length,

or, when erected on site is 320 or more square feet, and which is built on a permanent chassis and designed to be used as a dwelling with or without a permanent foundation when connected to the required utilities, and includes the plumbing, heating, air-conditioning, and electrical systems contained in the structure. The term includes all structures that meet the above requirements, except the size requirements and with respect to which the manufacturer voluntarily files a certification pursuant to part 3282.13 and complies with the MHCSS set forth in part 3280. This term does not include any self-propelled recreational vehicle. Calculations used to determine the number of square feet in a structure will include the total of square feet for each transportable section comprising the completed structure and will be based on the structure's exterior dimensions measured at the largest horizontal projections when erected on-site. These dimensions will include all expandable rooms, cabinets, and other projections containing interior space, but do not include bay windows. Nothing in this definition should be interpreted to mean that a manufactured home necessarily meets the requirements of HUD's Minimum Property Standards (HUD Handbook 4900.1) or that it is automatically eligible for financing under 12 U.S.C. 1709(b) certification.

- BB. “Manufactured Home Construction and Safety Standards or MHCSS or “part 3280” means the Manufactured Home Construction and Safety Standards established in part 3280, pursuant to section 604 of the Act, 42 U.S.C. 5403.
- CC. “Manufactured Home Installation Program or “part 3286” means the Manufactured Home Installation Program established in 24 CFR part 3286.
- DD. “Manufactured Home Procedural and Enforcement Regulations or “part 3282” means the Manufactured Home Procedural and Enforcement Regulations established in 24 CFR part 3282.
- EE. “Manufactured home gas supply connector” means a listed connector designed for connecting the manufactured home to the gas supply source.
- FF. “Manufactured home site” means a designated parcel of land designed for the installation of one manufactured home for the exclusive use of the occupants of the home.
- GG. “Manufactured Housing Board” or “board” means the State of Maine Manufactured Housing Board.
- HH. “Manufactured Housing Consensus Committee or MHCC” means the consensus committee established pursuant to section 604(a)(3) of the Act, 42 U.S.C. 5403(a)(3).
- II. “Model Installation Standards” means the installation standards established pursuant to section 605 of the Act, 42 U.S.C. 5404.
- JJ. “Pad” means that area which has been established for the placement of a home.
- KK. “Pier” means that portion of the support system between the footing and the manufactured home, exclusive of caps and shims.

- LL. “Ramada” means any freestanding roof or shade structure, installed or erected above a manufactured home or any portion thereof.
- MM. “Secretary” means the Secretary of Housing and Urban Development, or an official of HUD delegated the authority of the Secretary with respect to the Act.
- NN. “Set-up” means the work performed and operations involved in the placement and securing of a manufactured home or any portion thereof and includes the connection of existing electrical, oil burner, gas, water, sewage, and similar systems.
- OO. “Shall” means to indicate a mandatory requirement.
- PP. “Should” means to indicate a recommendation or that which is advised but not required.
- QQ. “Skirting” means weather-resistant material used to enclose the perimeter, under the living area of the home, from the bottom of the manufactured home to grade.
- RR. “Stabilizing devices” means all components of the anchoring and support systems, such as piers, footings, ties, anchoring equipment, anchoring assemblies, or any other equipment, materials and methods of construction, that support and secure the manufactured home to the ground.
- SS. “State” means each of the several States, the District of Columbia, the Commonwealth of Puerto Rico, Guam, the Virgin Islands, the Canal Zone, and American Samoa.
- TT. “Support system” means pilings, columns, footings, piers, foundation walls, shims, and any combination thereof that, when properly installed, support the manufactured home.
- UU. “Tie” means straps, cable, or securing devices used to connect the manufactured home to anchoring assemblies.
- VV. “Ultimate load” means the absolute maximum magnitude of load that a component or system can sustain, limited only by failure.
- WW. “Uncontrolled fill” means fill materials that are placed without control of the content of the fill materials or without adequate compaction to assure a bearing capacity without undue settlement. For purposes of this Standard, uncontrolled fill shall mean fill materials containing organic matter or fills which are placed without compaction necessary to provide a uniform bearing capacity of 1000 lbs./ft.
- XX. “Utility connection” means the connection of the manufactured home to utilities that include, but are not limited to, electricity, water, sewer, gas, or fuel oil.
- YY. “Vertical tie” means a tie intended to resist uplifting and overturning forces.
- ZZ. “Wind zone” means the areas designated on the Basic Wind Zone Map, as further defined in Appendix A to this chapter.

AAA. “Working load” means the maximum recommended load that may be exerted on a component or system determined by dividing the ultimate load of a component or system by an appropriate factor of safety.

VI. Final Leveling of Manufactured Home

Refer to Subchapter J.

VII. Preoccupancy Inspections

Board staff will conduct pre-occupancy inspections of 20% of all new manufactured homes installed in Maine. The 20% will be selected randomly from locations throughout the state. For homes that pass inspection, a label will be affixed under the kitchen sink cabinet certifying that the installation complied with this installation standard. For homes that do not pass inspection, a notice of violation and order of correction will be issued to the dealer or mechanic who performed the installation in the manner described in Chapter 370, Section 5(A) of the board’s rules. The licensee shall respond to the notice of violation and order of correction as set forth in Chapter 370, and the provisions of Chapter 370 shall apply to any further proceedings arising from the notice of violation and order of correction.

**SUBCHAPTER B - PRE-INSTALLATION CONSIDERATIONS**

I. Fire Separation

No portion of a manufactured home, excluding the hitch, shall be located closer than 10 feet (3 meters) side to side, 8 feet (2.4 meters) end to side, or 6 feet (1.8 meters) end to end horizontally from any other manufactured home or community building unless the exposed composite walls and roof of either structure are without openings and constructed of materials that will provide a 1 hour fire-resistance rating or the structures are separated by a 1 hour fire-rated barrier.

II. Installation of Manufactured Homes in Flood Hazard Areas

A. Definitions

Except to the extent otherwise in Subchapter A, the terms used in this subchapter are as defined in 44 CFR 59.1 of the National Flood Insurance Program (NFIP) regulations.

B. Applicability

The provisions of this section apply to the initial installation of new manufactured homes located wholly or partly within the flood hazard area.

C. Pre-Installation Considerations

Prior to the initial installation of a new manufactured home, the installer is responsible for determining whether the manufactured home site lies wholly or partly within a special flood hazard area as shown on the LAHJ’s Flood Insurance Rate Map, Flood Boundary and Floodway Map, or Flood Hazard Boundary Map, or if no LAHJ, in

accordance with NFIP regulations. If so located, and before an installation method is agreed upon, the map and supporting studies adopted by the LAHJ must be used to determine the flood hazard zone and base flood elevation at the site.

#### D. General Elevation and Foundation Requirements

##### 1. Methods and Practices

Manufactured homes located wholly or partly within special flood hazard areas must be installed on foundations engineered to incorporate methods and practices that minimize flood damage during the base flood, in accordance with the LAHJ, 44 CFR 60.3(a) through (e) and other provisions of 44 CFR referenced by those paragraphs.

##### 2. Outside Appliances

- a. Appliances installed on the manufactured home site in flood hazard areas must be anchored and elevated to or above the same elevation as the lowest elevation of the lowest floor of the home.
- b. Appliance air inlets and exhausts in flood hazard areas must be located at or above the same elevation as the lowest elevation of the lowest floor of the home.

##### 3. Related guidance

Refer to FEMA 85/September 1985, *Manufactured Home and Installation in Flood Hazard Areas* (incorporated by reference).

#### III. Site Suitability with Design Zone Maps

Prior to the initial installation of a new manufactured home and as part of making the certification of the installation required under part 3286 of the Federal standards, upon effect, the installer is to verify that the design and construction of the manufactured home, as indicated on the design zone maps provided with the home, are suitable for the site location where the home is to be installed. The design zone maps are those identified in part 3280 of the Federal standards.

##### A. Wind Zone

Manufactured homes must not be installed in a wind zone that exceeds the design wind loads for which the home has been designed, as evidenced by the wind zone indicated on the home's data plate. Maine wind zones are described in Appendix A to this chapter.

##### B. Roof Load Zone

Manufactured homes must not be located in a roof load zone that exceeds the design roof load for which the home has been designed as evidenced by the roof load zone

indicated on the home's data plate. Maine roof load zones are described in Appendix A to this chapter.

C. Thermal Zone

Manufactured Homes must not be installed in a thermal zone that exceeds the thermal zone for which the home has been designed as evidenced by the thermal zone indicated on the heating/cooling certificate and insulation zone map. The manufacturer may provide the heating/cooling information and insulation zone map on the home's data plate.

IV. Permits, Other Alterations, and On-Site Structures

Refer to Subchapter J for considerations related to permitting, other alterations and on-site structures.

### **SUBCHAPTER C – SITE PREPARATION**

I. Soil Conditions

To help prevent settling or sagging, the foundation must be constructed on firm, undisturbed soil or fill compacted to at least 90 percent of its maximum relative density. All organic material such as grass, roots, twigs, and wood scraps must be removed in areas where footings are to be placed. After removal of organic material, the home site must be graded or otherwise prepared to ensure adequate drainage, in accordance with Subchapter C, Section III. Homes shall not be installed on uncontrolled fill.

II. Soil Classifications and Bearing Capacity

The soil classification and bearing capacity of the soil must be determined before the foundation is constructed and anchored. The soil classification and bearing capacity must be determined by one or more of the following methods, unless the soil bearing capacity is established as permitted in paragraph F of this Section:

- A. Soil tests. Soil tests that are in accordance with generally accepted engineering practice; or
- B. Soil records. Soil records of the applicable LAHJ; or
- C. Soil classifications and bearing capacities. If the soil class or bearing capacity cannot be determined by test or soil records, but its type can be identified, the soil classification, allowable pressures, and torque values shown in the table to this section may be used.
- D. A pocket penetrometer; or
- E. In lieu of determining the soil bearing capacity by use of the methods shown in the table, an allowable pressure of 1,500 psf may be used, unless the site-specific information requires the use of lower values based on soil classification and type.

- F. If the soil appears to be composed of peat, organic clays or uncompacted fill, or appears to have unusual conditions, a registered professional geologist, registered professional engineer, or registered architect must determine the soil classification and maximum allowable soil bearing capacity.

**Table to Subchapter C, Section II – Soil Classifications and Bearing Capacity**  
**ASTM D 2487–00 or D 2488–00, (incorporated by reference)**

Soil classification		Soil description	Allowable soil bearing pressure (psf) <sup>1</sup>	Blow count ASTM D 1586–99	Torque probe <sup>3</sup> value <sup>4</sup> (inch-pounds)
Classification number					
1 .....	.....	Rock or hard pan .....	4000+ .....		
2 .....	GW, GP, SW, SP, GM, SM.	Sandy gravel and gravel; very than dense and/or cemented sands; course gravel/ cobbles; preloaded silts, clays and coral.	2000 .....	40+	More than 550.
3 .....	GC, SC, ML, CL .....	Sand; silty sand; clayey sand; silty gravel; medium dense course sands; sandy gravel; and very stiff silt, sand clays.	1500 .....	24–39	351–550.
4A .....	CG, MH <sup>2</sup> .....	Loose to medium dense sands; firm to stiff clays and silts; alluvial fills.	1000 .....	18–23	276–350.
4B .....	CH, MH <sup>2</sup> .....	Loose sands; firm clays; alluvial fills .....	1000 .....	12–17	175–275.
5 .....	OL, OH, PT .....	Uncompacted fill; peat; organic clays .....	Refer to Subchapter C Section II(E)	0–11	Less than 175.

Notes to Table

1. The values provided in this table have not been adjusted for overburden pressure, embedment depth, water table height, or settlement problems.
2. For Soils classified as CH or MH, without either torque probe values or blow count test results, selected anchors must be rated for a 4B soil.
3. The torque test probe is a device for measuring the torque probe value of soils to assist in evaluating the holding capacity of the soil in which the ground anchor is placed. The shaft must be of suitable length for the full depth of the ground anchor.
4. The torque value is a measure of the load resistance provided by the soil when subject to the turning or twisting force of the probe.

III. Site Drainage

A. Purpose

Drainage must be provided to direct surface water away from the home to protect against erosion of foundation supports and to prevent water build-up under the home, as shown in the Figure to Subchapter C, Section III – Site Drainage.

- B. The home site must be graded as shown in the Figure to Section III-Site Drainage, or other methods, such as a drain tile and automatic sump pump system, must be provided to remove any water that may collect under the home.

- C. All drainage must be diverted away from the home and must slope a minimum of one-half inch per foot away from the foundation for the first 10 feet. Where property lines, walls, slopes, or other physical conditions prohibit this slope, the site must be provided with drains or swales or otherwise graded to drain water away from the structure as shown in the Figure 1 to Section III – Site Drainage.


D. Sloped Site Considerations

The home, where sited, must be protected from surface runoff from the surrounding area.

E. Gutters and Downspouts

Manufacturers must specify in their installation instructions whether the home is suitable for the installation of gutters and downspouts. If suitable, the installation instructions must indicate that when gutters and downspouts are installed, the runoff must be directed away from the home.

**Figure to Subchapter C, Section III – Site Drainage**

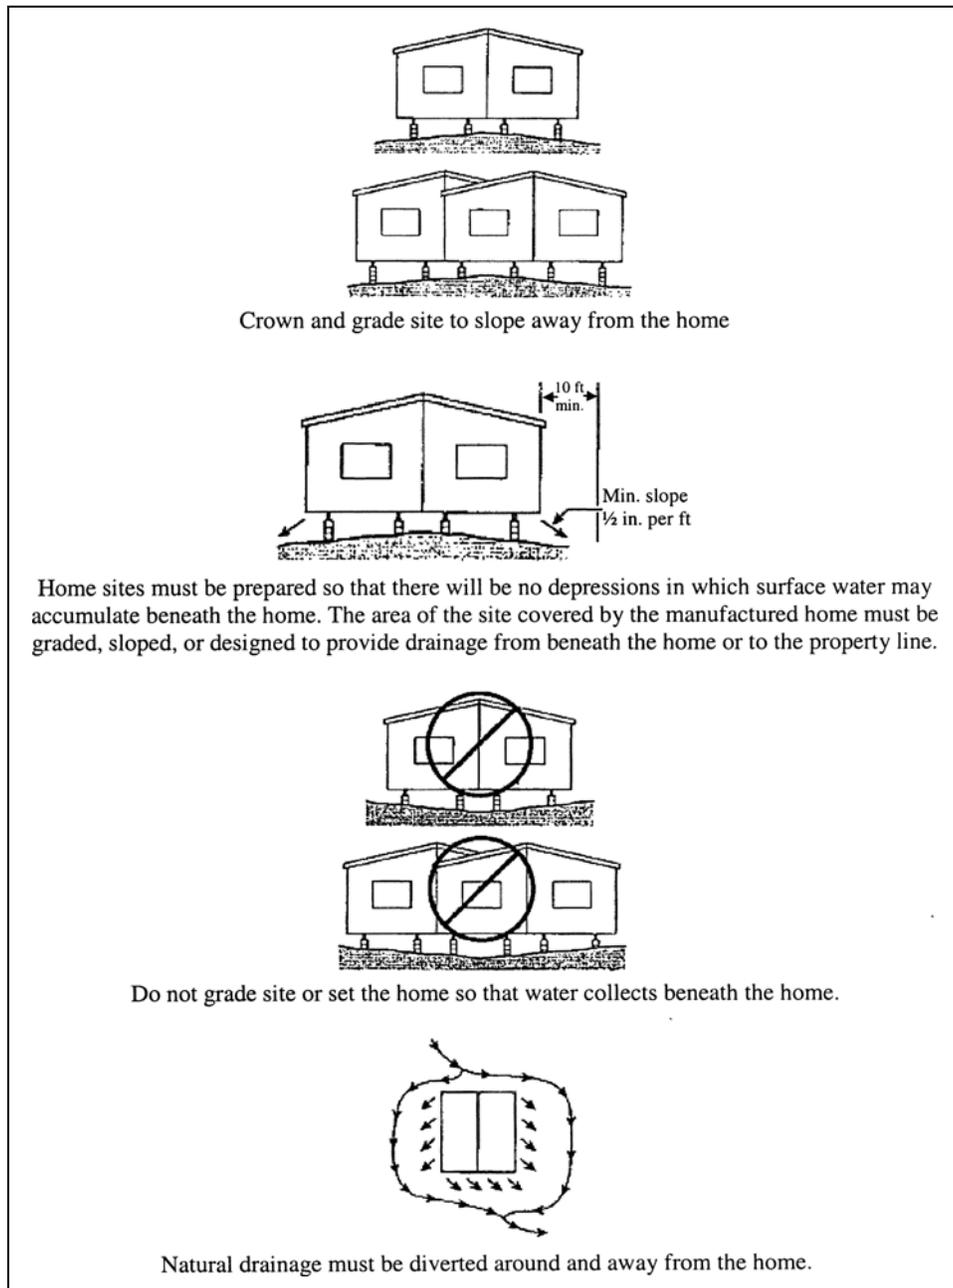

**IV. Ground Moisture Control**

**A. Vapor Retarder**

If the space under the home is to be enclosed with skirting or other materials, a vapor retarder must be installed to cover the ground under the home.

**B. Vapor Retarder Material**

A minimum of six mil polyethylene sheeting or its equivalent must be used.

### C. Proper Installation

1. The entire area under the home must be covered with the vapor retarder as noted in paragraph A of this section, except for areas under open porches, decks, and recessed entries. Joints in the vapor retarder must be overlapped at least 12 inches.
2. The ground cover may be placed directly beneath footings, or otherwise installed around or over footings placed at grade, and around anchors or other obstructions.
3. Any voids or tears in the vapor retarder must be repaired. At least one repair method must be provided in the manufacturer's installation instructions.

## SUBCHAPTER D - FOUNDATIONS

### I. General

- A. Foundations for manufactured home installations must be designed and constructed in accordance with this subchapter and must be based on site conditions, home design features, and the loads the home was designed to withstand, as shown on the home's data plate.
- B. Foundation systems that are not pier and footing type configurations may be used when verified by engineering data and designed in accordance with Subchapter D, Section I(D), consistent with the design loads of the MHCSS. Pier and footing specifications that are different than those provided in this subchapter, such as block size, metal piers, section width, loads, and spacing, may be used when verified by engineering data and comply with Subchapter D, Section I(C) and (D) and are capable of resisting all design loads of the MHCSS.
- C. All foundation details, plans, and test data must be designed and certified by a registered professional engineer or registered architect, and must not take the home out of compliance with the MHCSS.
- D. Alternative foundation systems or designs are permitted in accordance with either of the following:
  1. Systems or designs must be manufactured and installed in accordance with their listings by a nationally recognized testing agency based on a nationally recognized testing protocol; or
  2. System designs must be prepared by a registered professional engineer or a registered architect in accordance with acceptable engineering practice and must be installed so as not to take the home out of compliance with the MHCSS (part 3280).

### II. Flood Hazard Areas

In flood hazard areas, foundations, anchorings, and support systems must be capable of resisting loads associated with design flood and wind events, or combined wind and flood events, and homes must be installed on foundation supports that are designed and anchored to prevent flotation, collapse, or lateral movement of the structure. Manufacturer's installation instructions must indicate whether:

- A. The foundation specifications have been designed for flood-resistant considerations, and, if so, the conditions of applicability for velocities, depths, or wave action; or
- B. The foundation specifications are not designed to address flood loads.

### III. Piers

#### A. General

The piers used must be capable of transmitting the vertical live and dead loads to the footings or foundation.

#### B. Acceptable Piers – Materials Specification

- 1. Piers are permitted to be concrete blocks, pressure-treated wood with a water borne preservative, in accordance with AWWPA Standard U1-04 (incorporated by reference) for Use Category 4B ground contact applications; or adjustable metal or concrete piers.
- 2. Manufactured piers must be listed or labeled for the required vertical load capacity, and, where required by design, for the appropriate horizontal load capacity.

#### C. Design Requirements

##### 1. Load-bearing capacity

The load-bearing capacity for each pier must be designed to include consideration for the dimensions of the home, the design dead and live loads, the spacing of the piers, and the way the piers are used to support the home.

- 2. Center beam/mating wall support must be required for multi-section homes and designs must be consistent with Tables 2 and 3 of this section and Figures A, B, and C to Subchapter D, Section X.

#### D. Pier Loads

- 1. Design support layout configurations for the pier loads, pier spacing, and roof live loads must be in accordance with Tables 1, 2 and 3 of this section and the MHCSS. Other pier designs are permitted in accordance with this subchapter.

2. Manufactured piers must be rated at least to the loads required to safely support the dead and live loads, as required by Subchapter D, Section I, and the installation instructions for those piers must be consistent with Tables 1, 2, and 3 of this section.

**Table 1 to Subchapter D, Section III – Piers  
Frame Blocking Only – Perimeter Support not Required Except at Openings**

Pier spacing	Roof live load (psf)	Location	Load (lbs.)
4 ft. 0 in. ....	20	Frame .....	2,900
	30	Frame .....	3,300
	40	Frame .....	3,600
6 ft. 0 in. ....	20	Frame .....	4,200
	30	Frame .....	4,700
	40	Frame .....	5,200
8 ft. 0 in. ....	20	Frame .....	5,500
	30	Frame .....	6,200
	40	Frame .....	6,900
10 ft. 0 in. ....	20	Frame .....	6,800
	30	Frame .....	7,600
	40	Frame .....	8,500

Notes to Table 1:

1. See the Table to Subchapter D, Section XII for cast-in-place footing design by using the noted loads.
2. Table 1 is based on the following design assumptions: maximum 16 ft. nominal section width (15 ft. actual width), 12" eave, 10" I-beam size, 300 lbs. per dead load, 10 psf roof dead load, 6 psf floor dead load, 35 plf wall dead load, and 10 plf chassis dead load.
3. Interpolation for other pier spacing is permitted.
4. The pier spacing and loads shown in the above table do not consider floor or seismic loads, and are not intended for use in flood or seismic hazard areas. In those areas, the foundation support system is to be designed by a professional engineer or architect.
5. See the Table to Subchapter D, Section XII for sizing of footings.

**Table 2 to Subchapter D, Section III – Piers  
Frame Plus Perimeter Blocking/Perimeter Blocking Required**

Maximum pier spacing	Roof live load (psf)	Location	Load (lbs.)
4 ft. 0 in. ....	20	Frame .....	1,400
		Perimeter .....	1,900
		Mating .....	3,200
4 ft. 0 in. ....	30	Frame .....	1,400
		Perimeter .....	2,300
		Mating .....	3,800
4 ft. 0 in. ....	40	Frame .....	1,400
		Perimeter .....	2,600
		Mating .....	4,400
6 ft. 0 in. ....	20	Frame .....	1,900
		Perimeter .....	2,700
		Mating .....	4,700
6 ft. 0 in. ....	30	Frame .....	1,900
		Perimeter .....	3,200
		Mating .....	5,600
6 ft. 0 in. ....	40	Frame .....	1,900
		Perimeter .....	3,700
		Mating .....	6,500
8 ft. 0 in. ....	20	Frame .....	2,400
		Perimeter .....	3,500
		Mating .....	6,100
8 ft. 0 in. ....	30	Frame .....	2,400
		Perimeter .....	4,200
		Mating .....	7,300
8 ft. 0 in. ....	40	Frame .....	2,400
		Perimeter .....	4,800
		Mating .....	8,500
10 ft. 0 in. ....	20	Frame .....	2,900
		Perimeter .....	4,300
		Mating .....	7,600
10 ft. 0 in. ....	30	Frame .....	2,900
		Perimeter .....	5,100
		Mating .....	9,100
10 ft. 0 in. ....	40	Frame .....	2,900
		Perimeter .....	6,000
		Mating .....	10,600

Notes to Table 2:

1. See the Table to Subchapter D, Section XII for cast-in-place footing design by using the noted loads.
2. Mating wall perimeter piers and footings only required under full height mating walls supporting roof loads. Refer to Figures 1 and 2 to Subchapter D, Section X.
3. Table 2 is based on the following design assumptions: maximum 16 ft. nominal section width (15 ft. actual width), 12" eave, 10" I-beam size, 300 lbs. pier dead load, 10 psf roof dead load, 6 psf floor dead load, 35 plf wall dead load, and 10 plf chassis dead load.
4. Interpolation for other pier spacing is permitted.
5. The pier spacing and loads shown in the above table do not consider floor or seismic loads and are not intended for use in flood or seismic hazard areas. In those areas, the foundation support system is to be designed by a professional engineer or architect.
6. See the Table to Subchapter D, Section XII for sizing of footings.

**Table 3 to Subchapter D, Section III – Piers  
Ridge Beam Span Footing Capacity**

Mating wall opening (ft)	Roof live load (psf)	Pier and footing load (lbs.)
5 .....	20	1,200
	30	1,600
	40	1,900
10 .....	20	2,300
	30	3,100
	40	3,800
15 .....	20	3,500
	30	4,700
	40	5,800
20 .....	20	4,700
	30	6,200
	40	7,500
25 .....	20	5,800
	30	7,800
	40	9,700
30 .....	20	7,000
	30	9,300
	40	11,600
35 .....	20	8,100
	30	10,900
	40	13,600

Notes to Table 3:

1. See the Table to Subchapter D, Section XII for cast-in-place footing design by using the noted loads.
2. Table 3 is based on the following design assumptions: maximum 16 ft. nominal section width (15 ft. actual width), 12" eave, 10" I-beam size, 300 lbs. per dead load, 10 psf roof dead load, 6 psf floor dead load, 35 plf wall dead load, and 10 plf chassis dead load.
3. Loads listed are maximum column loads for each section of the manufactured home.
4. Interpolation for maximum allowable pier and column loads is permitted for mate-line openings between those shown in the table.
5. The pier spacing and loads shown in the above table do not consider flood or seismic loads, and are not intended for use in flood or seismic hazard areas. In those areas, the foundation support system is to be designed by a professional engineer or architect.
6. See the Table to Subchapter D, Section XII for sizing of footings.

**IV. Pier Configuration**

**A. Concrete Blocks**

Installation instructions for concrete block piers must be developed in accordance with the following provisions and must be consistent with Figures 1 and 2 to Subchapter D, Section VI:

1. Load-bearing (not decorative) concrete blocks must have nominal dimensions of at least 8 inches x 8 inches x 16 inches;
2. The concrete blocks must be stacked with their hollow cells aligned vertically; and
3. When piers are constructed of blocks stacked side by side, each layer must be at right angles to the preceding one, as shown in Figure 2 to Subchapter D, Section VI.

**B. Caps**

1. Structural loads must be evenly distributed across capped-hollow block piers, as shown in Figures 1 and 2 to Subchapter D Section VI.

2. Caps must be solid masonry of at least 4 inches nominal in thickness, or hardboard lumber at least 2 inches nominal in thickness, or be of corrosion-protected minimum one-half inch thick steel; or be of other listed materials.
3. All caps must be of the same length and width as the piers on which they rest.
4. When split caps are used on double stacked blocks, the caps must be installed with the long dimension across the joint in the blocks below.

#### C. Gaps

Any gaps that occur during installation between the bottom of the main chassis beam and foundation support system must be filled by:

1. Nominal 4 inch x 6 inch x 1 inch shims to level the home and fill any gaps between the base of the main chassis beam and the top of the pier cap;
2. Shims must be used in pairs as shown in Figures 1 and 2 to Subchapter D, Section VI, and must be driven in tightly so that they do not occupy more than one inch of vertical height; and
3. Hardwood plates no thicker than 2 inches nominal in thickness or 2 inch or 4 inch nominal concrete block must be used to fill in remaining vertical gaps.

#### D. Manufactured Pier Heights

Manufactured pier heights must be selected so that the adjustable risers do not extend more than 2 inches when finally positioned.

#### V. Clearance under Homes

A minimum clearance of 12 inches must be maintained between the lowest member of the main frame (I-beam or channel beam) and the grade under all areas of the home.

#### VI. Design Procedures for Concrete Block Piers

##### A. Frame piers less than 36 inches high

1. Frame piers less than 36 inches high are permitted to be constructed of single, open or closed-cell concrete blocks 8 inches x 8 inches x 16 inches, when the design capacity of the block is not exceeded.
2. The frame piers must be installed so that the long sides are at right angles to the supported I-beam, as shown in Figure 1 of this section.
3. The concrete blocks must be stacked with their hollow cells aligned vertically and must be positioned at right angles to the footings.

4. Horizontal offsets from the top to the bottom of the pier must not exceed one-half inch.
5. Mortar is not required, unless specified in the installation instructions or required by a registered professional engineer or registered architect.


**B. Frame Piers 36 inches to 48 inches high and Corner Piers**

1. All frame piers between 36 inches and 48 inches high and all corner piers over three blocks high must be constructed out of double, interlocked concrete blocks, as shown in Figure B to this section, when the design capacity of the block is not exceeded. Mortar is not required for concrete piers, unless otherwise specified in the manufacturer installation instructions or required by a registered professional engineer or registered architect.
2. Horizontal offsets from the top to the bottom of the pier must not exceed one inch.


**C. All Piers over 48 inches High**

Piers over 48 inches high must be designed by a registered professional engineer or registered architect, in accordance with acceptable engineering practice. Mortar is not required for concrete block piers unless otherwise specified in the manufacturer installation instructions or by the design.

**Figure A to Subchapter D, Section VI – Design Procedures for Concrete Pier Blocks:  
Typical Footing and Pier Design, Single Concrete Block**

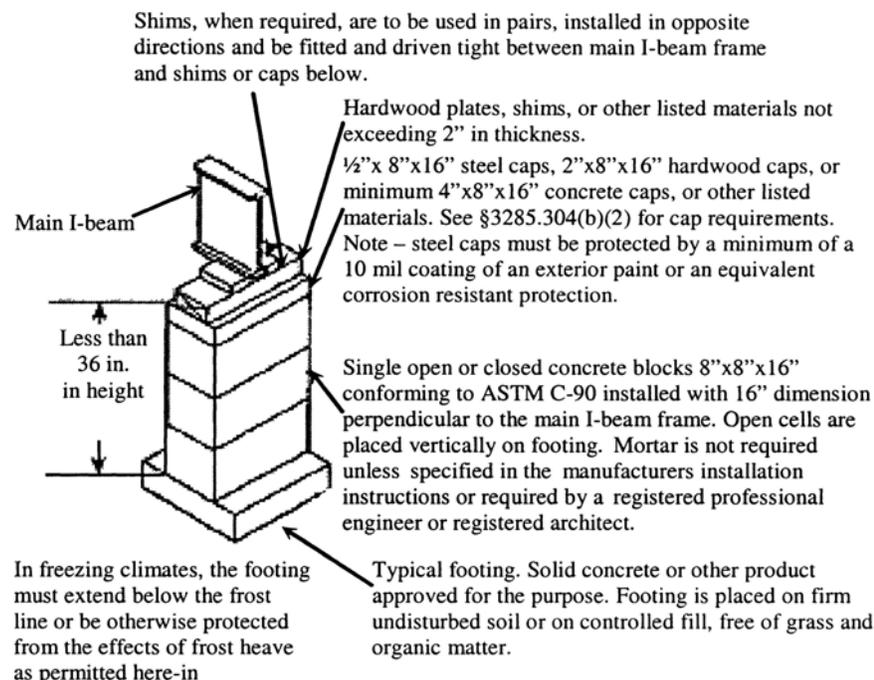

**Figure B to Subchapter D, Section VI – Design Procedures for Concrete Pier Blocks:  
Typical Footing and Pier Installation, Double Concrete Block**

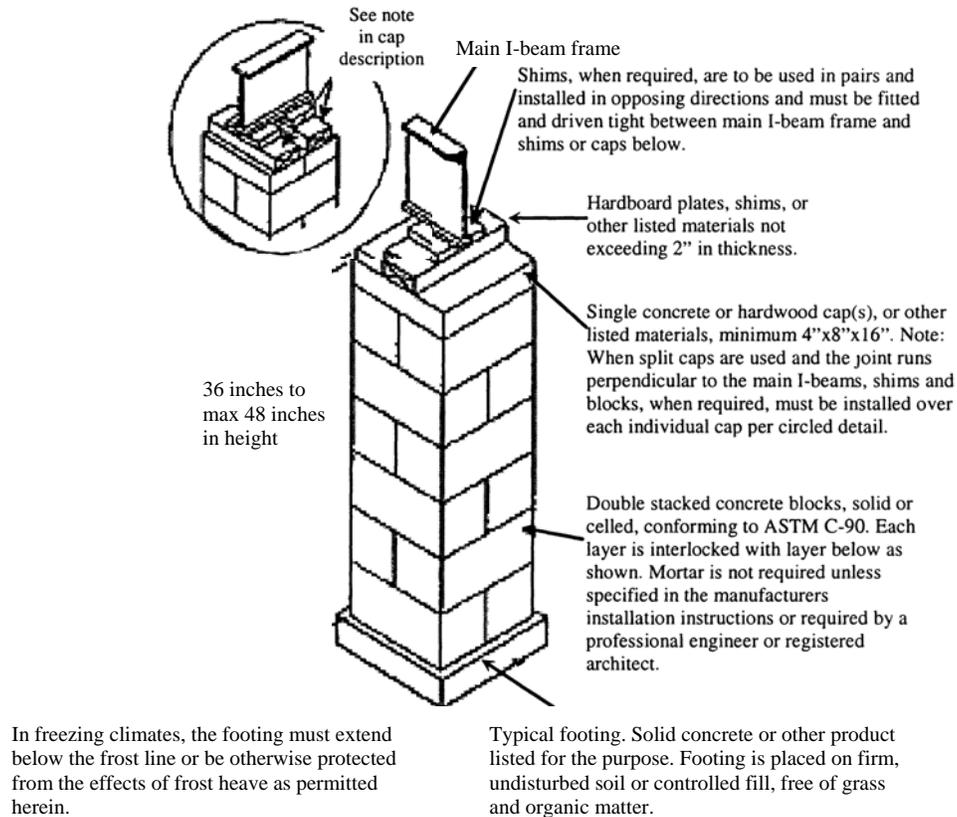

**VII. Perimeter Support Piers**

- A. Piers required at mate-line supports, perimeter piers, and piers at exterior wall openings are permitted to be constructed of single open-cell or closed-cell concrete blocks, with nominal dimensions of 8 inches x 8 inches x 16 inches, to a maximum height of 48 inches as shown in Figure A to this section, when the design capacity of the block is not exceeded.
- B. Piers used for perimeter support must be installed with the long dimension parallel to the perimeter rail.

**VIII. Manufactured Piers**


- A. Manufactured piers must be listed and labeled and installed to the pier manufacturer's installation instructions. See Subchapter D, Section III(D)(2) for additional requirements.
- B. Metal or other manufactured piers must be provided with protection against weather deterioration and corrosion at least equivalent to that provided by a coating of zinc on steel of .30 oz./ft<sup>2</sup> of surface coated.

IX. [Reserved]

X. Pier Location and Spacing

- A. The location and spacing of piers depends upon the dimensions of the home, the live and dead loads, the type of construction (single- or multi-section), I-beam size, soil bearing capacity, footing size, and such other factors as the location of doors or other openings.
- B. Mate-line and column pier supports must be in accordance with this subchapter and consistent with Figures A through C of this section unless the pier support and footing configuration is designed by a registered professional engineer or registered architect.
- C. Piers supporting the frame must be no more than 24 inches from both ends and not more than 120 inches center to center under the main rails.
- D. Pier support locations and spacing must be presented to be consistent with Figures A and B to Subchapter D, Section XII, as applicable, unless alternative designs are provided by a registered professional engineer or registered architect in accordance with acceptable engineering practice.

**Figure A to Subchapter D, Section X – Pier Location and Spacing:  
Typical Mate-Line Column Pier and Mating Wall Support  
When Frame Only Blocking is Required**

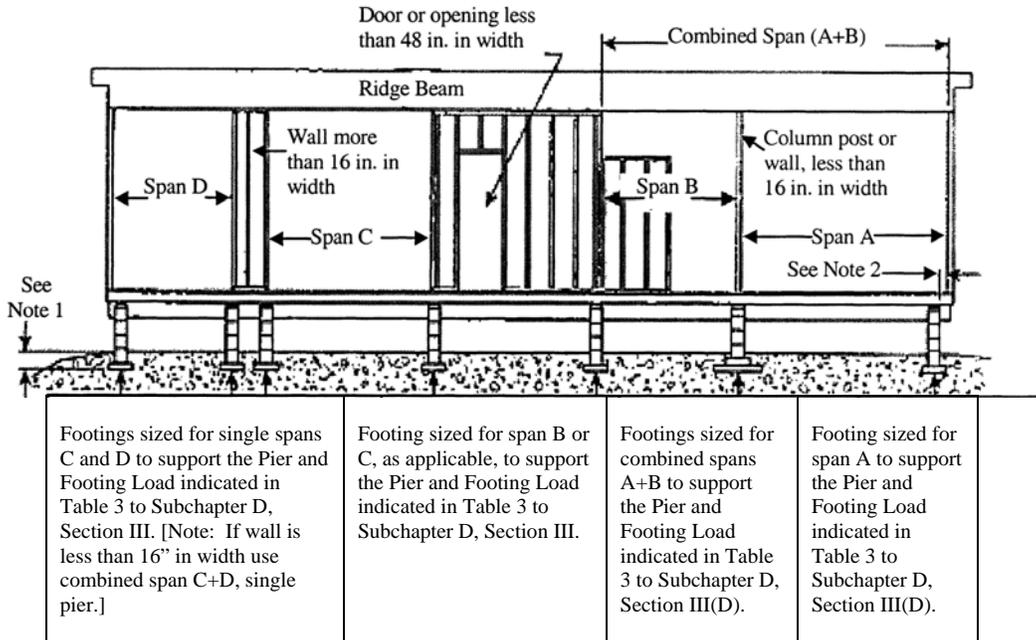


Notes to Figure A:

1. Bottom of footings must extend below frost line depth, unless designed for placement above the frost lines. (See Subchapter D, Section XII(B)).
2. Piers may be offset up to 6 inches in either direction along the supported members to allow for plumbing, electrical, mechanical, equipment, crawlspace, or other devices.
3. Single-stack concrete block pier loads must not exceed 8,000 lbs.
4. Prefabricated piers must not exceed their approved or listed maximum vertical or horizontal design loads.
5. When a full-height mating wall does not support the ridge beam, this area is considered an unsupported span – Span B.

- Piers are not required at openings in the mating wall that are less than 48 inches in width. Place piers on both sides of mating wall openings that are 48 inches or greater in width. For roof loads of 40 psf or greater, a professional engineer or registered architect must determine the maximum mating wall opening permitted without pier or other supports.


**Figure B to Subchapter D, Section X – Pier Location & Spacing:  
Typical Mate-Line Column Pier and Mating Wall Support  
When Perimeter Blocking is Required**

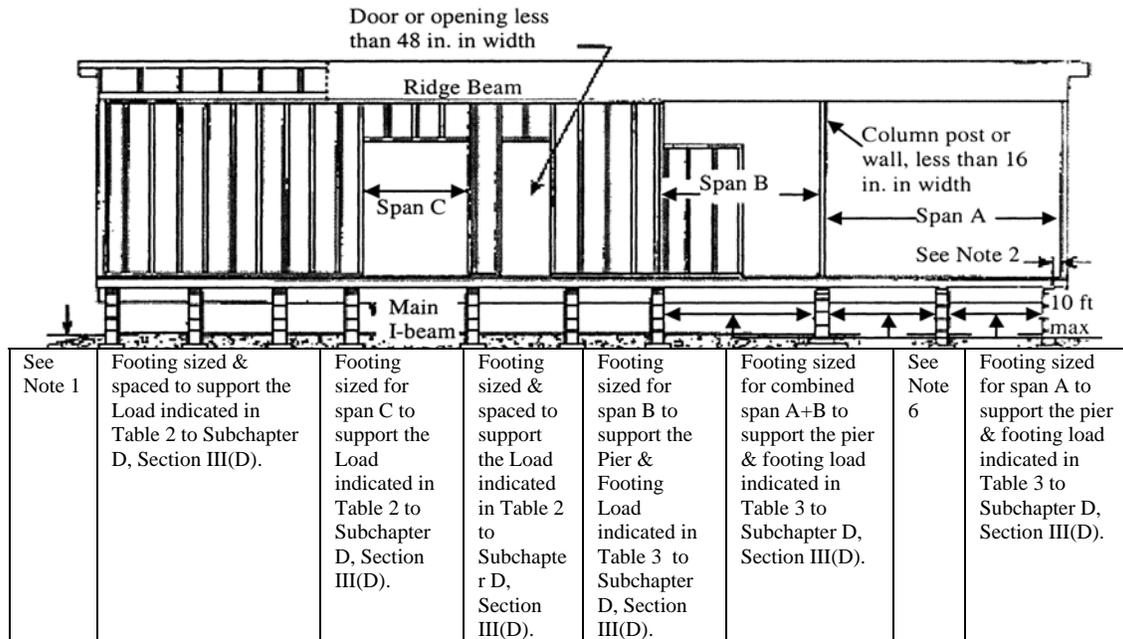

Notes to Figure B:

- Bottom of footings must be below the frost line depth, unless designed for placement above the frost line. (See Subchapter D, Section XII(B)).
- Piers may be offset 6 inches in either direction along supported members to allow for plumbing, electrical, mechanical equipment, crawlspace, or other devices.
- Single stack concrete blocks pier loads must not exceed 8,000 lbs.
- Piers are not required at openings in the mating wall that are less than 48 inches in width. Place piers on both sides of mating wall openings that are 48 inches or greater in width. For roof loads of 40 psf or greater, a professional engineer or registered architect must determine the maximum mating wall opening permitted without pier or other supports.
- When a full-height mating wall does not support the ridge beam, this area is considered an unsupported span – Span B.
- In areas where the open span is greater than 10 ft., intermediate piers and footings must be placed at maximum 10 ft. on center.
- Prefabricated piers must not exceed their approved or listed maximum horizontal or vertical design loads.
- Column piers are in addition to piers required under full-height mating walls.

**Figure C to Subchapter D, Section X – Pier Location & Spacing:  
Typical Mate-Line Column and Piers**

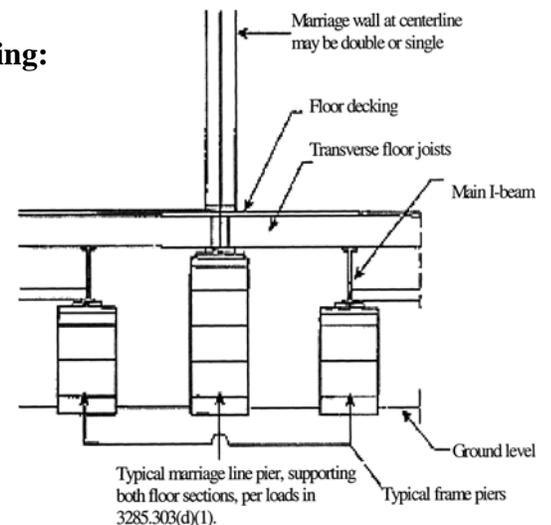

Notes to Figure C:

- Mate-line column supports piers are installed with the long dimension of the concrete block perpendicular to the rim joists.
- Pier and footing designed to support both floor sections. Loads as listed in Table 3 to Subchapter D, Section III are total column loads for both sections.

## XI. Required Perimeter Supports

- A. Perimeter pier or other supports must be located as follows:
1. On both sides of side wall exterior doors (such as entry, patio, and sliding glass doors) and any other side wall openings of 48 inches or greater in width, and under load-bearing porch posts, factory installed fireplaces, and fireplace stoves.)
  2. Other perimeter supports must be:
    - a. Located in accordance with Table 2 to Subchapter D, Section III; or
    - b. Provided by other means such as additional outriggers or floor joists. When this alternative is used, the design required by Subchapter D, Section I must consider the additional loads in sizing the pier and footing supports under the main chassis beam.
- B. For roof live loads of 40 psf or greater, a professional registered engineer or professional architect must determine the maximum sidewall opening permitted without perimeter pier or other supports.
- C. The location and installation of any perimeter pier support must not take the home out of compliance with the Manufactured Home Construction and Safety Standards (part 3280).

## XII. Footings

- A. Materials approved for footings must provide equal load-bearing capacity and resistance to decay, as required by this section. Footings must be placed on undisturbed soil or fill compacted to 90 percent of maximum relative density. A footing must support every pier. Footings are to be either:
1. Concrete
    - a. Four inch nominal precast concrete pads meeting or exceeding ASTM C 90-02a, Standard Specification for Loadbearing Concrete Masonry Units (incorporated by reference), without reinforcement, with at least a 28-day compressive strength of 1,200 pounds per square inch (psi); or
    - b. Six inch nominal poured-in-place concrete pads, slabs, or ribbons with at least a 28-day compressive strength of 3,000 pounds per square inch (psi). Site-specific soil conditions or design load requirements may also require the use of reinforcing steel in cast-in-place concrete footings.
  2. Pressure-treated permanent wood

- a. Pressure-treated wood footings must consist of a minimum of two layers of nominal 2-inch thick pressure treated wood, a single layer of nominal  $\frac{3}{4}$ -inch thick, pressure-treated plywood with a maximum size of 16 inches by 16 inches, or at least two layers of  $\frac{3}{4}$ -inch thick, pressure-treated plywood for sizes greater than 16 inches by 16 inches. Plywood used for this purpose is to be rated exposure 1 or exterior sheathing, in accordance with PS1-95, Construction and Industrial Plywood (incorporated by reference).
  - b. Pressure-treated lumber is to be treated with a water-borne adhesive, in accordance with AWPA Standard U1-04 (incorporated by reference) for Use Category 4B ground contact applications.
  - c. Cut ends of pressure treated lumber must be field-treated, in accordance with AWPA Standard M4-02 (incorporated by reference).
3. ABS footing pads
- a. ABS footing pads are permitted provided they are installed in accordance with the pad manufacturer installation instructions and certified for use in the soil classification at the site.
  - b. ABS footing pads must be listed or labeled for the required load capacity.
4. Other materials

Footings may be of other materials than those identified in this section, provided they are listed for such use and meet all other applicable requirements of this subchapter.

B. Placement in Freezing Climates

Footings placed in freezing climates must be designed using methods and practices that prevent the effects of frost heave by one of the following methods:

1. Conventional footings

Conventional footings must be placed below the frost line depth for the site unless an insulated foundation or monolithic slab is used (refer to Subchapter D, Section XII(C)(2) and Subchapter D, Section XII(C)(3)). When the frost line depth is not available from the LAHJ, a registered professional engineer, registered architect, or registered geologist must be consulted to determine the required frost line depth for the manufactured home site. This is not subject to the provisions in Subchapter A, Section II(C) that also require review by the manufacturer and approval by its DAPIA for any variations to the manufacturer's installation instructions for support and anchoring.

2. Monolithic slab systems

A monolithic slab is permitted above the frost line when all relevant site-specific conditions, including soil characteristics, site preparation, ventilation, and insulative properties of the under floor enclosure are considered and anchorage requirements are accommodated as set out in Subchapter E, Section I. The monolithic slab system must be designed by a registered professional engineer or registered architect:

- a. In accordance with acceptable engineering practice to prevent the effects of frost heave; or
- b. In accordance with SEI/ASCE 32-01 (incorporated by reference).

3. Insulated foundations


An insulated foundation is permitted above the frost line, when all relevant site-specific conditions, including soil characteristics, site preparation, ventilation, and insulative properties of the under the floor enclosure, are considered, and the foundation is designed by a registered professional engineer or registered architect:

- a. In accordance with acceptable engineering practice to prevent the effects of frost heave; or
- b. In accordance with SEI/ASCE 32-01 (incorporated by reference).

C. Sizing of footings

The sizing and layout of footings depends on the load-bearing capacity of the soil, footings, and the piers. See Subchapter C, Sections II and III, and Table to Subchapter D, Section XII.

**Figure A to Subchapter D, Section XII – Footings  
Typical Blocking Diagram for Single Section Homes**

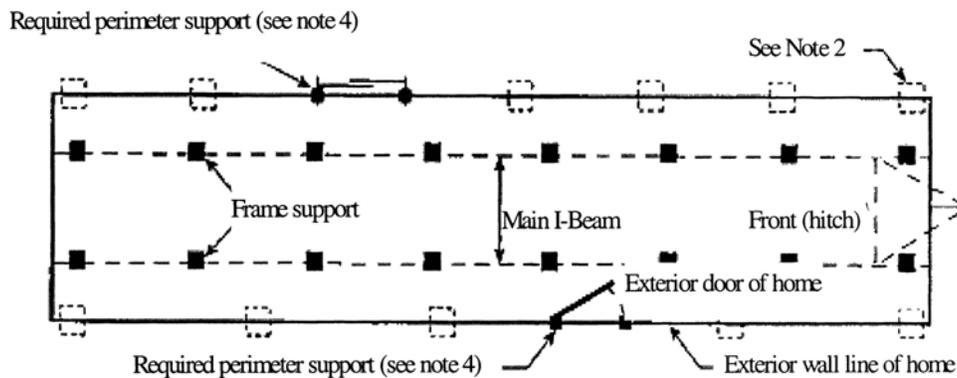


Notes to Figure A:

- 1. Refer to Table 1 to Subchapter D, Section III for pier and footing requirements when frame blocking only is used.
- 2. In addition to blocking required by Subchapter D, Section XI, see Table 2 to Subchapter D, Section III for maximum perimeter blocking loads.

3. End piers under main I-beams may be set back a maximum of 24 inches, as measure from the outside edge of the floor to the center of the pier.
4. Place piers on both sides of sidewall exterior doors, patio doors, and sliding glass doors; under porch posts, factory-installed fireplaces, and fireplace stoves; under jamb studs at multiple window openings; and at any other sidewall openings 48 inches or greater in width. For roof loads of 40 psf or greater, a professional engineer or registered architect must determine the maximum sidewall opening permitted without perimeter supports. See Subchapter D, Section VII and Subchapter D, Section XI for additional requirements for locating perimeter supports.

**Figure B to Subchapter D, Section XII – Footings**  
**Typical Blocking Diagram for Multi-section Homes**

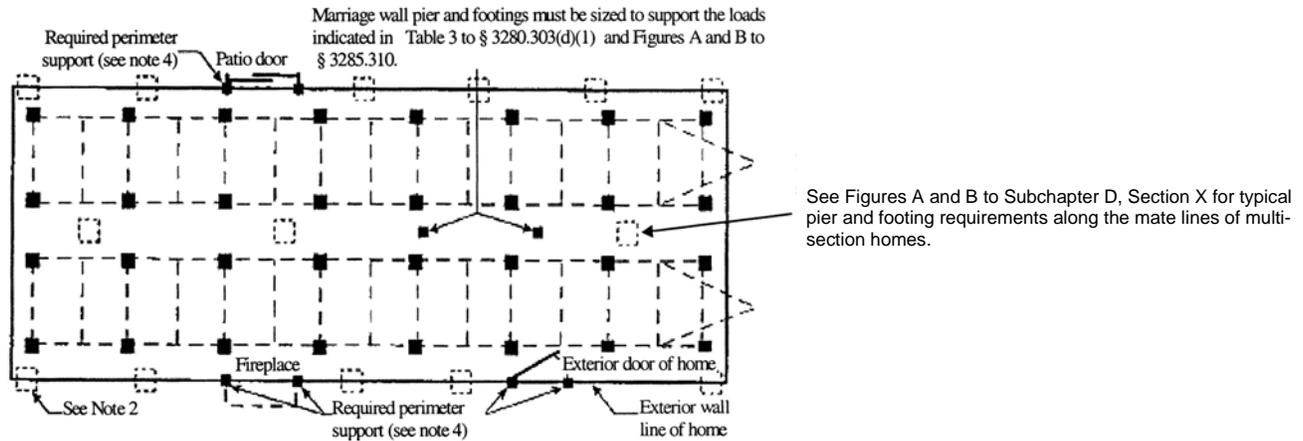

Notes to FigureB:

1. Refer to Table 1 to Subchapter D, Section III for pier and footing requirements when frame blocking only is used.
2. In addition to blocking required by Subchapter D, Section XI, see Tables 2 and 3 to Subchapter D, Section III for maximum perimeter blocking loads.
3. End piers under main I-beams may be set back a maximum of 24 inches, as measured from the outside edge of the floor to center of the pier.
4. Place piers on both sides of sidewall exterior doors, patio doors, and sliding glass doors; under porch posts, factory-installed fireplaces, and fireplace stoves; under jamb studs at multiple window openings; and at any other sidewall openings 48 inches or greater in width. For roof loads of 40 psf or greater, a professional engineer or registered architect must determine the maximum sidewall opening permitted without perimeter supports or mating wall opening permitted without pier or other supports. See Subchapter D, Section VII and Subchapter D, Section XI for additional requirements for locating perimeter supports.
5. When an end pier under the mate-line also serves as a column pier, it may be set back a maximum of 6 inches, as measured from the inside edge of the exterior wall to the center of the pier.

**Table to Subchapter D, Section XII – Footings**  
**The Size & Capacity for Unreinforced Cast-in-Place Footings**

Soil capacity (psf)	Minimum footing Size (in.)	8 in. x 16 in. pier		16 in. x 16 in. pier	
		Maximum footing capacity (lbs)	Unreinforced cast-in-place minimum thickness (in.)	Maximum footing capacity (lbs)	Unreinforced cast-in-place minimum thickness (in.)
1,000	16 x 16	1,600	6	1,600	6
	20 x 20	2,600	6	2,600	6
	24 x 24	3,700	6	3,700	6
	30 x 30	5,600	8	5,800	6
	36 x 36	7,900	10	8,100	8
	42 x 42	10,700	10	10,700	10
1,500	48 x 48	13,100	12	13,600	10
	16 x 16	2,500	6	2,500	6

	20 x 20	4,000	6	4,000	6
	24 x 24	5,600	8	5,700	6
	30 x 30	48,500	10	8,900	8
	36 x 36	412,400	10	12,600	8
	42 x 42	416,500	12	416,800	10
	48 x 48	421,200	14	421,600	12
2,000	16 x 16	3,400	6	3,400	6
	20 x 20	5,300	6	5,300	6
	24 x 24	7,600	8	7,700	6
	30 x 30	411,700	10	11,900	8
	36 x 36	416,700	15	416,900	10
	42 x 42	421,700	18	422,700	12
2,500	16 x 16	4,300	6	4,300	6
	20 x 20	6,700	6	6,700	6
	24 x 24	49,600	8	9,700	6
	30 x 30	414,800	10	15,000	8
	36 x 36	420,700	12	421,400	10
3,000	16 x 16	5,200	6	5,200	6
	20 x 20	8,100	8	8,100	6
	24 x 24	411,500	10	11,700	6
	30 x 30	417,800	12	418,100	8
	36 x 36	425,400	14	425,900	10
4,000	16 x 16	7,000	6	7,000	6
	20 x 20	410,800	8	10,900	6
	24 x 24	415,500	10	15,600	8
	30 x 30	423,300	12	424,200	10

## Notes to Table:

1. The footing sizes shown are for square pads and are based on the area (in.<sup>2</sup>), shear and bending required for the loads shown. Other configurations, such as rectangular or circular configurations, can be used, provided the area and depth is equal to or greater than the area and depth of the square footing shown in the table, and the distance from the edge of the pier to the edge of the footing is not less than the thickness of the footing.
2. The 6 inch cast-in-place values can be used for 4 inch unreinforced precast concrete footings.
3. The capacity values listed have been reduced by the dead load of the concrete footing.
4. Concrete block piers must not exceed their design capacity of 8,000 lbs for 8" x 16" single stack block and 16,000 lbs for 16" x 16" double stack block.
5. A registered professional engineer or registered architect must prepare the design, if the design loads exceed the capacity for single or double stack concrete block piers shown in footnote 4.

## XIII. Combination Systems

Support systems that combine both load-bearing capacity and uplift resistance must also be sized and designed for all applicable design loads.

## XIV. [Reserved]

## XV. Special Snow Load Conditions

## A. General

Foundations for homes designed for and located in areas with roof live loads greater than 40 psf must be designed by the manufacturer for the special snow load conditions in accordance with acceptable engineering practice. Where site or other conditions, final determination to be made by the Manufactured Housing Board, prohibit the use of the manufacturer's instructions, a registered professional engineer or registered architect must design the foundation for the special snow load conditions.

B. Ramadas

Ramadas may be used in areas with roof live loads greater than 40 psf. Ramadas are to be self-supporting, except any connection to the home must be for weatherproofing only.

## **SUBCHAPTER E – ANCHORAGE AGAINST WIND**

I. Anchoring Instructions

- A. After blocking and leveling, the manufactured home must be secured against the wind by use of anchor assembly type installations or by connecting the home to an alternative foundation system. See Subchapter D, Section I.
- B. For anchor assembly type installations, the installation instructions must require the home to be secured against the wind as described in this section. The installation instructions and design for anchor type assemblies must be prepared by a registered professional engineer or registered architect, in accordance with acceptable engineering practice, the design loads of the MHCSS, and Subchapter D, Section I.
- C. All anchoring and foundation systems must be capable of meeting the loads that the home was designed to withstand required by part 3280 and Subchapter D, as shown on the home's data plate.

Exception: Manufactured homes that are installed in less restrictive roof load zone and wind zone areas may have foundation or anchorage systems that are capable of meeting the lower design load provision of the Standards, if the design for the lower requirements is either provided in the installation instructions or the foundation and anchorage system is designed by a professional registered engineer or registered architect.

- D. The installation instructions are to include at least the following information and details for anchor assembly-type installation:
  - 1. The maximum spacing for installing diagonal ties and any required vertical ties or straps to ground anchors;
  - 2. The minimum and maximum angles or dimensions for installing diagonal ties or straps to ground anchors and the main chassis members of the manufactured home;

3. Requirements for connecting the diagonal ties to the main chassis members of the manufactured home. If the diagonal ties are attached to the bottom flange of the main chassis beam, the frame must be designed to prevent rotation of the beam;
4. Requirements for longitudinal and mating wall tie-downs and anchorage;
5. The method of strap attachment to the main chassis member and ground anchor, including provisions for swivel-type connections;
6. The methods for protecting vertical and diagonal strapping at sharp corners by use of radius clips or other means; and
7. As applicable, the requirements for sizing and installation of stabilizer plates.

## II. Ground Anchor Installations

### A. Ground Anchor Certification and Testing

Each ground anchor must be manufactured and provided with installation instructions, in accordance with its listing or certification. A nationally recognized testing agency must list, or a registered professional engineer or registered architect must certify, the ground anchor for use in a classified soil (refer to Subchapter C, Section II), based on a nationally recognized testing protocol, or a registered professional engineer or registered architect must certify that the ground anchor is capable of resisting all loads in paragraph B of this section for the soil type or classification.

### B. Specification for Tie-down Straps and Ground Anchors

#### 1. Ground Anchors

Ground anchors must be installed in accordance with their listing or certification, be installed to their full depth, be provided with protection against weather deterioration and corrosion at least equivalent to that provided by a coating of zinc on steel of not less than 0.30 oz./ft<sup>2</sup> of surface coated, and be capable of resisting a minimum ultimate load of 4,725 lbs, and a working load of 3,150 lbs, as installed, unless reduced capacities are noted in accordance with note 11 of Table 1 to this section or note 12 of Tables 2 and 3 to this section. The ultimate load and working load of ground anchors and anchoring equipment must be determined by a registered professional engineer or registered architect, or tested by a nationally recognized third-party testing agency in accordance with a nationally recognized testing protocol.

#### 2. Tie-Down Straps

A 1 ¼ inch x 0.035 inch or larger steel strapping conforming to ASTM D 3953-97, Standard Specification for Strapping, Flat Steel and Seals (incorporated by reference), Type 1, Grade 1, Finish B, with a minimum total capacity of 4,725 lbs and a working capacity of 3,150 lbs must be used. The tie-down straps must

be provided with protection against weather deterioration and corrosion at least equivalent to that provided by a coating of zinc on steel of not less than 0.30 oz./ft<sup>2</sup> of surface coated. Slit or cut edges of coating strapping need not be zinc coated.

C. Number and Location of Ground Anchors

1. Ground anchor and anchor strap spacing must be:

- a. No greater than the spacing shown in Tables 1 through 3 to this section and Figures A and B to this section; or
- b. Designed by a registered professional engineer or registered architect, in accordance with accepted engineering practice and the requirements of the MHCSS for any conditions that are outside the parameters and applicability of the Tables 1 through 3 to this section.


2. The requirements in paragraph C of this section must be used to determine the maximum spacing of ground anchors and their accompanying anchor straps, based on the soil classification determined in accordance with Subchapter C, Section II:

- a. The installed ground anchor type and size (length) must be listed for use in the soil class at the site and for the minimum and maximum angle permitted between the diagonal strap and the ground; and
- b. All ground anchors must be installed in accordance with their listing or certification and the ground anchor manufacturer installation instructions; and
- c. If required by the ground anchor listing or certification, the correct size and type of stabilizer plate is installed. If metal stabilizer plates are used, they must be provided with protection against weather deterioration and corrosion at least equivalent to that provided by a coating of zinc on steel of not less than 0.30 oz./ft<sup>2</sup> of surface coated. Alternatively, ABS stabilizer plates may be used when listed and certified for such use.

3. Longitudinal Anchoring

Manufactured homes must also be stabilized against wind in the longitudinal direction in all Wind Zones. Manufactured homes located in Wind Zones II and III must have longitudinal ground anchors installed on the ends of the manufactured home transportable section(s) or be provided with alternative systems that are capable of resisting wind forces in the longitudinal direction. See Figure C to Subchapter E, Section II for an example of one method that may be used to provide longitudinal anchoring. A registered professional engineer or registered architect must certify the longitudinal anchoring method or any alternative system used as adequate to provide the required stabilization, in accordance with acceptable engineering practice.


**Figure A to Subchapter E, Section II – Ground Anchor Installations  
Ground Anchor Locations and Spacing (Plan View)**

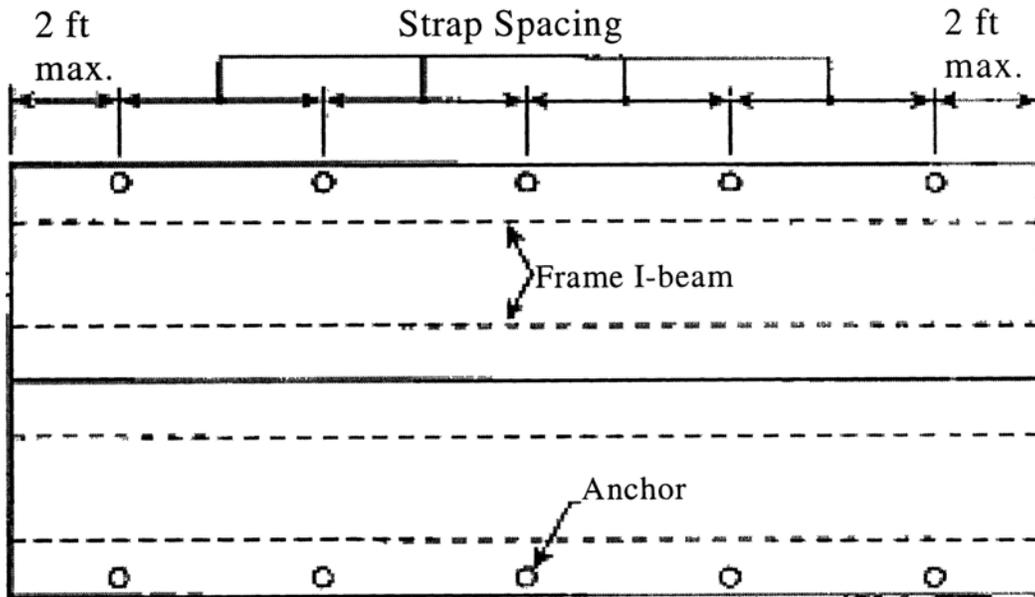

Notes to Figure A:

1. Refer to Tables 1, 2, and 3 to this section for maximum ground anchor spacing.
2. Longitudinal anchors not shown for clarity; refer to Subchapter E, Section II(B)(2) for longitudinal anchoring requirements.


**Figure B to Subchapter E, Section II – Ground Anchor Installation  
Anchor Strap and Pier Relationship**

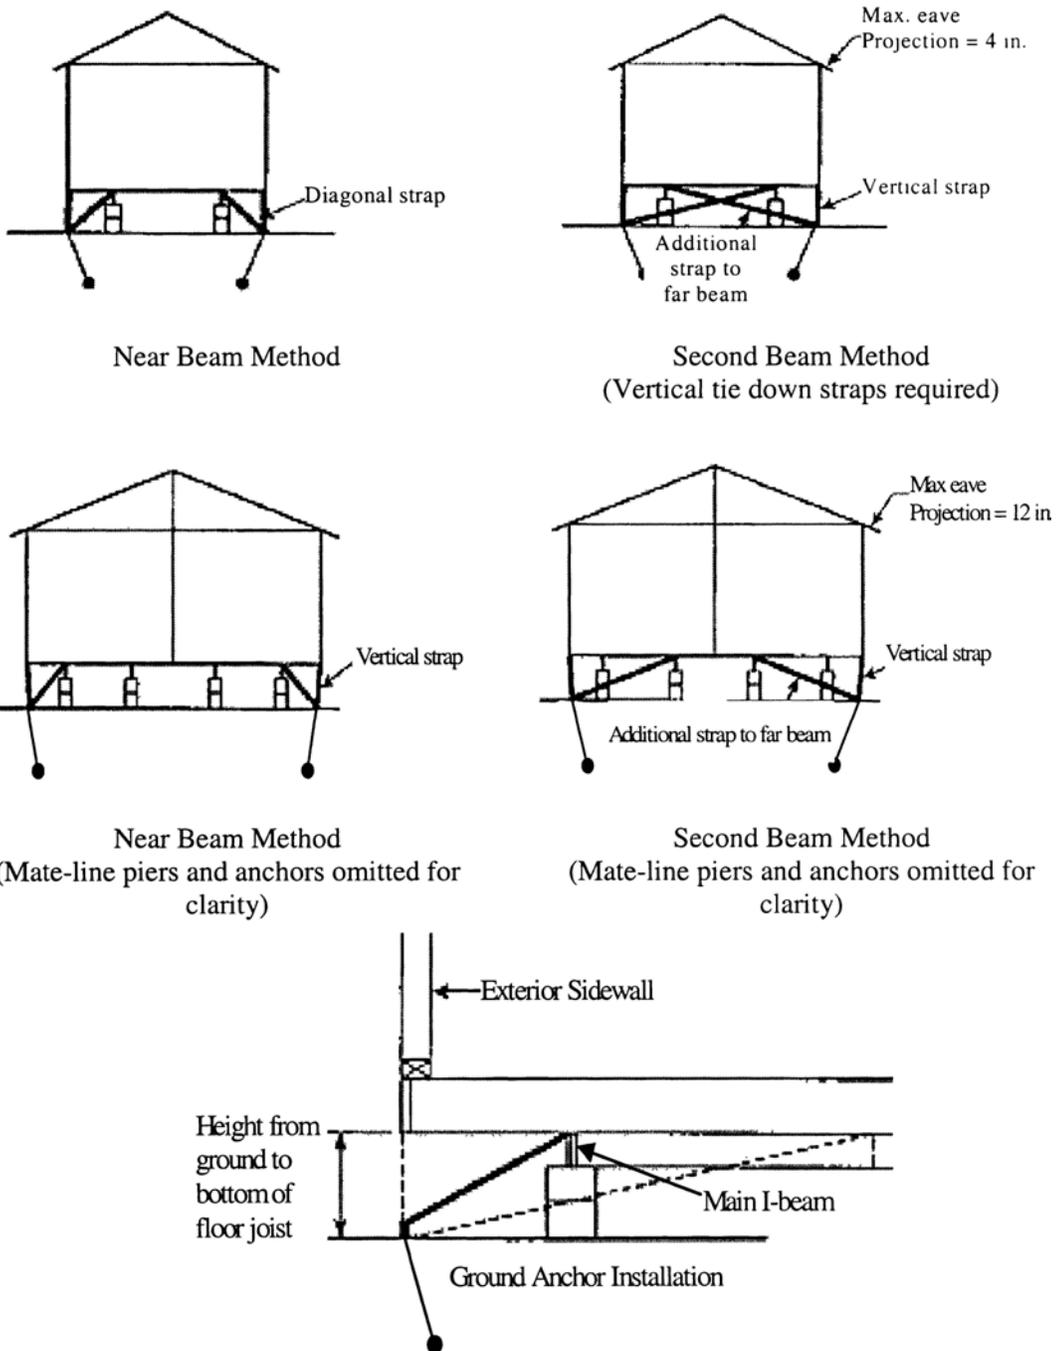

Notes to Figure B:

1. Vertical straps are not required in Wind Zone 1.
2. The frame must be designed to prevent rotation of the main chassis beam when the diagonal ties are not attached to the top flange of the beam. See Subchapter E, Section I(D)(3).

**Figure C to Subchapter E, Section II – Ground Anchor Installation  
Longitudinal Anchoring**

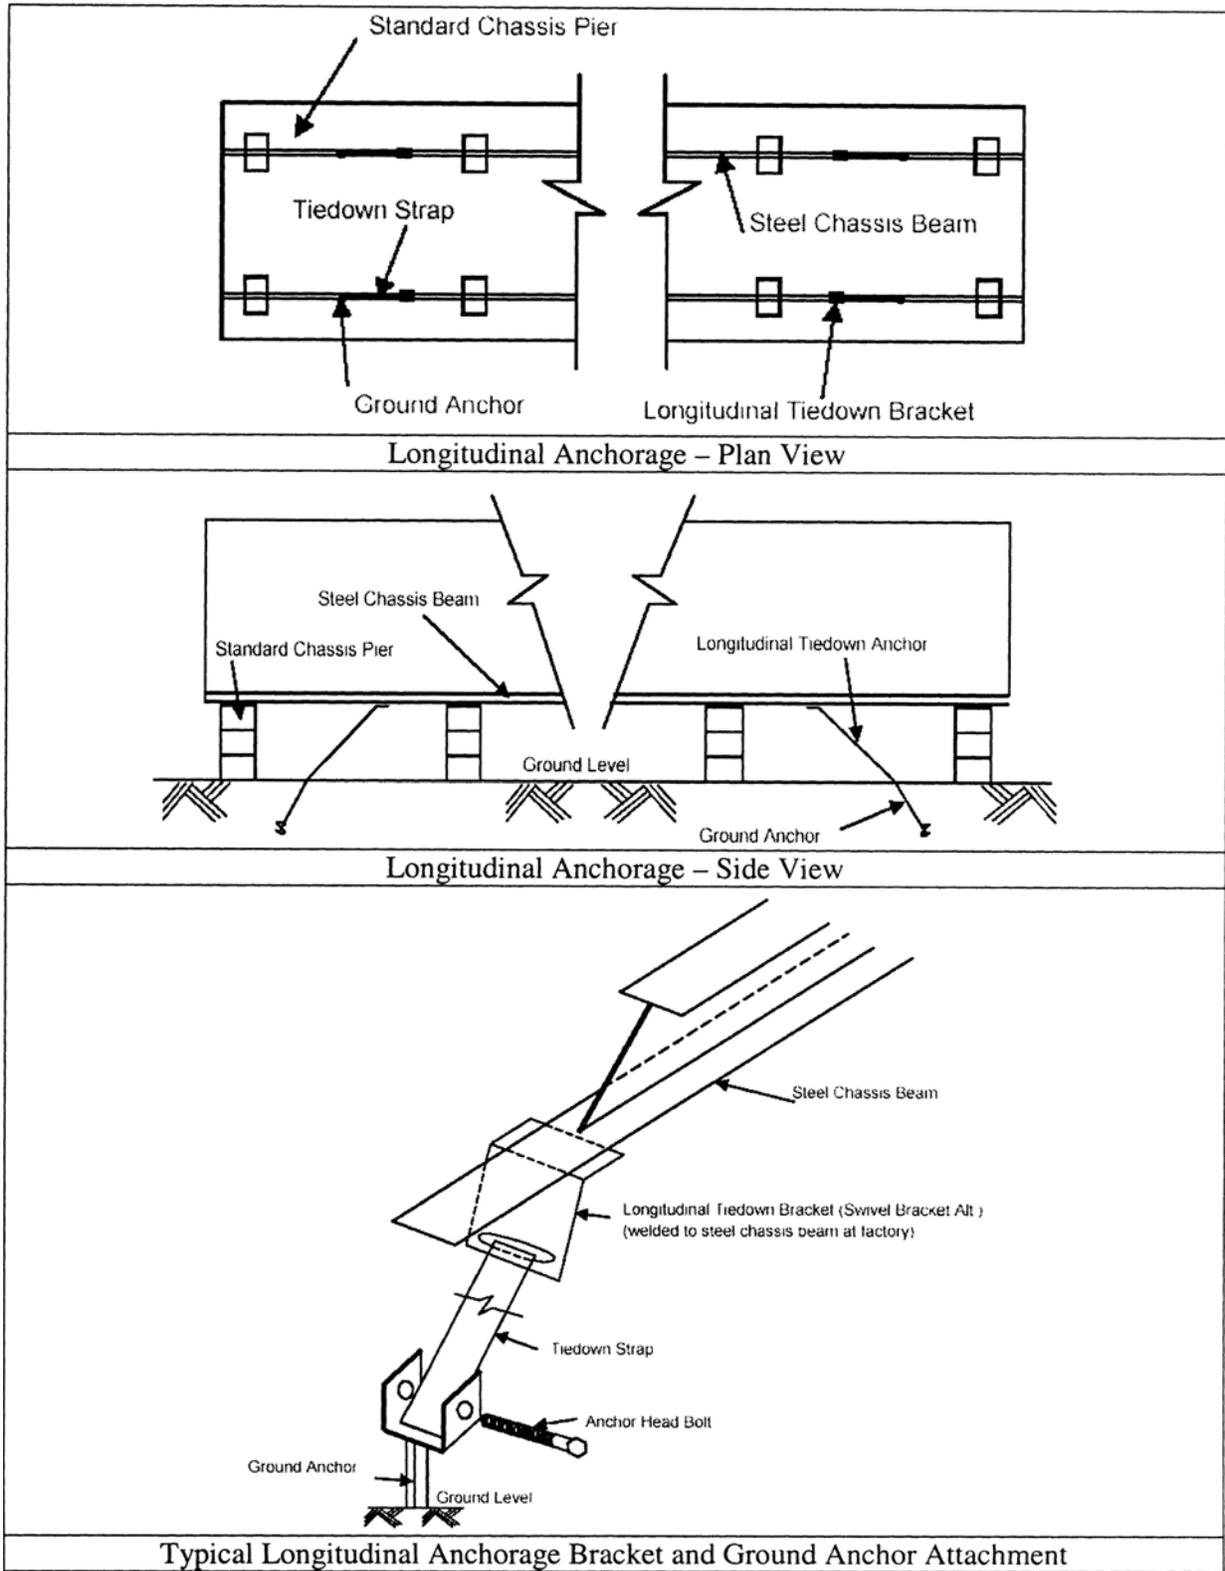

**Table 1 to Subchapter E, Section II – Ground Anchor Installation  
Maximum Diagonal Tie-down Strap Spacing  
Wind Zone I**

Nominal floor width, single section/multi-section	Max. height from ground to diagonal strap attachment	I-beam spacing 82.5 in.	I-beam spacing 99.5 in.
12/24 ft. 144 in. nominal section(s) .....	25 in ..... 33 in ..... 46 in ..... 67 in .....	14 ft. 2 in ..... 11 ft. 9 in ..... 9 ft. 1 in ..... N/A .....	N/A N/A N/A N/A
14/28 ft. 168 in. nominal section(s) .....	25 in ..... 33 in ..... 46 in ..... 67 in .....	18 ft. 2 in ..... 16 ft. 1 in ..... 13 ft. 3 in ..... 10 ft. 0 in .....	15 ft. 11 in 13 ft. 6 in. 10 ft. 8 in. N/A
16/32 ft. 180 in. to 192 in. nominal section(s) .....	25 in ..... 33 in ..... 46 in ..... 67 in .....	N/A ..... 19 ft. 0 in ..... 6 ft. 5 in ..... 13 ft. 1 in .....	19 ft. 5 in. 17 ft. 5 in. 14 ft. 7 in. 11 ft. 3 in.

Notes to Table 1:

1. Table is based on maximum 90 in. sidewall height.
2. Table is based on maximum 4 in. inset for ground anchor head from edge of floor or wall.
3. Table is based on main rail (I-beam) spacing per given column.
4. Table is based on maximum 4 in. eave width for single-section homes and maximum 12 in. for multi-section homes.
5. Table is based on maximum 20-degree roof pitch (4.3/12).
6. Table is based upon the minimum height between the ground and the bottom of the floor joist being 18 inches. Interpolation may be required for other heights from ground to strap attachment.
7. Additional tie-downs may be required per the home manufacturer instructions.
8. Ground anchors must be certified for these conditions by a professional engineer, architect, or listed by a nationally recognized testing laboratory.
9. Ground anchors must be installed to their full depth, and stabilizer plates, if required by the ground anchor listing or certification, must also be installed in accordance with the listing or certification and in accordance with the ground anchor and home manufacturer instructions.
10. Strapping and anchoring equipment must be certified by a registered professional engineer or registered architect, or listed by a nationally recognized testing agency to resist these specified forces, in accordance with testing in ASTM D 3953-97, Standard Specification for Strapping, Flat Steel and Seals (incorporated by reference).
11. A reduced ground anchor or strap working load capacity will require reduced tie-down strap and anchor spacing.
12. Ground anchors must not be spaced closer than the minimum spacing permitted by the listing or certification.
13. Table is based on a 3,150 lbs. working load capacity, and straps must be placed within 2 ft. of the ends of the home.
14. Table is based on a minimum angle of 30 degrees between the diagonal strap and the ground.
15. Table does not consider flood or seismic loads and is not intended for use in flood or seismic hazard areas. In those areas, the anchorage system is to be designed by a professional engineer or architect.

**Table 2 to Subchapter E, Section II – Ground Anchor Installation  
Maximum Diagonal Tie-down Strap Spacing  
Wind Zone II**

Nominal floor width, single section/multi-section	Max. height from ground to diagonal strap attachment	Near beam method I-beam spacing		Second beam method I-beam spacing	
		82.5 in.	99.5 in.	82.5 in.	99.5 in.
12 ft./24 ft. 144 in. nominal section(s).	25 in .....	5 ft. 1 in .....	N/A .....	N/A .....	N/A
	33 in .....	4 ft. 3 in .....	N/A .....	N/A .....	N/A
	46 in .....	N/A .....	N/A .....	N/A .....	N/A
	67 in .....	N/A .....	N/A .....	N/A .....	N/A
14 ft./28 ft. 168 in. nominal section(s).	25 in .....	6 ft. 2 in .....	5 ft. 7 in .....	N/A .....	N/A
	33 in .....	5 ft. 8 in .....	4 ft. 9 in .....	N/A .....	N/A
	46 in .....	4 ft. 8 in .....	N/A .....	N/A .....	N/A
	67 in .....	N/A .....	N/A .....	N/A .....	N/A
16 ft./32 ft. 180 in. to 192 in. nominal section(s).	25 in .....	N/A .....	6 ft. 3 in .....	N/A .....	N/A
	33 in .....	6 ft. 1 in .....	5 ft. 11 in .....	N/A .....	N/A
	46 in .....	5 ft. 7 in .....	5 ft. 0 in .....	N/A .....	N/A
	67 in .....	4 ft. 5 in .....	N/A .....	N/A .....	N/A

Notes to Table 2:

1. Table is based on maximum 90 in. sidewall height.
2. Table is based on maximum 4 in. inset for ground anchor head from edge of floor or wall.
3. Tables are based on main rail (I-beam) spacing per given column.
4. Table is based on maximum 4 in. eave width for single-section homes and maximum 12 in. for multi-section homes.
5. Table is based on maximum 20-degree roof pitch (4.3/12).
6. All manufactured homes designed to be located in Wind Zone II must have a vertical tie installed at each diagonal tie location.
7. Table is based upon the minimum height between the ground and the bottom of the floor joist being 18 inches. Interpolation may be required for other heights from ground to strap attachment.
8. Additional tie-downs may be required per the home manufacturer instructions.
9. Ground anchors must be certified for these conditions by a professional engineer, architect, or listed by a nationally recognized testing laboratory.
10. Ground anchors must be installed to their full depth, and stabilizer plates, if required by the ground anchor listing or certification, must also be installed in accordance with the listing or certification and in accordance with the ground anchor and home manufacturer instructions.
11. Strapping and anchoring equipment must be certified by a registered professional engineer or registered architect, or listed by a nationally recognized testing agency to resist these specified forces, in accordance with testing in ASTM D 3953-97, Standard Specification for Strapping, Flat Steel and Seals (incorporated by reference).
12. A reduced ground anchor or strap working load capacity will require reduced tie-down strap and anchor spacing.
13. Ground anchors must not be spaced closer than the minimum spacing permitted by the listing or certification.
14. Table is based on a 3,150 lbs. working load capacity, and straps must be placed within 2 ft. of the ends of the home.
15. Table is based on a minimum angle of 30 degrees between the diagonal strap and the ground.
16. Table does not consider flood or seismic loads and is not intended for use in flood or seismic hazard areas. In those areas, the anchorage system is to be designed by a professional engineer or architect.

**Table 3 to Subchapter E, Section II – Ground Anchor Installation  
Maximum Diagonal Tie-down Strap Spacing  
Wind Zone III**

Nominal floor width, single section/multi-section	Max. height from ground to diagonal strap attachment	Near beam method I-beam spacing		Second beam method I-beam spacing	
		82.5 in.	99.5 in.	82.5 in.	99.5 in.
12 ft/24 ft. 144 in. nominal section(s).	25 in .....	6 ft. 2 in .....	4 ft. 3 in .....	N/A .....	N/A
	33 in .....	5 ft. 2 in .....	N/A .....	N/A .....	N/A
	46 in .....	4 ft. 0 in .....	N/A .....	N/A .....	N/A
	67 in .....	N/A .....	N/A .....	6 ft 1 in .....	6 ft 3 in
14 ft/28 ft. 168 in. nominal section(s).	25 in .....	7 ft. 7 in .....	6 ft. 9 in .....	N/A .....	N/A
	33 in .....	6 ft. 10 in .....	5 ft. 9 in .....	N/A .....	N/A
	46 in .....	5 ft. 7 in .....	4 ft. 6 in .....	N/A .....	N/A
	67 in .....	4 ft. 3 in .....	N/A .....	N/A .....	N/A
16 ft/32 ft. 180 in. to 192 in. nominal section(s).	25 in .....	N/A .....	7 ft. 10 in .....	N/A .....	N/A
	33 in .....	7 ft. 6 in .....	7 ft. 2 in .....	N/A .....	N/A
	46 in .....	6 ft. 9 in .....	6 ft. 0 in .....	N/A .....	N/A
	67 in .....	5 ft. 4 in .....	4 ft. 7 in .....	N/A .....	N/A

Notes to Table 3:

1. Table is based on maximum 90 in. sidewall height.
2. Table is based on maximum 4 in. inset for ground anchor head from edge of floor or wall.
3. Tables are based on main rail (I-beam) spacing per given column.
4. Table is based on maximum 4 in. eave width for single-section homes and maximum 12 in. for multi-section homes.
5. Table is based on maximum 20-degree roof pitch (4.3/12).
6. All manufactured homes designed to be located in Wind Zone II must have a vertical tie installed at each diagonal tie location.
7. Table is based upon the minimum height between the ground and the bottom of the floor joist being 18 inches. Interpolation may be required for other heights from ground to strap attachment.
8. Additional tie-downs may be required per the home manufacturer instructions.
9. Ground anchors must be certified for these conditions by a professional engineer, architect, or listed by a nationally recognized testing laboratory.
10. Ground anchors must be installed to their full depth, and stabilizer plates, if required by the ground anchor listing or certification, must also be installed in accordance with the listing or certification and in accordance with the ground anchor and home manufacturer instructions.
11. Strapping and anchoring equipment must be certified by a registered professional engineer or registered architect, or listed by a nationally recognized testing agency to resist these specified forces, in accordance with testing in ASTM D 3953-97, Standard Specification for Strapping, Flat Steel and Seals (incorporated by reference).
12. A reduced ground anchor or strap working load capacity will require reduced tie-down strap and anchor spacing.
13. Ground anchors must not be spaced closer than the minimum spacing permitted by the listing or certification.
14. Table is based on a 3,150 lbs. working load capacity, and straps must be placed within 2 ft. of the ends of the home.
15. Table is based on a minimum angle of 30 degrees between the diagonal strap and the ground.
16. Table does not consider flood or seismic loads and is not intended for use in flood or seismic hazard areas. In those areas, the anchorage system is to be designed by a professional engineer or architect.

**III. Sidewall, Over-the-roof, Mate-line, and Shear Wall Straps**

If sidewall, over-the-roof, mate-line, or shear wall straps are installed on the home, they must be connected to an anchoring assembly.

**IV. Severe Climatic Conditions**

In frost-susceptible soil locations, ground anchor augers must be installed below the frost line, unless the foundation system is frost-protected to prevent the effects of frost heave, in

accordance with acceptable engineering practice, part 3280.306, and Subchapter D, Section XII.

V. Severe Wind Zones

When any part of a home is installed within 1,500 feet of a coastline in Wind Zones II or III, the manufactured home must be designed for the increased requirements as specified on the home's data plate (refer to part 3280.5(f)) in accordance with acceptable engineering practice. Where site or other conditions prohibit the use of the manufacturer's instructions, a registered professional engineer or registered architect in accordance with acceptable engineering practice, must design anchorage for the special wind conditions.

VI. Flood Hazard Areas

Refer to Subchapter D, Section II for anchoring requirements in flood hazard areas.

## **SUBCHAPTER F – OPTIONAL FEATURES**

I. Home Installation Manual Supplements

Supplemental instructions for optional equipment or features must be approved by the DAPIA as not taking the home out of conformance with the requirements of this subchapter or part 3280, and included with the manufacturer installation instructions.

II. Expanding Rooms

The support and anchoring systems for expanding rooms must be installed in accordance with designs provided by the home manufacturer or prepared by a registered professional engineer or registered architect, in accordance with acceptable engineering practice.

III. Optional Appliances

A. Comfort cooling systems

When not provided and installed by the home manufacturer, any comfort cooling systems that are installed must be installed according to the appliance manufacturer's installation instructions.

1. Air conditioners

Air conditioning equipment must be listed or certified by a nationally recognized testing agency for the application for which the unit is intended and installed in accordance with the terms of its listing or certification (see part 3280.714):

a. Energy efficiency

- (i) Site-installed central air conditioning equipment must be sized to meet the home's heat gain requirement in Chapter 28 of the 1997

ASHRAE Handbook of Fundamentals (incorporated by reference) or ACCA Manual J, Residential Cooling Load, 8<sup>th</sup> edition (incorporated by reference). Information necessary to calculate the home's heat gain can be found on the home's comfort cooling certificate.

- (ii) The BTU/hr. rated capacity of the site-installed air conditioning equipment must not exceed the air distribution system's rated BTU/hr. capacity as shown on the home's compliance certificate.

b. Circuit rating

If a manufactured home is factory provided with an exterior outlet to energize heating and/or air conditioning equipment, the branch circuit rating on the tag adjacent to this outlet must be equal to or greater than the minimum circuit amperage identified on the equipment rating plate.

c. A-coil units

- (i) A-coil air conditioning units must be compatible and listed for use with the furnace in the home and installed in accordance with the appliance manufacturer's instructions.
- (ii) The air conditioner manufacturer instructions must be followed.
- (iii) All condensation must be directed beyond the perimeter of the home by means specified by the equipment manufacturer.

2. Heat Pumps

Heat pumps must be listed or certified by a nationally recognized testing agency for the application for which the unit is intended and installed in accordance with the terms of its listing or certification (See part 3280.714).

3. Evaporative Coolers

- a. A roof-mounted cooler must be listed or certified by a nationally recognized testing agency for the application for which the unit is intended and installed in accordance with the terms of its listing (See part 3280.714):
  - (i) Any discharge grill must not be closer than three feet from a smoke alarm.
  - (ii) Before field installing a roof mounted evaporative cooler on-site, the installer must ensure that the roof will support the weight of the cooler.

(iii) A rigid base must be provided to distribute the cooler weight over multiple roof trusses to adequately support the weight of the evaporative cooler.

b. An evaporative cooler that is not roof-mounted is to be installed in accordance with the requirements of its listing or the equipment manufacturer's instructions, whichever is the more restrictive.

#### B. Fireplaces and Wood-Stoves

When not provided by the home manufacturer, fireplaces and wood-stoves including chimneys and air inlets for fireplaces and wood stoves must be listed for use with manufactured homes and must be installed in accordance with their listings.


#### C. Appliance Venting

1. All fuel burning heat producing appliances of the vented type except ranges and ovens must be vented to the exterior of the home.
2. Upon completion, the venting system must comply with all requirements of 3280.707(b) and 3280.710 of the Manufactured Home Construction and Safety Standards.
3. When the vent exhausts through the floor, the vent must not terminate under the home and must extend to the home's exterior and through any skirting that may be installed.

#### D. Clothes Dryer Exhaust Duct System

A clothes dryer exhaust duct system must conform with and be completed in accordance with the appliance manufacturer instructions and part 3280.708. The vents must exhaust to the exterior of the home, beyond any perimeter skirting installed around it, as shown in the Figure to Subchapter F, Section III.

### Figure to Subchapter F, Section III – Optional Appliances: Dryer Exhaust System

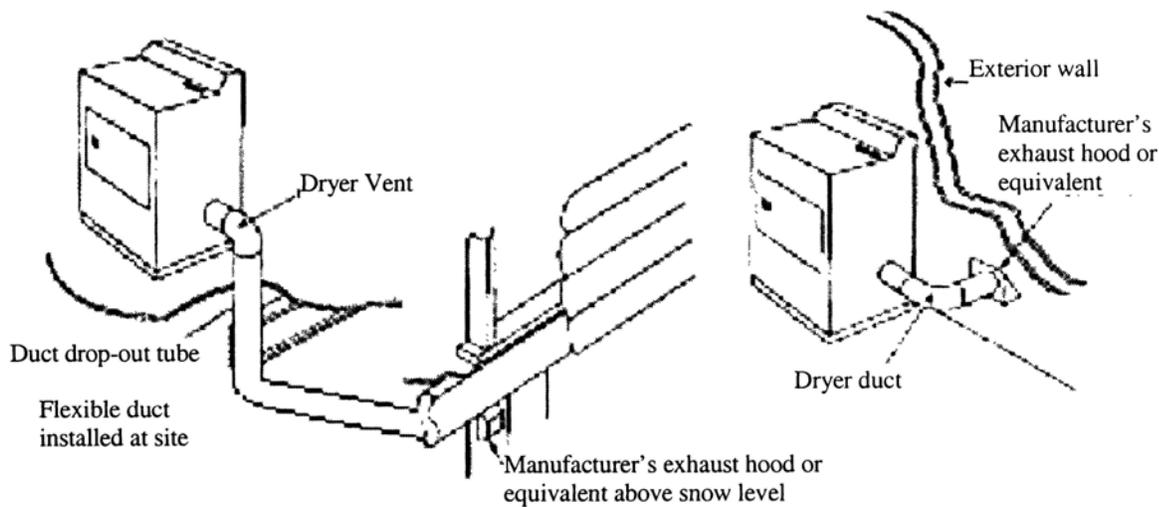

Notes to Figure:

1. Installation of the exhaust system must be in accordance with the dryer manufacturer instructions
2. Dryer exhaust system must not contain reverse slope or terminate under the home.

#### IV. Skirting

- A. Skirting, if used, must be of weather-resistant materials or provided with protection against weather deterioration at least equivalent to that provided by a coating of zinc on steel of not less than 0.30 oz./ft.<sup>2</sup> of surface coated.
- B. Skirting must not be attached in a manner that can cause water to be trapped between the siding and trim or forced up into the wall cavities trim to which it is attached.
- C. All wood skirting within 6 inches of the ground must be pressure-treated in accordance with AWP Standard U1 (incorporated by reference) for Use Category 4A, Ground Anchor Contact Applications, or be naturally resistant to decay and termite infestations.
- D. Skirting must not be attached in a manner that impedes the contraction and expansion characteristics of the home's exterior covering.

#### V. Crawlspace Ventilation

- A. A crawlspace with skirting must be provided with ventilation openings. The minimum net area of ventilation openings must not be less than one square foot (ft.<sup>2</sup>) for every 150 square feet (ft.<sup>2</sup>) of the home's floor area. The total area of ventilation openings may be reduced to one square foot (ft.<sup>2</sup>) for every 1,500 square feet (ft.<sup>2</sup>) of the home's floor area, where a uniform 6-mil polyethylene sheet material or other acceptable vapor retarder is installed according to Subchapter C, Section IV, on the ground surface beneath the entire floor area of the home.
- B. Ventilation openings must be placed as high as practicable above the ground.

- C. Openings must be located on at least two opposite sides to provide cross-ventilation.
- D. Ventilation openings must be covered for their full height and width with a perforated corrosion and weather-resistant covering that is designed to prevent the entry of rodents. In areas subject to freezing, the coverings for the ventilation openings must also be of the adjustable type, permitting them to be in the open or closed position, depending on the climatic conditions.
- E. Access opening(s) not less than 18 inches in width and 24 inches in height and not less than three square feet (ft.<sup>2</sup>) in area must be provided and must be located so that any utility connections under the home are accessible.
- F. Dryer vents and combustion air inlets must pass through the skirting to the outside. Any surface water runoff from the furnace, air conditioning, or water heater drains must be directed away from under the home or collected by other methods identified in Subchapter C, Section III.

## **SUBCHAPTER G – DUCTWORK AND PLUMBING AND FUEL SUPPLY SYSTEMS**

### **I. Field Assembly**

Home manufacturers must provide specific installation instructions for the proper field assembly of manufacturer-supplied and shipped loose ducts, plumbing, and fuel supply system parts that are necessary to join all sections of the home and are designed to be located underneath the home. The installation instructions must be designed in accordance with applicable requirements of part 3280, subchapters G and H, as specified in this subchapter.

### **II. Utility Connections**

Refer to Subchapter J for considerations for utility system connections.

### **III. Water Supply**

#### **A. Crossover**

Multi-section homes with plumbing in both sections require water-line crossover connections to join all sections of the home. The crossover design requirements are located in, and must be designed in accordance with part 3280.609.

#### **B. Maximum Supply Pressure and Reduction**

When the local water supply pressure exceeds 80 psi to the manufactured home, a pressure-reducing valve must be installed.

#### **C. Mandatory Shutoff Valve**

- 1. An identified and accessible shutoff valve must be installed between the water supply and the inlet.

2. The water riser for the shutoff value connection must be located underneath the home.
3. The shutoff valve must be a full-flow gate or ball valve, or equivalent valve.
4. Water riser pipes shall be a minimum  $\frac{3}{4}$  in. nominal diameter and extend a minimum of 6 in. above ground elevation. Surface water shall be diverted from the riser.

D. Wells as a Source of Supply

A well shall not be located within the boundaries of a manufactured home pad.

E. Freezing Protection

Water line crossovers completed during installation must be protected from freezing. The freeze protection design requirements are located in, and must be designed in accordance with the requirements of part 3280.603.

1. If subject to freezing temperatures, the water connection must be wrapped with insulation or otherwise protected to prevent freezing.
2. In areas subject to freezing or subfreezing temperatures, exposed sections of water supply piping, shutoff valves, pressure reducers, and pipes in water heater compartments must be insulated or otherwise protected from freezing.
3. Use of pipe heating cable

Only pipe heating cable listed for manufactured home use is permitted to be used, and it must be installed in accordance with the cable manufacturer installation instructions.

F. Testing Procedures

1. The water system must be inspected and tested for leaks after completion at the site. The installation instructions must provide testing requirements that are consistent with part 3280.612.
2. The water heater must be disconnected when using an air-only test.

IV. Drainage Systems

A. Crossovers

Multi-section homes with plumbing in more than one section require drainage system crossover connections to join all sections of the home. The crossover design requirements are located in, and must be designed in accordance with part 3280.610.

B. Assembly and Support

If portions of the drainage system were shipped loose because they were necessary to join all sections of the home and designed to be located underneath the home, they must be installed and supported in accordance with 3280.608.

C. Proper Slopes


Drains must be completed in accordance with 3280.610:

1. Drain lines must not slope less than one-quarter inch per foot, unless otherwise noted on the schematic diagram, as shown in the figure to Subchapter G, Section IV.
2. A slope of one-eighth inch per foot may be permitted when a clean-out is installed at the upper end of the run.

D. Testing Procedures

The drainage system must be inspected and tested for leaks after completion at the site. The installation instructions must provide testing requirements that are consistent with 3280.612.

**Figure to Subchapter G, Section IV – Drainage Systems  
Drain Pipe Slope and Connections**

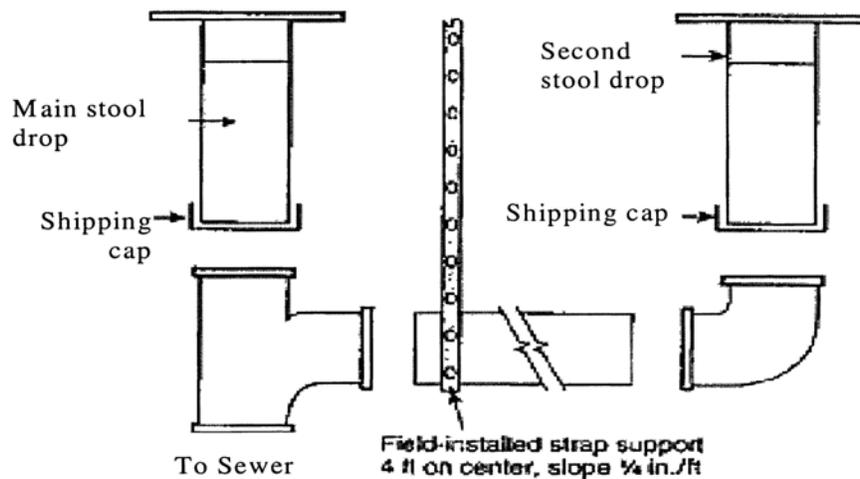

V. Fuel Supply System

A. Proper Supply Pressure

The gas piping system in the home is designed for a pressure that is at least 7 inches of water column [4 oz./in.<sup>2</sup> or 0.25 psi] and not more than 14 inches of water column [8 oz./in.<sup>2</sup> or 0.5 psi]. If gas from any supply source exceeds, or could exceed this pressure,

a regulator may be installed if required by the State of Maine Propane and Natural Gas Board.

B. Crossovers

1. Multi-section homes with fuel supply piping in both sections require crossover connections to join all sections of the home. The crossover design requirements are located in, and must be designed in accordance with 3280.705.
2. Tools must not be required to connect or remove the flexible connector quick-disconnect.


C. Testing Procedures

The gas system must be inspected and tested for leaks after the completion at the site. The installation instructions must provide testing requirements that are consistent with 3280.705.

VI. Ductwork Connections

- A. Multi-section homes with ductwork in more than one section require crossover connections to complete the duct system of the home. All ductwork connections, including duct collars, must be sealed to prevent air leakage. Galvanized metal straps or tape and mastics must be used around the duct collar and secured tightly to make all connections.
- B. If metal straps are used, they must be secured with galvanized sheet metal screws.
- C. Metal ducts must be fastened to the collar with a minimum of three galvanized sheet metal screws equally spaced around the collar.
- D. Air conditioning or heating ducts must be installed in accordance with applicable requirements of the duct manufacturer installation instructions.
- E. The duct must be suspended or supported above the ground by straps or other means that are spaced at a maximum distance not to exceed 4'0" or as otherwise permitted by the installation instructions. When straps are used to support a flexible type duct, the straps must be at least ½" wider than the spacing of the metal spirals encasing the duct. The ducts must be installed such that the straps cannot slip between any two spirals and arranged under the floor to prevent compression or kinking in any location, as shown in Figures A and B to this section. In-floor crossover ducts are permitted in accordance with Subchapter G, Section VI(G).
- F. Crossover ducts outside the thermal envelope must be insulated with materials that conform to designs consistent with part 3280, subchapter F.
- G. In-floor or ceiling crossover duct connections must be installed and sealed to prevent air leakage.


**Figure A to Subchapter G, Section VI – Ductwork Connections  
Crossover Duct Installation With Two Connecting Ducts**

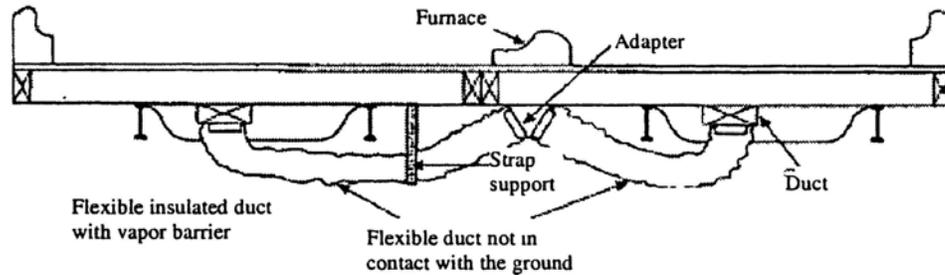

Notes to Figure A:

1. This system is typically used when a crossover duct has not been built into the floor and the furnace is outside the I-Beam. With this type of installation, it is necessary for two flexible ducts to be installed.
2. The crossover duct must be listed for exterior use.

**Figure B to Subchapter G, Section VI – Ductwork Connections  
Crossover Duct Installation with One Connecting Duct**

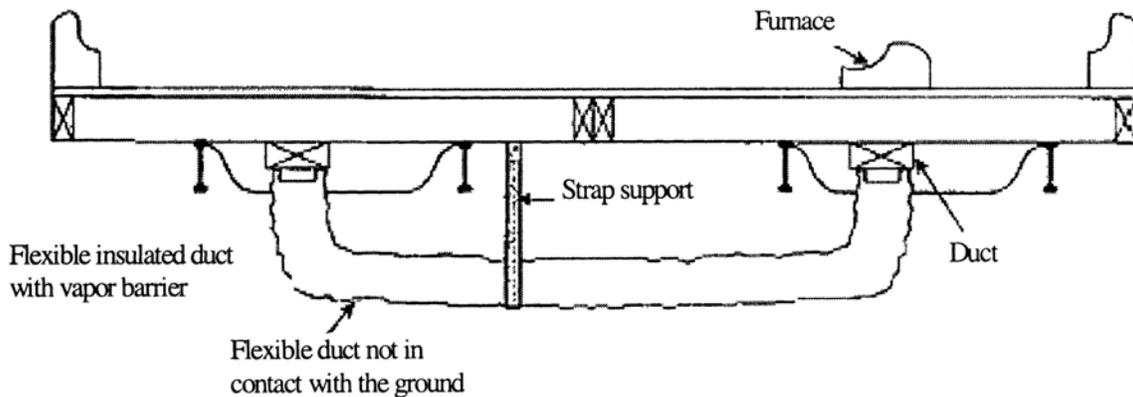

Notes to Figure B:

1. This system is typically used when a crossover duct has not been built into the floor and the furnace is situated directly over the main duct in one section of the home. A single flexible duct is then used to connect the two sections to each other.
2. The crossover duct must be listed for exterior use.

## **SUBCHAPTER H – ELECTRICAL SYSTEMS AND EQUIPMENT**

### **I. Electrical Crossovers**


Multi-section homes with electrical wiring in more than one section require crossover connections to join all sections of the home. The crossover must be designed in accordance with part 3280, subchapter I, and completed in accordance with the directions provided in the installation instructions.

### **II. Miscellaneous Lights and Fixtures**


- A. When the home is installed, exterior lighting fixtures, ceiling-suspended (paddle) fans, and chain-hung lighting fixtures are permitted to be installed in accordance with their listings and part 3280, subchapter I.
- B. Grounding
  - 1. All the exterior lighting fixtures and ceiling fans installed per Subchapter H Section II(A) must be grounded by a fixture-grounding device or by a fixture-grounding wire.
  - 2. For chain-hung lighting fixtures, as shown in Figure A to this section, both a fixture-grounding device and a fixture-grounding wire must be used. The identified conductor must be the neutral conductor.
- C. Where lighting fixtures are mounted on combustible surfaces such as hardboard, a limited combustible or noncombustible ring, as shown in Figures A and B to this section, must be installed to completely cover the combustible surface exposed between the fixture canopy and the wiring outlet box.
- D. Exterior Lights
  - 1. The junction box covers must be removed and wire-to-wire connections must be made using listed wire connectors.
  - 2. Wires must be connected black-to-black, white-to-white, and equipment ground-to-equipment ground.
  - 3. The wires must be pushed into the box, and the lighting fixture must be secured to the junction box.
  - 4. The lighting fixture must be caulked around its base to ensure a watertight seal to the sidewall.
  - 5. The light bulb must be installed and the globe must be attached.
- E. Ceiling Fans
  - 1. Ceiling-suspended (paddle) fans must be connected to the junction box listed and marked for ceiling fan application, in accordance with Article 314.27(b) of the National Electrical Code, NFPA 70-2005 (incorporated by reference);
  - 2. The ceiling fan must be installed with the trailing edges of the blades at least 6 feet 4 inches above the finished floor; and
  - 3. The wiring must be connected in accordance with the product manufacturer installation instructions.
- F. Testing

1. After completion of all electrical wiring and connections, including crossovers, electrical lights, and ceiling fans, the electrical system must be inspected and tested at the site, in accordance with the testing requirements of 3280.810(b).
2. The installation instructions must indicate that each manufactured home must be subjected to the following tests:
  - a. An electrical continuity test to ensure that metallic parts are effectively bonded;
  - b. Operational tests of all devices and utilization equipment, except water heaters, electric ranges, electric furnaces, dishwashers, clothes washers/dryers, and portable appliances, to demonstrate that they are connected and in working order; and
  - c. For electrical equipment installed or completed during installation, electrical polarity checks must be completed to determine that connections have been made properly. Visual verification is an acceptable electrical polarity check.

**Figure A to Subchapter H, Section II – Miscellaneous Lights and Fixtures  
Typical Installation of Chain-Hung Lighting Fixture**

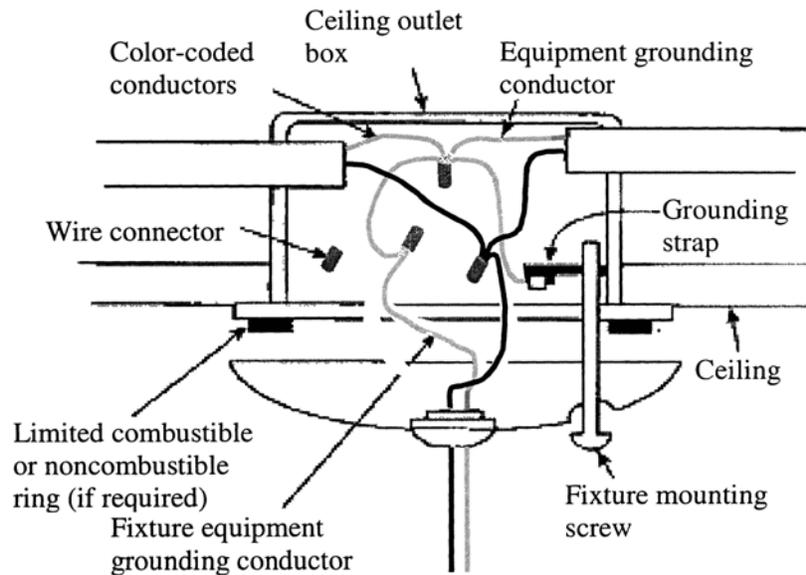

**Figure B to Subchapter H, Section II – Miscellaneous Lights and Fixtures  
Typical Installation of Surface-Mounted Exterior Lighting Fixture**

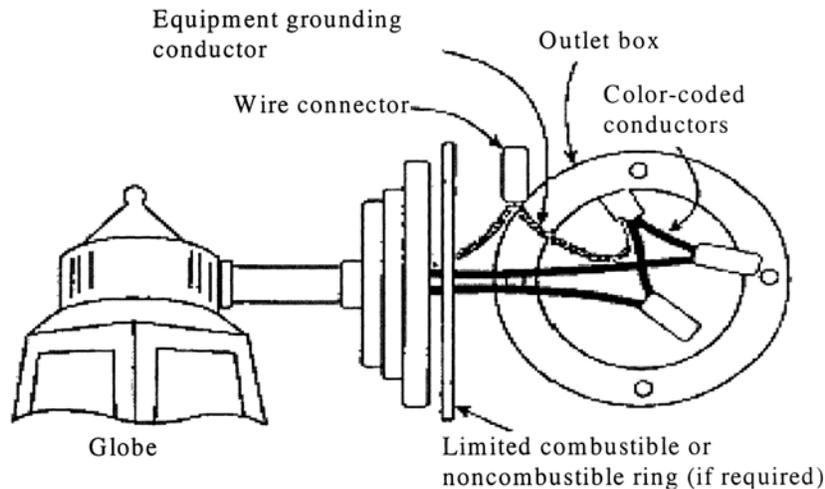

### III. Smoke Alarms

Smoke alarms must be functionally tested in accordance with applicable requirements of the smoke alarm manufacturer instructions and must be consistent with 3280.208.

## SUBCHAPTER I – EXTERIOR AND INTERIOR CLOSE-UP

### I. Exterior Close-up

- A. Exterior siding and roofing necessary to join all sections of the home must be installed according to the product manufacturer installation instructions and must be fastened in accordance with designs and manufacturer installation instructions consistent, with 3280.305 and 3280.307. Exterior close-up strips/trim must be fastened securely and sealed with exterior sealant. (Refer to Figure A to this Section.)
- B. Joints and Seams
 

All joints and seams in exterior wall coverings that were disturbed during location of the home must be made weatherproof.
- C. Prior to installing the siding, the polyethylene sheeting covering exterior walls for transit must be completely removed.
- D. Prior to completing the exterior close-up, any holes in the roofing must be made weatherproof and sealed with a sealant or other material that is suitable for use with the roofing in which the hole is made.
- E. Mate-line Gasket


The home manufacturer must provide materials and designs for mate-line gaskets or other methods designed to resist the entry of air, water, water vapor, insects, and rodents at all mate-line locations exposed to the exterior (See Figure B to this Section.)

#### F. Hinged Roofs and Eaves

Hinged roofs and eaves must be completed during installation in compliance with all requirements of the Manufactured Home Construction and Safety Standards (24 CFR part 3280) and the Manufactured Home Procedural and Enforcement Regulations (24 CFR part 3282). Unless exempted by the following provisions, hinged roofs are also subject to a final inspection for compliance with the Manufactured Home Construction and Safety Standards (24 CFR part 3280) by the IPIA or a qualified independent inspector acceptable to the IPIA. Homes with hinged roofs that are exempted from IPIA inspection are instead to be completed and inspected in accordance with the Manufactured Home Installation Program (24 CFR part 3286). This includes homes:


1. That are designed to be located in Wind Zone I;
2. In which the pitch of the hinged roof is less 7:12; and
3. In which fuel burning appliance flue penetrations are not above the hinge.

**Figure A to Subchapter I, Section I – Exterior Close-up  
Installation of Field-Applied Horizontal Lap Siding**

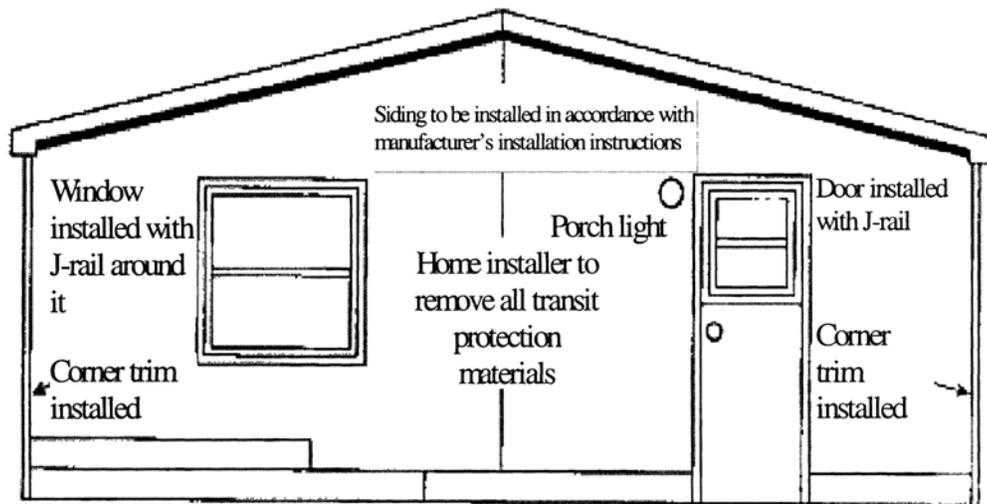

#### Notes to Figure A:

1. Multi-section homes with horizontal-lap siding can be shipped with no siding on the front and rear end walls.
2. The manufacturer must install doors/windows trimmed with J-rail or the equivalent and protect all exposed materials not designed for exposure with plastic sheeting for transport. Siding, starter trim, and vents may be shipped loose in the home for installation on set-up.
3. All home installers must ensure that all field installed trim, windows, doors, and other openings are properly sealed according to the siding manufacturer installation instructions.

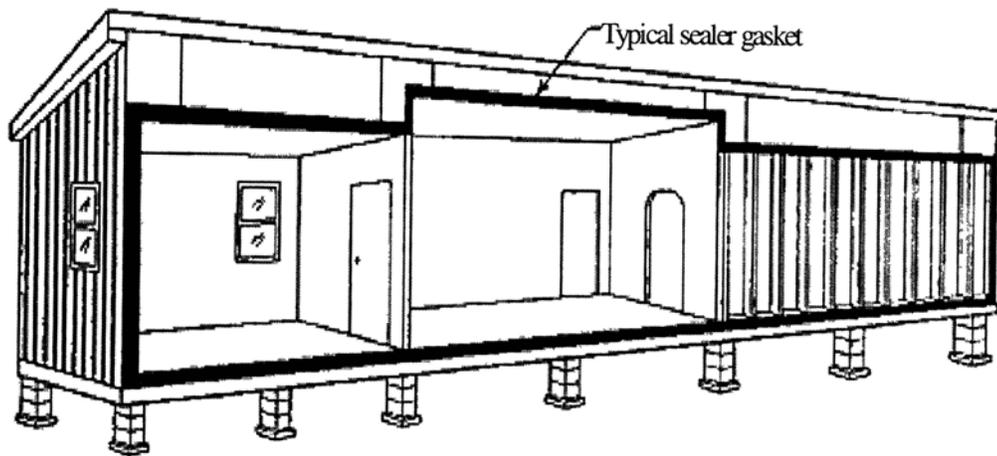**Figure B to Subchapter I, Section I – Exterior Close-up**

Note to Figure B:

On multi-section manufactured homes, install the sealer gasket on the ceiling, end walls, and floor mate-line prior to joining the sections together.

## II. Structural Interconnection of Multi-Section Homes


- A. For multi-section homes, structural interconnections along the interior and exterior at the mate-line are necessary to join all sections of the home.
- B. Structural interconnection must be designed in accordance with the requirements located in 3280.305 to ensure a completely integrated structure.
- C. Upon completion of the exterior close-up, no gaps are permitted between the structural elements being interconnected along the mate-line of multi-section homes. However, prior to completion of the exterior close-up, gaps that do not exceed one inch are permitted between structural elements provided:
  1. The gaps are closed before completion of the close-up;
  2. The home sections are in contact with each other; and
  3. The mate-line gasket is providing a proper seal. All such gaps must be shimmed with dimensional lumber, and fastener lengths used to make connections between the structural elements must be increased to provide adequate penetration into the receiving member.

## III. Interior Close-up

- A. All shipping blocking, strapping, or bracing must be removed from appliances, windows, and doors.
- B. Interior close-up items necessary to join all sections of the home or items subject to transportation damage may be packaged or shipped with the home for site installation.

- C. Shipped-loose wall paneling, necessary for the joining of all sections of the home must be installed by using polyvinyl acetate (PVA) adhesive on all framing members and fastened with minimum 1 ½ inch long staples or nails at 6 inches on center panel edges and 12 inches on center in the field unless, alternative fastening methods are permitted in the installation instructions (See the Figure to Section III.)

**Figure to Subchapter I, Section III – Interior Close-up  
Installation of Interior Field-Applied Panels**

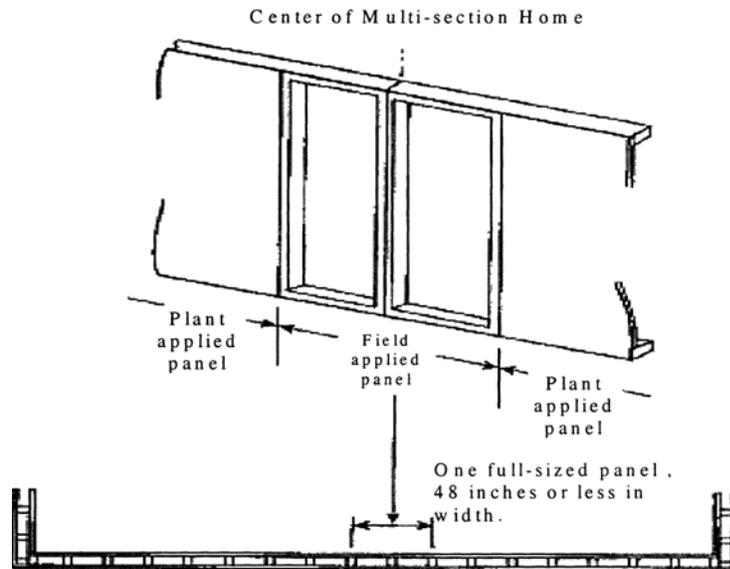

Note to Figure:

Specific designs must be approved by a DAPIA and included in the home manufacturer installation instructions.

#### IV. Bottom Board Repair

- A. The bottom board covering must be inspected for any loosening or areas that might have been damaged or torn during installation or transportation. Any missing insulation is to be replaced prior to closure and repair of the bottom board.
- B. Any splits or tears in the bottom board must be resealed with tape or patches in accordance with methods provided in the manufacturer's installation instructions.
- C. Plumbing P-traps must be checked to be sure they are well-insulated and covered.
- D. All edges of repaired areas must be taped or otherwise sealed.

### SUBCHAPTER J – ADDITIONAL REQUIREMENTS

#### I. General

A. Exemption

Manufactured homes, which are installed in compliance with this standard, are exempt from all state or political subdivision codes, standards or regulations covering the same matters. Other matters are under the authority of the LAHJ.

B. Alterations to the home by a licensed installer are prohibited.

C. Installation of On-site Structures

Onsite structures attached to the home shall be installed according to the home manufacturer's installation instructions or be designed and approved by a registered engineer or registered architect.

Onsite structures which support their own live load and dead loads and are not attached to the home are not covered by this standard and come under the authority of the LAHJ.

D. The home must be installed and leveled by a licensed installer.

E. The home shall be leveled so that all doors and windows operate as intended and plumbing drains function in a safe and sanitary manner.


II. Drainage

A. Drainage parts shall be installed only by a licensed installer or a plumber licensed by the Plumbers' Examining Board.

B. All drainage parts shipped loose with the home shall be installed according to the manufacturer's instructions.

C. All other drainage shall be installed in compliance with the Maine State Internal Plumbing Code as adopted by the Plumbers' Examining Board.

D. The main drain line shall be connected to the site's sewer hook-up using an elastomeric coupling, acceptable under the Maine State Internal Plumbing Code adopted by the Plumbers' Examining Board, as shown in the Figure to this Section:

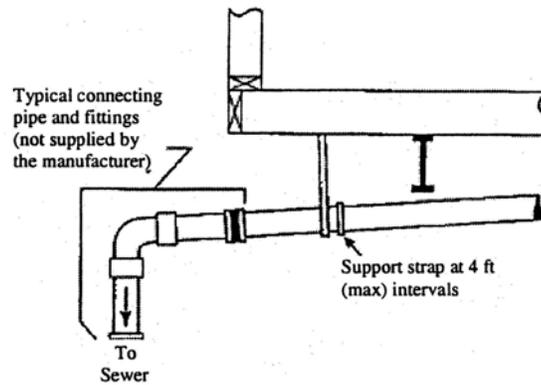**Figure to Subchapter J, Section II – Connection to Site Sewer****III. Gas Systems**

- A. Licensed installers are prohibited from performing any gas system work.
- B. A technician licensed by the Propane and Natural Gas Board shall:
  1. Assemble factory supplied loose shipped gas system parts
  2. Convert an appliance from one gas type to another
  3. Connect to on-site supply systems and tanks
  4. Install propane tank or tanks and system components.
- C. A technician licensed by the Propane and Natural Gas Board shall:
  1. Inspect all equipment shut-off valves
  2. Light pilot lights when provided
  3. Adjust burners and spark igniters
  4. Inspect all line connections, vent connections and roof jacks
  5. Install a natural gas or propane fired appliance in a home
- D. All gas system work shall be performed in compliance with NFPA 54, National Fuel Gas Code, NFPA 58, LP Gas Code and other appropriate rules and codes as adopted by the Propane and Natural Gas Board.

**IV. Fuel Oil Systems**

- A. Licensed installers may install, in compliance with manufacturer's instructions, loose shipped fuel oil appliance items.

- B. All other fuel oil system work, not described in the manufacturer’s instructions, including oil supply tanks and fuel oil piping, shall be performed only by a licensed limited tank installer or other technician licensed by the Oil and Solid Fuel Board.
- C. All fuel oil system work, not described in the manufacturer’s instructions, shall be done in compliance with NFPA 31, Installation of Oil Burning Equipment and Chapter 9, Installation of Oil Burning Equipment and other appropriate rules and codes as adopted by the Oil and Solid Fuel Board.

V. Electrical

- A. Licensed installers may:
  - 1. Install, in compliance with the manufacturer’s instructions, electrical equipment shipped loose with the home.
  - 2. Connect the main panel to an existing service disconnect.
- B. All other electrical work, not described in the manufacturer’s instructions, shall be performed by a electrician licensed by the Electricians’ Examining Board.
- C. All other electrical work, not described in the manufacturer’s instructions, shall be done in compliance with NFPA 70, the National Electrical Code.

APPENDIX A: ROOF LOAD, WIND AND INSTALLATION ZONES

I. Roof Load Zones

A. 40 psf Roof Load Zones

The following counties are deemed to be within the 40 psf roof load zone: Washington, Hancock, Aroostook, Somerset, Waldo, Franklin, Penobscot, Oxford and Piscataquis.

B. 30 psf Roof Load Zones

The following counties are deemed to be within the 30 pound roof zone: York, Cumberland, Kennebec, Sagadahoc, Knox, Lincoln, and Androscoggin.

II. Wind Zones

A. Wind Zone I

The following counties are deemed to be within Wind Zone I: Aroostook, Somerset, Waldo, Franklin, Penobscot, Oxford, Piscataquis, York, Cumberland, Kennebec, Sagadahoc, Knox, Lincoln, and Androscoggin.

B. Wind Zone II...100 mph

The following counties are deemed to be within Wind Zone II: Hancock and Washington.

III. Installation Zones

A. Sites prepared in Washington, Hancock, Aroostook, Somerset, Waldo, Franklin, Penobscot, Oxford and Piscataquis counties require 24 inches of compacted fill.

B. Sites prepared in York, Cumberland, Kennebec, Sagadahoc, Knox, Lincoln, and Androscoggin counties require 18 inches of compacted fill.

## 02 DEPARTMENT OF PROFESSIONAL AND FINANCIAL REGULATION

## 385 MANUFACTURED HOUSING BOARD

CHAPTER 900 USED MANUFACTURED HOME INSTALLATION STANDARDS -  
INSTALLATION

SUMMARY: Establishes standards for the installation of used manufactured mobile homes, ~~to meet the requirements of resolve 26 of 1989~~. The rules define installation as the process of affixing or assembling or setting up manufactured housing on foundations or supports at a building site, and includes the connection of existing electrical, oil burner, gas, water, sewage and similar systems.

## SUBPART 1

## 1-1 SCOPE AND INTENT OF STANDARD, ORGANIZATION OF STANDARD, AND DEFINITIONS

SCOPE: This standard covers the installation of used manufactured homes, wherever located.

1-2 INTENDED USAGE OF USED MANUFACTURED HOMES COVERED UNDER THIS STANDARD. The provisions of this standard are intended to apply to used manufactured homes (single section, multiple section or expanded types) for use as a single family dwelling. The following homes are included:

Note 1: ~~the~~This standard does not apply to manufactured housing used for other than dwelling purposes.

Note 2: ~~The provisions of this~~ This standard ~~shall~~ does not apply to recreational vehicles as defined in ~~the~~ NFPA 501C1192, Standard for Recreational Vehicles, or to park model trailers as defined in the ANSI A119.5, Standards for Park Trailers.

## 1-2.1 TYPES OF STRUCTURE COVERED

(a) Used Manufactured Homes. The used manufactured homes covered under this Standard are as follows:

- (1) Those units constructed after June 15, 1976, which the manufacturer certifies are constructed in compliance with the HUD standard, meaning structures, transportable in one or more sections,

which in the traveling mode, are 8 body feet or more in width and 40 body feet or more in length or, when erected on site, are 320 or more square feet, and which are built on a permanent chassis and designed to be used as dwellings, with or without permanent foundations, when connected to the required utilities, including plumbing, heating, air conditioning and electrical systems contained therein; except that such term shall include any structure which meets all the requirements of this paragraph except the size requirements and with respect to which the manufacturer voluntarily files a certification required by the Secretary of the United States Department of Housing and Urban Development and complies with the standards established under the National Manufactured Housing Construction and Safety Standards Act of 1974.

- (2) Those units constructed prior to June 15, 1976, meaning mobile homes, transportable in one or more sections, which are built on a permanent chassis and designed to be used as dwellings, with or without permanent foundations when connected to the required utilities, including the plumbing, heating, air-conditioning or electrical systems contained therein.

## 1-2.2 APPLICABILITY

This standard is applicable only for ~~new or used mobile~~ manufactured homes and is not intended for modular or other types of manufactured dwellings. The standard is designed for the safety and health of ~~mobile~~ manufactured home users. It is intended to apply to all ~~used mobile~~ manufactured homes. Where this standard provides useful technical data for improvements to existing sites falling within its scope and such is encouraged. However, mobile home park pads which are now licensed and all homes currently installed on private lots and may not comply with all design and construction standards of these rules, shall be deemed acceptable if capable of being maintained and operated in a safe and sanitary condition. This standard shall not be construed as relieving the installers of a used manufactured home of responsibility for compliance with the manufacturer's installation instructions, state and local ordinances, codes, and regulations. This standard does not relieve the manufactured home owner or occupant from responsibilities for the proper use and maintenance of a used manufactured home.

### 1-3 DEFINITIONS

**ANCHORING EQUIPMENT (TIES).** Straps, cables, turnbuckles, and chains, including tensioning devices, which are used to secure a manufactured home.

**ANCHORING SYSTEM.** A method of construction which when properly designed and installed will resist overturning and lateral movement of the manufactured home.

~~APPROVED. Acceptable to the Board.~~

~~NOTE: THE BOARD DOES NOT APPROVE OR CERTIFY ANY INSTALLATION, PROCEDURES, EQUIPMENT, OR MATERIAL, NOR APPROVE OR EVALUATE TESTING LABORATORIES. IN DETERMINING THE ACCEPTABILITY OF INSTALLATION OR PROCEDURES, EQUIPMENT OR MATERIALS, THE BOARD'S ACCEPTANCE MAY BE BASED ON A SITE INSPECTION BY BOARD PERSONNEL OR AGENTS OF THE BOARD. THE BOARD REFERS TO THE LISTING OR LABELING PRACTICES TO AN ORGANIZATION CONCERNED WITH PRODUCT EVALUATIONS WHICH IS IN A POSITION TO DETERMINE COMPLIANCE WITH APPROPRIATE STANDARDS FOR THE CURRENT PRODUCTION OF LISTED ITEMS.~~

**DIAGONAL TIE.** A tie intended to primarily resist horizontal or shear forces and which may secondarily resist vertical, uplift, and overturning forces.

**FOUNDATION, MANUFACTURED HOME.** A site-built or site assembled system of stabilizing devices which is:

- (a) Capable of transferring design dead loads and live loads ~~required by Federal Regulations~~ and other design loads unique to local home sites due to wind, seismic, and water conditions, that are imposed by or upon the structure into the underlying soil bedrock without failure.

**GROUND ANCHOR.** A device at the manufactured home ~~stand~~ pad designed to transfer manufactured home anchoring loads to the ground.

**HURRICANE-RESISTIVE MANUFACTURED HOME.** A manufactured home which meets the wind design load requirements for Zone II in Subpart D, Section 3280.305(c)(2) of the Federal Standard or the applicable hurricane-resistive design requirements of the Standard for Mobile Homes, NFPA 501B/ ANSIA119.1 edition in effect at the time of manufacture.

**INSTALLER.** Any licensed dealer or an employee of a licensed dealer, or a person licensed as a mechanic † who engages in the process of affixing or assembling or setting up of manufactured housing on foundations or supports at a building site.

**INSTALLATION.** The process of affixing or assembling or setting up manufactured housing on foundation or supports at the building site.

~~Mechanic~~ **MECHANIC.** For the purposes of these rules, any licensed individual who engages in the process of installing manufactured housing. Meaning the process of affixing or assembling or setting up a home on foundations or supports at the building site.

**PAD.** That area which has been established for the placement of a manufactured home.

**PIER.** That portion of the support system between the footing and the manufactured home, exclusive of caps and shims.

**SET-UP.** The work performed and operations involved in the placement and securing of a manufactured home or any portion thereof.

**SHALL.** Indicates a mandatory requirement.

**SHOULD.** Indicates a recommendation or that which is advised but not required.

**SITE.** A. designated parcel of land designed for the accommodation of one manufactured home, its accessory buildings or structures, and accessory equipment for the exclusive use of the occupants.

**SKIRTING.** A weather-resistant material to enclose the space from the bottom of the manufactured home to grade.

**STABILIZING DEVICES.** All components of the anchoring and support systems such as piers, footings, ties, anchoring equipment, ground anchors, or any other materials and methods of construction which supports and secures the manufactured home to the ground.

~~**STAND.** That area of a manufactured home site which has been reserved for the placement of a manufactured home.~~

**SUPPORT SYSTEM.** A combination of footings, piers, caps, and shims that will, when properly installed, support the manufactured home.

~~**TIE.** See anchoring equipment.~~

**UNCONTROLLED FILL.** Uncontrolled fills are fill materials that are placed without control of the content of the fill materials or without adequate compaction to assure a bearing capacity without undue settlement. For purposes of this STANDARD, uncontrolled fills shall mean fill materials containing organic matter or fills which are placed without compaction necessary to provide a uniform bearing capacity of 1000 lbs./ft.

**VERTICAL TIE.** A tie intended to resist the uplifting and overturning forces.

## SUBPART 2 SITING AND FOUNDATION SYSTEMS

### 2.1 Siting and Foundation Systems

#### 2-1.1 GENERAL

This chapter prescribes standards for siting, design and installation of manufactured home foundation systems. It identifies acceptable foundations systems. This chapter is applicable to ~~all new and~~ relocated manufactured homes, when and wherever newly installed at a home site. Homes which are designated 30 PSF snow zone in the manufacturer's data plate shall not be installed in 40 PSF roof load zones designated in Appendix B. Homes designated 20 PSF snow zone in the manufacturer's data plate shall not be installed in the State of Maine. Homes which are designated 15 PSF wind zone on the manufacturer's data plate shall not be installed in a 25 PSF wind load zone as identified in Appendix B.

#### 2-1.2

A MANUFACTURED HOME FOUNDATION SYSTEM shall be constructed on each manufactured home site.

#### EXCEPTION:

1. Sites which have been licensed by the Manufactured Housing Board in accordance with rules governing the licensing of mobile home parks prior to ~~the adoption of this Installation Standard.~~ March 1, 1993.
2. Sites for the installation of manufactured housing to provide temporary relief from fire, flood or other disasters. The site is exempted from the provisions of Chapter 2 for a period of two years from the date of the installation of the home.

#### 2-1.3

A Manufactured Home Foundation System for used manufactured homes shall be constructed in accordance with one of the following;

- (a) the manufacturer's installation instructions,
- (b) by Appendix C of the Installation Standard
- (c) a foundation design prepared by a Registered professional engineer or architect for the site.

#### 2-1.4

Homes installed on sites exempted from the requirement of 2-1.2 shall be installed and the sites maintained in a manner which is not detrimental to the functions of any of the systems in the home. Homes which require perimeter blocking shall be blocked at locations required by the manufacturer of the home.

## 2-2 SITE CONSIDERATIONS.

### 2-2.1 GENERAL

#### 2-2.1.2 EVALUATION.

Each site shall be evaluated by the person assuming responsibility to determine if it is suitable for its intended use and if such hazards as flood erosion, sediment deposition, or other hazards exist that might impair the use or utility of the site. When, during preparation of the site, such unforeseen factors as rock formation, high groundwater levels, springs, biologically generated gases, etc., are encountered, corrective works shall be taken to siting of the manufactured home.

#### 2-2.1.3

**PROTECTIVE SLOPES OF UNPAVED AREAS AROUND MANUFACTURED HOME STANDS PADS.** Grades shall slope away from ~~stands pads~~, from walls, skirting, and foundations, and from water supply wells to adequate outfalls or to drainage swales discharging to adequate outfalls.

## 2-3 Soil Considerations

### 2-3.1

FOOTINGS. It shall be determined when natural soils or controlled fill (free of grass and organic material) are used, that the footing shall support the loads imposed by the support system of the manufactured home placed thereon.

## 2-3.2.

### ANCHORING

#### 2-3.2.1

ANCHOR DESIGN AND INSTALLATION. Homes installed on sites in ~~the 25 PSF wind zone as identified in Appendix B of this standard~~ Washington and Hancock counties and which are occupied by other than the home owner shall be installed with an anchoring system properly designed and constructed to resist sliding and overturning of the home.

## 2-4 PLACEMENT

### 2-4.1

#### Clearances.

##### 2-4.1.1

Clearance Under Home. A minimum clearance of 12 in. shall be maintained beneath the lowest member of the main frame (I-beam or channel beam).

##### 2-4.1.2

Elevated Manufactured Homes. When the manufactured home is installed on a basement or split entry type foundation over a habitable lower-level area, or when more than one-fourth of the area of the manufactured home is installed so that the bottom of the main frame members are more than 3 ft. above ground level, the foundation system shall be designed by a registered professional engineer or architect. Appendix C can not be used for any elevated installation or in combination with the manufacturers instructions.

##### 2-4.1.3

Removal of Manufactured Home Transportation Components at the Time of Installation. No portion of a manufactured home shall be removed when located on its home site unless it is designed to be removed in accordance with HUD's and the manufacturer's instruction.

## 2-5.1 VENTILATION

### 2-5.1.1 Access to and Ventilation of Underfloor Areas.

- (a) Provisions shall be made to minimize condensation in underfloor areas through ventilation openings or other suitable means.
- (b) If combustion air for heat appliance(s) is taken from within the underfloor areas, ventilation shall be adequate to assure proper operation of the appliance(s). ~~This requirement shall take precedence over the provisions of 2-6-2.1 (a).~~
- (c) A minimum of four ventilation openings shall be provided from the underfloor space to the exterior. One shall be placed at or near each corner as high as practicable. Their total net free area shall be calculated by:
  - 1.  $a = A/150$  or
  - 2.  $a = A/600$  if the home is installed on a concrete slab or with a ground cover in accordance with 2-6.2.4. where:

A = the area of the crawl space, square feet

A· = the total net free vent area

Openings shall provide cross ventilation on at least two opposite sides. The openings shall be covered with corrosion resistant wire mesh not less than 1/8 in. and not more than 1/2 in. in any dimension or with openings designed to retard entry of dry vegetation, waste material, or rodents.

### 2-6.2.2.

Intake air for ventilation purposes shall not be drawn from underfloor spaces of the home.

#### 2-6.2.3.

Moisture producing devices, such as dryers, shall be vented to the atmosphere in such a manner to insure that moisture laden air is carried beyond the perimeter of the home.

#### 2-6.2.4

Under floor Continuous Ground Cover/Vapor Retarder.

If a ground cover is required, a uniform 4 to 6 mil. polyethylene sheet material or other acceptable membrane materials shall be installed for this purpose.

#### 2-6.2.5

Skirting

- (a) Materials. Skirting, if used, shall be of durable materials suitable for exterior exposures.

General installation.

Skirting, if used, shall be installed in accordance with the manufacturer's installation instructions. It shall be secured, as necessary, to assure stability, to minimize vibrations, to minimize susceptibility to wind damage, and to compensate for possible frost heaves. Access opening(s) not less than 18 in any dimension and not less than 3 sq. ft. in area shall be provided and shall be located so that any water supply and sewer drain connections located under the manufactured home are accessible for inspection. Such access panel(s) or door(s) shall not be fastened in a manner requiring the use of a special tool to remove or open same. On-site fabrication of skirting shall meet the objectives cited herein.

### SUBPART 3 PLUMBING

#### 3-1 General Requirements

NOTE: Where this standard differs from the State of Maine [Internal Plumbing Code](#), the standard adopted by the State of Maine shall prevail.

##### 3-1.1

Need for Plumbing and Utility Connections. Each manufactured home ~~stand~~ pad shall be provided with water supply and sewer located and arranged to permit attachment to the manufactured home in a workmanlike manner.

### 3-1.2

Location of Plumbing Utility Connections. The plumbing utility connection shall be located under the mobile home ~~stand~~ pad.

## 3-2 Water Supply.

### 3-2.1

Water-Riser Pipes, Size, and Protection. Water-riser pipes shall be a minimum of 3/4 in. nominal diameter. Water-riser pipes shall extend a minimum of 6 in. above ground elevation. Water riser pipes shall be terminated with a threaded plug, hose bib, or cap when a manufactured home does not occupy a site. Surface drainage shall be diverted from the location of the riser pipe.

#### 3-2.1.1.

Water Supply Shutoff Valves. An accessible shutoff valve shall be provided on the water-riser pipe serving the manufactured home. The system shall be protected from backflow for single family residences on shared wells.

#### 3-2.1.2.

Protection Against Freezing. Provision shall be made to protect the water supply piping and valves, including the riser.

- (a) Frost-proof valves shall be installed where necessary and shall be listed for backflow protection.
- (b) In areas subject to heaving and thawing, the piping shall be adequately protected to prevent damage.
- (c) Heat cables and tapes, when used for protection of plumbing components against freezing, shall be listed and labeled.
- (d) Installed in accordance with manufacturer's ~~directions~~ instructions and listing requirements.

### 3-3 Wells as a Source of Supply.

#### 3-3.1

Location of Wells. A well shall not be located within the boundaries of a manufactured home ~~stand~~ pad.

## SUBPART 4 MECHANICAL EQUIPMENT (HEATING and COOLING)

### 4-1 Exterior Mechanical Equipment.

4-1.1 Mechanical Equipment shall not be installed in a manner that would obstruct any means of required egress. Mechanical equipment shall not be installed in window openings which are part of an exiting system and shall not obstruct sidewalks or other means of egress from the home.

## SUBPART 5 FUEL SUPPLY

### 5-1

General. All fuel piping systems serving manufactured homes, which are not part of the manufactured home shall be designed and constructed in compliance with all applicable local, ~~state and Federal~~ and state codes.

## SUBPART 6 ELECTRICAL

### 6-1

Site Electrical Equipment and Installations. Sites provided with an electrical service shall have all electrical equipment and installations designed and constructed, and maintained in accordance with the applicable provisions of NFPA 70, National Electrical Code.

## SUBPART 7 LIFE AND FIRE SAFETY

### 7-1

~~For life and fire safety requirements, see NFPA 501A, Standard for Fire Safety Criteria for Manufactured Home Installation, Sites and Communities (1987) and NFPA 101, Life Safety Code (1988).~~

No portion of a manufactured home, excluding the hitch, shall be located closer than 10 feet (3 meters) side to side, 8 feet (2.4 meters) end to side, or 6 feet (1.8 meters) end to end horizontally from any other manufactured home or community building unless the exposed composite walls and roof of either structure are without openings and constructed of materials that

will provide a 1 hour fire-resistance rating or the structures are separated by a 1 hour fire-rated barrier.

## APPENDIX A PREVENTIVE MAINTENANCE- [Reserved]

### ~~Use and Preventive Maintenance of Manufactured Home Installations~~

~~This Appendix is not part of the requirements of this document, but is included for information purposes only.~~

#### ~~A-1 Responsibilities of the Manufactured Home Resident.~~

~~A-1.1 The resident should comply with all applicable requirements of this standard and should maintain his manufactured home site, its facilities, and its equipment in good repair and in a fire safe condition.~~

#### ~~A-2 Storage Practices Beneath Manufactured Homes~~

~~A-2.1 Periodic inspections of the enclosed space are recommended to assure that all utility and other connections are secured and no fire hazards exist~~

~~A-2.2 Homeowner should keep site free of an accumulation of combustible materials such as rubbish, paper, leaves, and brush~~

## APPENDIX B WIND ZONE and ROOF LOAD ZONE

MUNICIPALITY	ROOF LOAD	WIND LOAD	INSTALLATION ZONE
ABBOT	40	15	NORTHERN
ACTON	30	25	COASTAL
ADDISON	40	25	COASTAL
ALBION	30	25	COASTAL
ALEXANDER	40	25	COASTAL
ALFRED	30	25	COASTAL
ALLAGASH	40	15	NORTHERN
ALNA	30	25	COASTAL
ALTON	40	15	NORTHERN
AMHERST	40	25	COASTAL
AMITY	40	15	NORTHERN
ANDOVER	30	15	NORTHERN
ANSON	30	15	NORTHERN
APPLETON	30	25	COASTAL
ARROWSIC	30	25	COASTAL
ARUNDEL	30	25	COASTAL
ASHLAND	40	15	NORTHERN
ATHENS	30	15	NORTHERN
ATKINSON	40	15	NORTHERN
AUBURN	30	15	NORTHERN
AUGUSTA	30	15	NORTHERN
AURORA	40	25	COASTAL
AVON	30	15	NORTHERN
BAILEYVILLE	40	25	COASTAL
BALDWIN	30	25	COASTAL
BANCROFT	40	15	NORTHERN
BANGOR	40	25	COASTAL
BAR HARBOR	40	25	COASTAL
BARING PLAN.	40	25	COASTAL
BATH	30	25	COASTAL
BEALS	40	25	COASTAL
BEAVER COVE	40	15	NORTHERN
BEDDINGTON	40	25	COASTAL
BELFAST	40	25	COASTAL
BELGRADE	30	15	NORTHERN
BELMONT	30	25	COASTAL
BENTON	30	15	NORTHERN
BERWICK	30	25	COASTAL
BETHEL	30	15	NORTHERN
BIDDEFORD	30	25	COASTAL

BINGHAM	30	15	NORTHERN
BLAINE	40	15	NORTHERN
BLUE HILL	40	25	COASTAL
BOOTHBAY	30	25	COASTAL
BOOTHBAY HAR.	30	25	COASTAL
BOWDOIN	30	25	COASTAL
BOWDOINHAM	30	25	COASTAL
BOWERBANK	40	15	NORTHERN
BRADFORD	40	15	NORTHERN
BRADLEY	40	15	NORTHERN
BREMEN	30	25	COASTAL
BREWER	40	25	COASTAL
BRIDGEWATER	40	15	NORTHERN
BRIDGTON	30	25	COASTAL
BRIGHTON PLAN.	30	25	COASTAL
BRISTOL	30	25	COASTAL
BROOKLIN	40	25	COASTAL
BROOKS	30	25	COASTAL
BROOKSVILLE	40	25	COASTAL
BROWNFIELD	30	15	NORTHERN
BROWNVILLE	40	15	NORTHERN
BRUNSWICK	30	25	COASTAL
BUCKFIELD	30	15	NORTHERN
BUCKSPORT	40	25	COASTAL
BURLINGTON	40	15	NORTHERN
BURNHAM	30	15	NORTHERN
BUXTON	30	25	COASTAL
BYRON	30	15	NORTHERN
CALAIS	40	25	COASTAL
CAMBRIDGE	40	15	NORTHERN
CAMDEN	30	25	COASTAL
CANAAN	30	15	NORTHERN
CANTON	30	15	NORTHERN
CAPE ELIZABETH	30	25	COASTAL
CARATUNK	40	15	NORTHERN
CARIBOU	40	15	NORTHERN
CARMEL	40	15	NORTHERN
CARRABASSETT V.	30	15	NORTHERN
CARROLL PLAN.	40	15	NORTHERN
CARTHAGE	30	15	COASTAL
CARY PLAN.	40	15	NORTHERN
CASCO	30	25	COASTAL
CASTINE	40	25	COASTAL
CASTLE HILL	40	15	NORTHERN
CASWELL	40	15	NORTHERN
CENTERVILLE	40	25	COASTAL

CHAPMAN	40	15	NORTHERN
CHARLESTON	40	15	NORTHERN
CHARLOTTE	40	25	COASTAL
CHELSEA	30	25	COASTAL
CHERRYFIELD	40	25	COASTAL
CHESTER	40	15	COASTAL
CHESTERVILLE	30	15	NORTHERN
CHINA	30	25	COASTAL
CLIFTON	40	25	COASTAL
CLINTON	30	15	NORTHERN
CODYVILLE	40	15	NORTHERN
COLUMBIA	40	25	COASTAL
COLUMBIA FALLS	40	25	COASTAL
COOPER	40	25	COASTAL
COPLIN PLAN.	30	15	NORTHERN
CORINNA	40	15	NORTHERN
CORINTH	40	15	NORTHERN
CORNISH	30	25	COASTAL
CORNVILLE	30	15	NORTHERN
CRANBERRY ISLES	40	25	COASTAL
CRAWFORD	40	25	COASTAL
CRYSTAL	40	15	NORTHERN
CUMBERLAND	30	25	COASTAL
CUSHING	30	25	COASTAL
CUTLER	40	25	COASTAL
CYR PLAN.	40	15	NORTHERN
DALLAS PLAN.	30	15	NORTHERN
DAMARISCOTTA	30	25	COASTAL
DANFORTH	40	15	NORTHERN
DAYTON	30	25	COASTAL
DEBLOIS	40	25	COASTAL
DEDHAM	40	25	COASTAL
DEER ISLE	40	25	COASTAL
DENMARK	30	15	NORTHERN
DENNISTOWN PL.	40	15	NORTHERN
DENNYSVILLE	40	25	COASTAL
DETROIT	40	15	NORTHERN
DEXTER	40	15	NORTHERN
DIXFIELD	30	15	NORTHERN
DIXMONT	40	25	COASTAL
DOVER-FOXCROFT	40	15	NORTHERN
DRESDEN	30	25	COASTAL
DREW PLAN.	40	15	NORTHERN
DURHAM	30	25	COASTAL
DYER BROOK	40	15	NORTHERN
EAGLE LAKE	40	15	NORTHERN

EAST MACHIAS	40	25	COASTAL
E. MILLINOCKET	40	15	NORTHERN
EASTBROOK	40	25	COASTAL
EASTON	40	15	NORTHERN
EASTPORT	40	25	COASTAL
EDDINGTON	40	25	COASTAL
EDGECOMB	30	25	COASTAL
EDINBURG	40	15	NORTHERN
ELIOT	30	25	COASTAL
ELLSWORTH	40	25	COASTAL
EMBDEN	30	15	NORTHERN
ENFIELD	40	15	NORTHERN
ETNA	40	15	NORTHERN
EUSTIS	30	15	NORTHERN
EXETER	40	15	NORTHERN
FAIRFIELD	30	15	NORTHERN
FALMOUTH	30	25	COASTAL
FARMINGDALE	30	15	NORTHERN
FARMINGTON	30	15	NORTHERN
FAYETTE	30	15	NORTHERN
FORT FAIRFIELD	40	15	NORTHERN
FORT KENT	40	15	NORTHERN
FRANKFORT	40	25	COASTAL
FRANLIN	40	25	COASTAL
FREEDOM	30	25	COASTAL
FREEPORT	30	25	COASTAL
FRENCHBORO	40	25	COASTAL
FRENCHVILLE	40	15	NORTHERN
FRIENDSHIP	30	25	COASTAL
FRYEBURG	30	15	NORTHERN
GARDINER	30	25	COASTAL
GARFIELD PLAN.	40	15	NORTHERN
GARLAND	40	15	NORTHERN
GEORGETOWN	30	25	COASTAL
GILEAD	30	15	NORTHERN
GLENBURN	40	15	NORTHERN
GLENWOOD PLAN.	40	15	NORTHERN
GORHAM	30	25	COASTAL
GOULDSBORO	40	25	COASTAL
GRANDISLE	40	15	NORTHERN
GRAND LAKE STREAM PL.	40	15	NORTHERN
GRAY	30	25	COASTAL
GREAT POND	40	15	NORTHERN
GREENBUSH	40	15	NORTHERN
GREENE	30	15	NORTHERN
GREENFIELD	40	15	NORTHERN

GREENVILLE	40	15	NORTHERN
GREENWOOD	30	15	NORTHERN
GUILFORD	40	15	NORTHERN
HALLOWELL	30	15	NORTHERN
HAMLIN	40	15	NORTHERN
HAMMOND	40	15	NORTHERN
HAMPDEN	40	25	COASTAL
HANCOCK	40	25	COASTAL
HANOVER	30	15	COASTAL
HARMONY	40	15	NORTHERN
HARPSWELL	30	25	COASTAL
HARRINGTON	40	25	COASTAL
HARRISON	30	25	COASTAL
HARTFORD	30	15	NORTHERN
HARTLAND	30	15	NORTHERN
HAYNESVILLE	40	15	NORTHERN
HEBRON	30	15	NORTHERN
HERMON	40	15	NORTHERN
HERSEY	40	15	NORTHERN
HIGHLAND PLAN.	30	15	NORTHERN
HIRAM	30	15	NORTHERN
HODGDON	40	15	NORTHERN
HOLDEN	40	25	COASTAL
HOLLIS	30	25	COASTAL
HOPE	30	25	COASTAL
HOULTON	40	15	NORTHERN
HOWLAND	40	15	NORTHERN
HUDSON	40	15	NORTHERN
INDUSTRY	30	15	NORTHERN
ISLAND FALLS	40	15	NORTHERN
ISLE AU HAUT	40	25	COASTAL
ISLEBORO	40	25	COASTAL
JACKMAN	40	15	NORTHERN
JACKSON	40	25	COASTAL
JAY	30	15	NORTHERN
JEFFERSON	30	25	COASTAL
JONESBORO	40	25	COASTAL
JONESPORT	40	25	COASTAL
KENDUSKEAG	40	15	NORTHERN
KENNEBUNK	30	25	COASTAL
KENNEBUNKPORT	30	25	COASTAL
KINGFIELD	30	15	NORTHERN
KINGSBURY PLAN.	40	15	NORTHERN
KITTERY	30	25	COASTAL
KNOX	30	25	COASTAL
LAGRANGE	40	15	NORTHERN

LAKEVIEW PLAN.	40	15	NORTHERN
LAKEVIEW	40	15	NORTHERN
LAMOINE	40	25	COASTAL
LEBANON	30	25	COASTAL
LEE	40	15	NORTHERN
LEEDS	30	15	NORTHERN
LEVANT	40	15	NORTHERN
LEWISTON	30	15	NORTHERN
LIBERTY	30	25	COASTAL
LIMERICK	30	25	COASTAL
LIMESTONE	40	15	NORTHERN
LIMINGTON	30	25	COASTAL
LINCOLN	40	15	NORTHERN
LINCOLN PLAN.	30	15	NORTHERN
LINCOLNVILLE	30	25	COASTAL
LINNEUS	40	15	NORTHERN
LISBON	30	25	COASTAL
LITCHFIELD	30	25	COASTAL
LITTLETON	40	15	NORTHERN
LIVERMORE	30	15	NORTHERN
LIVERMORE FALLS	30	15	NORTHERN
LOVELL	30	15	NORTHERN
LOWELL	40	15	NORTHERN
LUBEC	40	25	COASTAL
LUDLOW	40	15	NORTHERN
LYMAN	30	25	COASTAL
MACHIAS	40	25	COASTAL
MACHAISPORT	40	25	COASTAL
MACWAHOC PLAN.	40	15	NORTHERN
MADAWASKA	40	15	NORTHERN
MADISON	30	15	NORTHERN
MADRID	30	15	NORTHERN
MAGALLOWAY PL.	30	15	NORTHERN
MANCHESTER	30	15	NORTHERN
MAPLETON	40	15	NORTHERN
MARIAVILLE	40	25	COASTAL
MARS HILL	40	15	NORTHERN
MARSHFIELD	40	25	COASTAL
MASARDIS	40	15	NORTHERN
MATINICUS ILE PL.	40	25	COASTAL
MATTAWAMKEAG	40	15	NORTHERN
MAXFIELD	40	15	NORTHERN
MECHANIC FALLS	30	15	NORTHERN
MEDDYBEMPS	40	25	COASTAL
MEDFORD	40	15	NORTHERN
MEDWAY	40	15	NORTHERN

MERCER	30	15	NORTHERN
MERRILL	40	15	NORTHERN
MEXICO	30	15	NORTHERN
MILLBRIDGE	40	25	COASTAL
MILFORD	40	15	NORTHERN
MILLINOCKET	40	15	NORTHERN
MILO	40	15	NORTHERN
MINOT	30	15	NORTHERN
MONHEGAN PLAN.	30	25	COASTAL
MONMOUTH	30	25	COASTAL
MONROE	40	25	COASTAL
MONSON	40	15	NORTHERN
MONTICELLO	40	15	NORTHERN
MONTVILLE	30	25	COASTAL
MOOSE RIVER	40	15	NORTHERN
MORO PLAN.	40	15	NORTHERN
MORRILL	30	25	COASTAL
MOSCOW	40	15	NORTHERN
MOUNT CHASE	40	15	NORTHERN
MOUNT DESERT	40	25	COASTAL
MOUNT VERNON	30	15	NORTHERN
NAPLES	30	15	NORTHERN
NASHVILLE PLAN.	40	15	NORTHERN
NEW CANADA	40	15	NORTHERN
NEW GLOUCESTER	30	25	COASTAL
NEW LIMERICK	40	15	NORTHERN
NEW PORTLAND	30	15	NORTHERN
NEW SHARON	30	15	NORTHERN
NEW SWEDEN	40	15	NORTHERN
NEW VINEYARD	30	15	NORTHERN
NEWBURGH	40	25	COASTAL
NEWCASTLE	30	25	COASTAL
NEWFIELD	30	25	COASTAL
NEWPORT	30	15	NORTHERN
NEWRY	30	15	NORTHERN
NOBLEBORO	30	25	COASTAL
NORRIDGEWOCK	30	15	NORTHERN
NORTH BERWICK	30	25	COASTAL
NORTH HAVEN	30	25	COASTAL
NORTH YARMOUTH	30	25	COASTAL
NORTHFIELD	40	25	COASTAL
NORTHPORT	40	25	COASTAL
NORWAY	30	15	NORTHERN
OAKFIELD	40	15	NORTHERN
OAKLAND	30	15	NORTHERN
OGUNQUIT	30	25	COASTAL

OLD ORCHARD	30	25	COASTAL
OLD TOWN	40	15	NORTHERN
ORIENT	40	15	NORTHERN
ORLAND	40	25	COASTAL
ORONO	40	15	NORTHERN
ORRINGTON	40	25	COASTAL
OSBORN	40	25	COASTAL
OTIS	40	25	COASTAL
OTISFIELD	30	15	NORTHERN
OWL'S HEAD	30	25	COASTAL
OXBOW PLAN.	40	15	NORTHERN
OXFORD	30	15	NORTHERN
PALERMO	30	25	COASTAL
PALMYRA	40	15	NORTHERN
PARIS	30	15	NORTHERN
PARKMAN	40	15	NORTHERN
PARSONFIELD	30	25	COASTAL
PASSADUMKEAG	40	15	NORTHERN
PATTEN	40	15	NORTHERN
PEMBROKE	40	25	COASTAL
PENOBSCOT	40	25	COASTAL
PERHAM	40	15	NORTHERN
PERRY	40	25	COASTAL
PERU	30	15	NORTHERN
PHILLIPS	30	15	NORTHERN
PHIPPSBURG	30	25	COASTAL
PITTSFIELD	30	15	NORTHERN
PITTSTON	30	25	COASTAL
PLSNT RIDGE PL.	30	15	COASTAL
PLYMOUTH	40	15	NORTHERN
POLAND	30	15	NORTHERN
PORTAGE LAKE	40	15	NORTHERN
PORTER	30	15	NORTHERN
PORTLAND	30	25	COASTAL
POWNAL	30	25	COASTAL
PRESQUE ISLE	40	15	NORTHERN
PRINCETON	40	15	NORTHERN
PROSPECT	30	25	COASTAL
RANDOLPH	30	25	COASTAL
RANGELEY	30	15	NORTHERN
RANGELEY PLAN.	30	15	NORTHERN
RAYMOND	30	25	COASTAL
READFIELD	30	15	NORTHERN
REED PLANTATION	40	15	COASTAL
RICHMOND	30	25	COASTAL
RIPLEY	40	15	NORTHERN

ROBBINSTON	40	25	COASTAL
ROCKLAND	30	25	COASTAL
ROCKPORT	30	25	COASTAL
ROME	30	15	NORTHERN
ROQUE BLUFFS	40	25	COASTAL
ROXBURY	30	15	NORTHERN
RUMFORD	30	15	NORTHERN
SABATTUS	30	25	COASTAL
SACO	30	25	COASTAL
ST. AGATHA	40	15	NORTHERN
ST. ALBANS	40	15	NORTHERN
ST. FRANCIS	40	15	NORTHERN
ST, GEORGE	30	25	COASTAL
ST. JOHN PLAN.	40	15	NORTHERN
SANDY RIVER PL.	30	15	NORTHERN
SANFORD	30	25	COASTAL
SANGERVILLE	40	15	NORTHERN
SCARBOROUGH	30	25	COASTAL
SEARSMONT	30	25	COASTAL
SEARSPORT	40	25	COASTAL
SEBAGO	30	25	COASTAL
SEBEC	40	15	NORTHERN
SEBOEIS PLAN.	40	15	NORTHERN
SEDGWICK	40	25	COASTAL
SHAPLEIGH	30	25	COASTAL
SHERMAN	40	15	NORTHERN
SHIRLEY	40	15	NORTHERN
SIDNEY	30	15	NORTHERN
SKOWHEGAN	30	15	NORTHERN
SMITHFIELD	30	15	NORTHERN
SMYRNA	40	15	NORTHERN
SOLOON	30	15	NORTHERN
SOMERVILLE	30	25	COASTAL
SORRENTO	40	25	COASTAL
SOUTH BERWICK	30	25	COASTAL
SOUTH BRISTOL	30	25	COASTAL
S. PORTLAND	30	25	COASTAL
S. THOMASTON	30	25	COASTAL
SOUTHPORT	30	25	COASTAL
SW HARBOR	40	25	COASTAL
SPRINGFIELD	40	15	NORTHERN
STACYVILLE	40	15	NORTHERN
STANDISH	30	25	COASTAL
STARKS	30	15	NORTHERN
STETSON	40	15	NORTHERN
STEUBEN	40	25	COASTAL

STOCKHOLM	40	15	NORTHERN
STOCKTON SPRGS	40	25	COASTAL
STONEHAM	30	15	NORTHERN
STONINGTON	40	25	COASTAL
STOW	30	15	NORTHERN
STRONG	30	15	NORTHERN
SULLIVAN	40	25	COASTAL
SUMNER	30	15	NORTHERN
SURRY	40	25	COASTAL
SWAN'S ISLAND	40	25	COASTAL
SWANVILLE	40	25	COASTAL
SWEDEN	30	15	NORTHERN
TALMADGE	40	15	NORTHERN
TEMPLE	30	15	NORTHERN
THE FORKS PLAN.	40	15	NORTHERN
THOMASTON	30	25	COASTAL
THORNDIKE	30	25	COASTAL
TOPSFIELD	40	15	NORTHERN
TOPSHAM	30	25	COASTAL
TREMONT	40	25	COASTAL
TRENTON	40	25	COASTAL
TROY	40	25	COASTAL
TURNER	30	15	NORTHERN
UNION	30	25	COASTAL
UNITY	30	25	COASTAL
UPTON	30	15	NORTHERN
VAN BUREN	40	15	NORTHERN
VANCEBORO	40	15	NORTHERN
VASSALBORO	30	25	COASTAL
VEAZIE	40	15	NORTHERN
VERONA	40	25	NORTHERN
VIENNA	30	15	NORTHERN
VINALHAVEN	30	25	COASTAL
WADE	40	15	NORTHERN
WAITE	40	15	NORTHERN
WALDO	30	25	COASTAL
WALDOBORO	30	25	COASTAL
WALES	30	25	COASTAL
WALLAGRASS PL.	40	15	NORTHERN
WALTHAM	40	25	COASTAL
WARREN	30	25	COASTAL
WASHBURN	40	15	NORTHERN
WASHINGTON	30	25	COASTAL
WATERBORO	30	25	COASTAL
WATERFORD	30	15	NORTHERN
WATERVILLE	30	15	NORTHERN

WAYNE	30	15	NORTHERN
WEBSTER PLAN.	40	15	NORTHERN
WELD	30	15	NORTHERN
WELLINGTON	40	15	NORTHERN
WELLS	30	25	COASTAL
WESLEY	40	25	COASTAL
WEST BATH	30	25	COASTAL
WEST FORKS PL.	40	15	NORTHERN
WEST GARDINER	30	25	COASTAL
WEST PARIS	30	15	NORTHERN
WESTBROOK	30	25	COASTAL
WESTFIELD	40	15	NORTHERN
WESTMANLAND	40	15	NORTHERN
WESTON	40	15	NORTHERN
WESTPORT	30	25	COASTAL
WHITEFIELD	30	25	COASTAL
WHITING	40	25	COASTAL
WHITNEYVILLE	40	25	COASTAL
WILLIMANTIC	40	15	NORTHERN
WILTON	30	15	NORTHERN
WINDHAM	30	25	COASTAL
WINDSOR	30	25	COASTAL
WINN	40	15	NORTHERN
WINSLOW	30	15	NORTHERN
WINTER HARBOR	40	25	COASTAL
WINTERPORT	30	25	COASTAL
WINTERVILLE PL.	40	15	NORTHERN
WINTHROP	30	15	NORTHERN
WISCASSET	30	25	COASTAL
WOODLAND	40	15	NORTHERN
WOODSTOCK	30	15	NORTHERN
WOODVILLE 40		15	NORTHERN
WOOLWICH	30	25	COASTAL
YARMOUTH	30	25	COASTAL
YORK	30	25	COASTAL

## APPENDIX C

## PREFACE TO APPENDIX C

~~The purpose of this appendix is to provide installation instructions which may be less expensive to implement than the manufacturer's installation instructions. This appendix instruction will provide adequate structural support for homes in all but the most extreme winter temperature conditions. During extreme temperature conditions, foundations detailed in this instruction may be subject to frost heave. Owners who choose to have homes installed in accordance with this instruction must understand that they accept responsibility for maintaining the home in a level condition. Failure to maintain the home in a level condition may result in the manufacturer's warranty being voided. Mechanics installing new homes and park owners renting pads to owners should insure that home owners understand the risks and their responsibility when homes are installed on sites constructed in accordance with this instruction.~~

## I GENERAL REQUIREMENTS

## 1. HOME SITE SELECTION

Home sites shall not be constructed on mud, organic silt or uncontrolled-fill. Home sites shall not be constructed in any naturally occurring seasonal drainage swale.

## 2. HOME SITE PREPARATION

Site soil conditions shall be evaluated. Home sites shall be prepared as required by SITE PREPARATION DETAILS I and the GENERAL SPECIFICATIONS FOR SITE PREPARATION.

## 3. LOCATION OF SUPPORTS

~~A. New homes shall be supported where required by the manufacturer's installation instructions.~~

~~B~~ A. Used homes for which installation instructions are available shall be supported where required by those instructions.

~~C~~ B. Used homes for which installation instructions are not available shall be supported at locations indicated in SUPPORT LOCATION DETAILS V.


~~D~~ C. Each unit in multi unit homes shall be supported as a separate unit in accordance with this instruction. For purposes of this instruction, required marriage wall support shall be the same as required for perimeter blocking support.

#### 4. FOOTING REQUIREMENT


- A. Footings shall consist of a concrete pad constructed in accordance with CONCRETE SLAB DETAIL IV-A when
- (1) The home requires perimeter support or
  - (2) The home is located in ~~the 25 Wind Zone shown in Appendix 8~~ Washington and Hancock counties and the home is to be rented or occupied by someone other than the home owner.
- B. Footings for homes other than those identified in Requirement 4.A.(1) shall be constructed in accordance with FOOTING DETAIL II or CONCRETE SLAB DETAIL IV-A.
- C. A footing shall be installed at each support location.

#### GENERAL SPECIFICATIONS FOR SITE PREPARATION

- (1) Compacted fill shall consist of gravel or sand which contains less than 5% (by weight) grains that will pass a #200 sieve. Gravel fill shall contain no rocks or boulders larger than 3" in diameter. Compacted fill shall contain no organic matter. Compacted fill shall not be frozen when placed or compacted.
- (2) Compacted fill shall be compacted in a maximum of 6" lifts. Each lift shall be compacted sufficiently so that when 1000 lbs. is applied to a 3½" x 3½" block placed on top of the fill, the block will not sink more than 3/8" into the fill. (see recommended compaction test procedure below.)
- (3) Compacted fill shall be placed on undisturbed and unfrozen soil. The site shall be free of topsoil and organic matter prior to the placement of fill.
- (4) Crushed rock shall consist of clean, washed rock, and may range in size from pea gravel to 3/4". All crushed rock shall be retained by a #4 sieve.
- (5) The perimeter of foundation sites shall be graded to prevent the flow of surface water under the home and to prevent the accumulation of surface water within 10 (ten) feet of the Perimeter of the home.

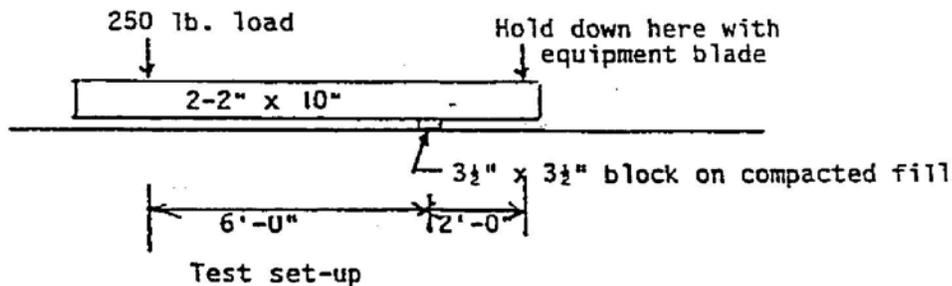RECOMMENDED COMPACTION TEST PROCEDURE

Place a 24" long straight edge or level on fill beside block. Center the straight edge on the block.

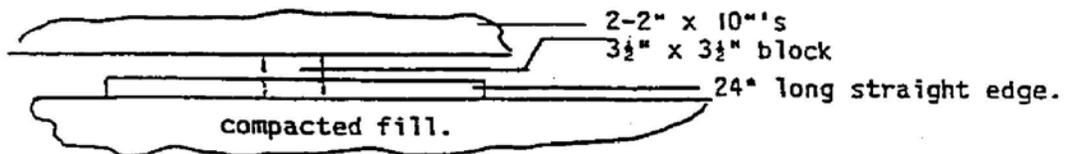

If the block sinks more than 3/8" with respect to the straight edge when the 250 lb. load is applied, more compaction is required

- D. Footings shall be centered within 1" of the required support location.
  - E. Footing surface shall be level within ¼" on the top surface after the home has been installed.
5. PIER REQUIREMENTS
- A. Piers shall be constructed at all locations of support under the main steel frame of the home.
  - B. Piers constructed under the main frame shall be constructed in accordance with PIER DETAILS.
  - C. Perimeter blocking or support, where required, shall be constructed in accordance with PERIMETER BLOCKING DETAILS.
  - D. Piers shall be centered on the footing within 1"
  - E. Piers shall be centered under the main frame wWithin 1" of required support locations.
6. Leveling Requirements

After the home is set, the home shall be leveled so that all doors and windows operate as intended and waste plumbing function in a safe manner. Specifically, leveling shall be adequate to maintain plumbing trap seals and prevent the buildup of solid waste in drain piping.

- A. The floor should be not more than 3/8" out of level in any 8 foot span.
- B. The floor should be not more than 2" out of level along the entire length of the home.

7. Tie Down Requirements


Tie downs shall be installed in accordance with the CONCRETE SLAB DETAIL IV-A on all homes which:

- A. are located in ~~the 25 Wind Zone as defined in Appendix B of this Standard~~ Washington and Hancock counties, and
- B. which are rented or otherwise occupied by other than the home owner.

## SITE PREPARATION DETAIL I-A REV.


## NOTES:

1. This detail may be used when:
  - a. the foundation site is overlain with at least 24" of naturally occurring gravel or sand with less than 7% (by weight) passing a #200 sieve, and
  - b. the highest ground water table is more than 24" below the finish grade.
2. Sites prepared in the Coastal Zone as defined in Appendix B require 18" where 24" is specified in Note 1.
3. Construction may be placed on naturally occurring soils after all organic material has been removed from the construction site.

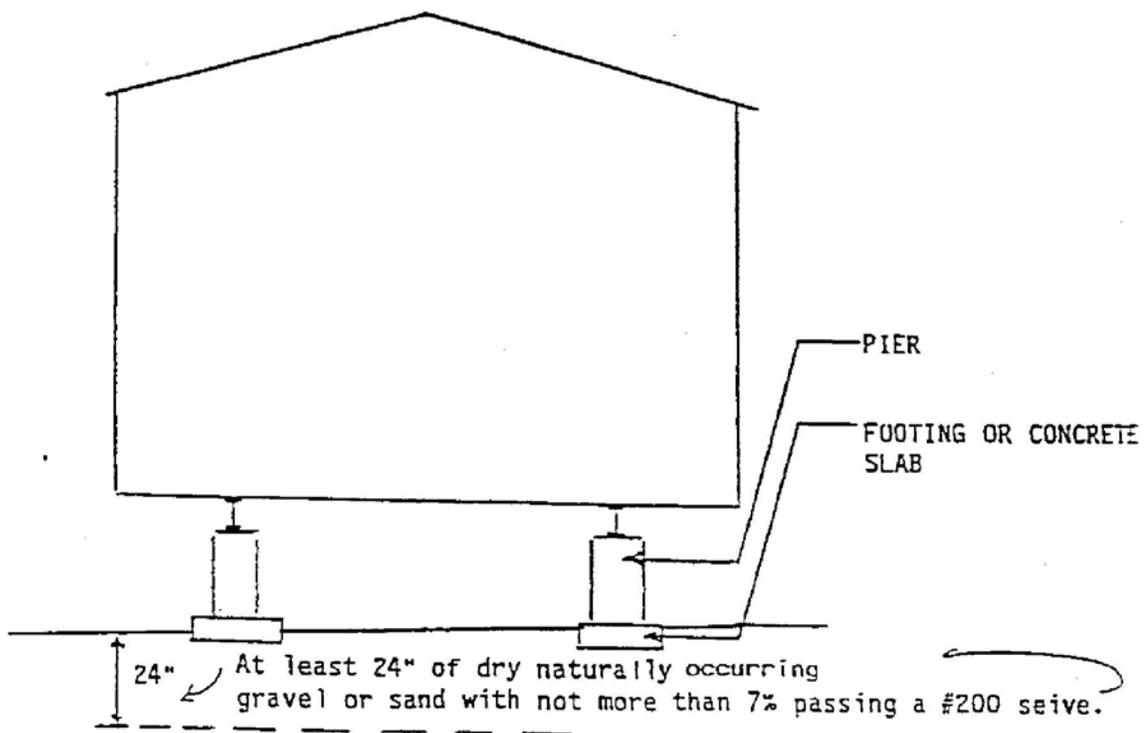


SITE PREPARATION DETAIL I-B REV.  
NOTES:

1. This detail may be used when the foundation site;
  - a. does not contain any mud, organic silt or uncontrolled fill, and
  - b. the highest ground water table is more than 24" below finish grade.
2. If a slab is to be constructed on this site, crushed rock must be installed under the entire slab.
3. A drainage swale at least 6" deep and within 10' of the sidewalls of the home must be constructed around the home. The swale shall have an unobstructed discharge allowing water to flow away continuously from the perimeter of the home.
4. The 4" drainage system shall provide for free flow of water from the rock pads and shall prevent the accumulation of any water.

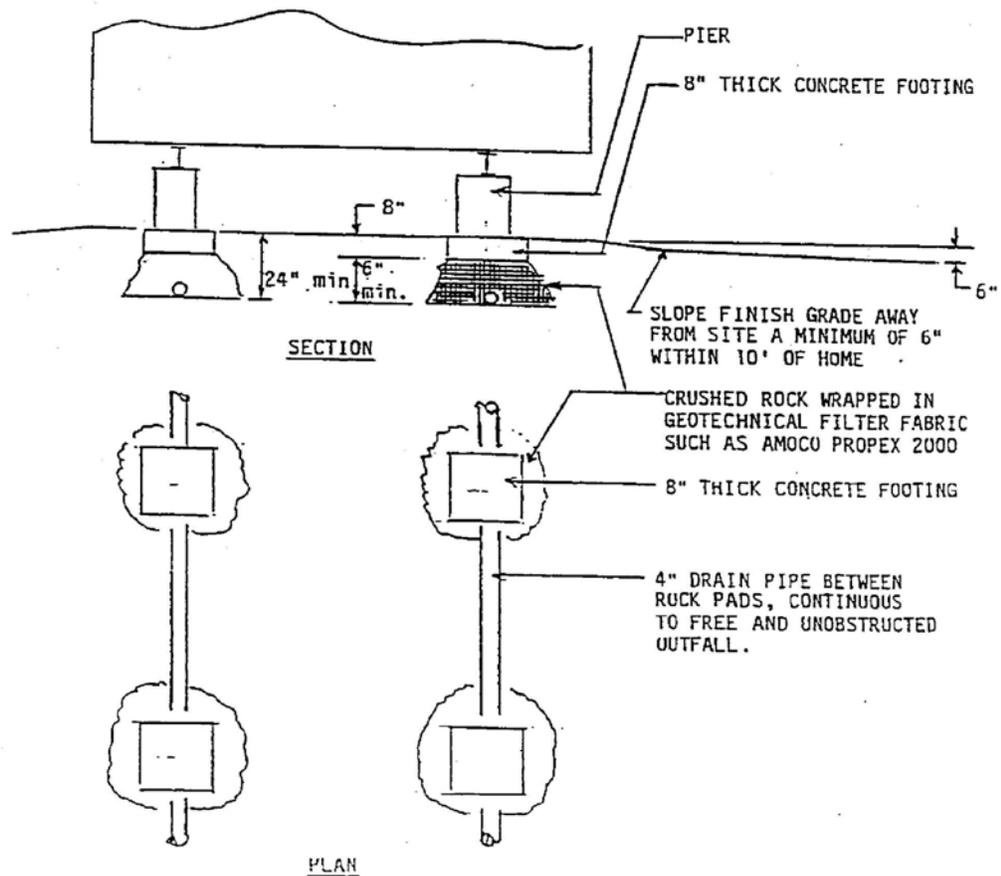

## SITE PREPARATION DETAIL I-C REV. NOTES:

1. This detail may be used on any foundation site that does not contain mud, organic silt or uncontrolled fill.
2. Sites prepared in the Coastal Zone as defined in Appendix B require 18" where 24" is specified in this detail.
3. Finish grade shall be loamed and seeded with grass or otherwise finished to prevent erosion of compacted fill.
4. Compacted fill may be placed below the original site grade only if a drainage system is installed in the fill to prevent the accumulation of water within 24" of the bottom of the footing.


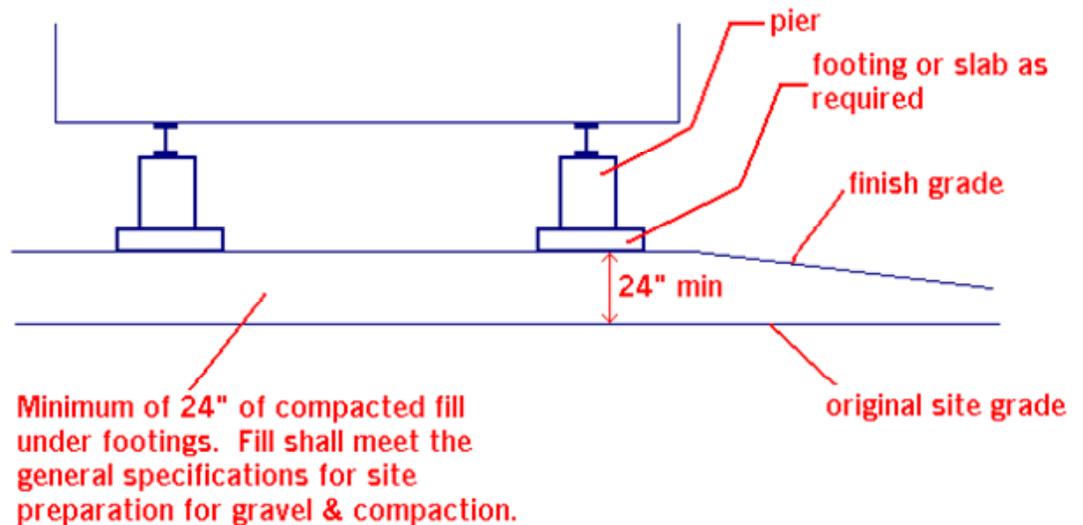
**Site Preparation**

## FOOTING DETAIL II-A

REV.

## NOTES:


1. Concrete shall have a minimum compressive strength of 3000 psi at 28 days
2. Concrete shall be protected from freezing for the first 7 days after it has been cast.
3. Footing pads may be cast on in situ or precast and delivered to the site for placing.
4. Footing pads which are precast for later placement shall be cured at least 7 days prior to handling.

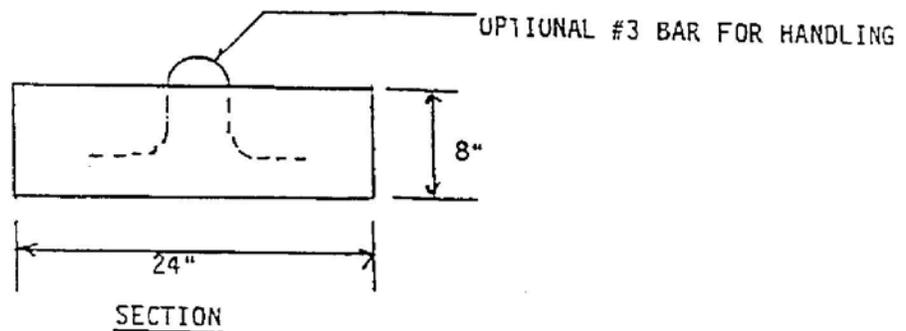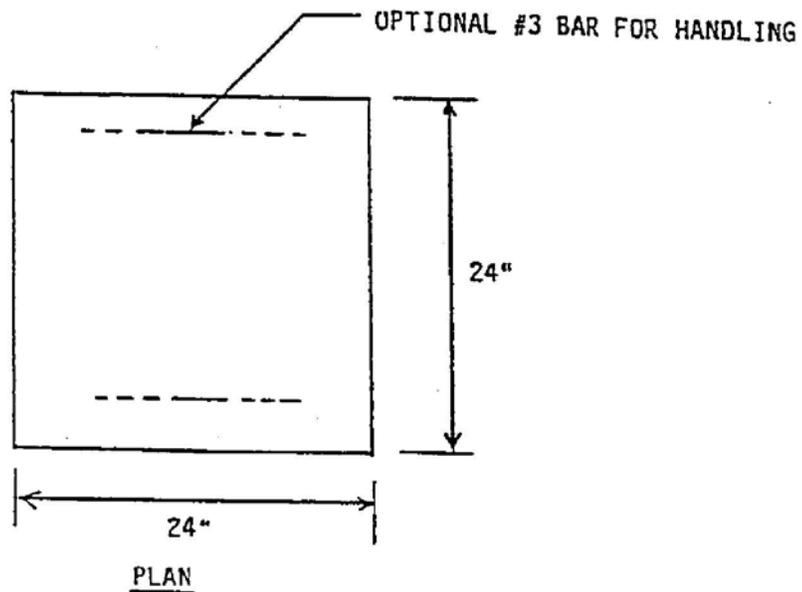

FOOTING DETAIL II-3 B      REV.  
 NOTES:

1. This detail is of a wood isolated footing to be placed on a prepared site. This detail may be used when pier height does not exceed 30".
2. Wood used in this detail must be Southern Yellow Pine, #2, pressure treated with water-borne preservatives in accordance with AWPA C2 or C9. The AWPA stamp must indicate that the treatment is for use in contact with ground.


**Footing Details**

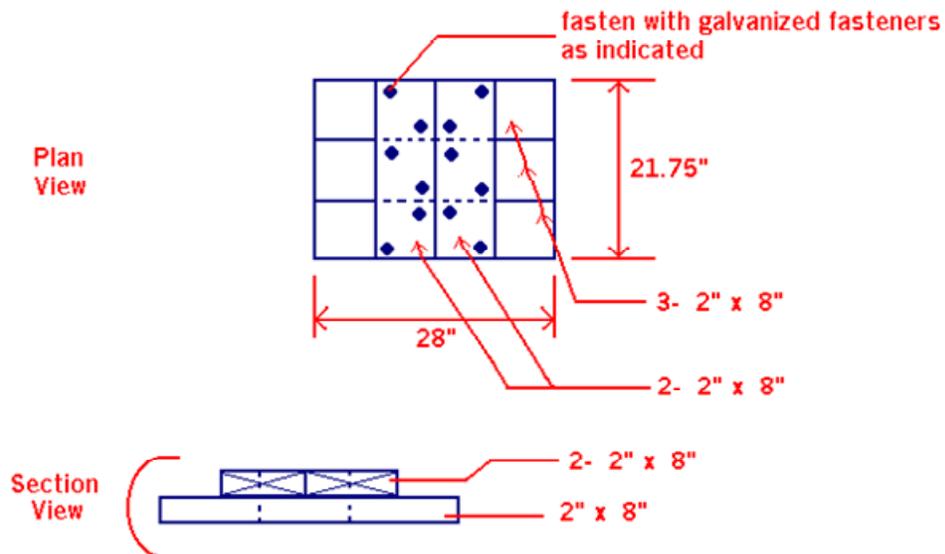


Note: Pier cement blocks shall be centered on the wood footing with the 16" dimension parallel to the 3-2" x 8".

**DETAIL III-A**  
**NOTES:****REV.**

1. This detail applies to piers which are a maximum of 24" high from the top of footing.
2. Masonry units in this detail shall comply with ASTM C90, Grades N-I or N-II.
3. Wood block shall be of a structurally graded lumber with the 12" dimension centered under the main frame. No more than 2 wood blocks may be stacked.
4. Shims shall provide contact between main frame and 2" x 10" for at least 6".

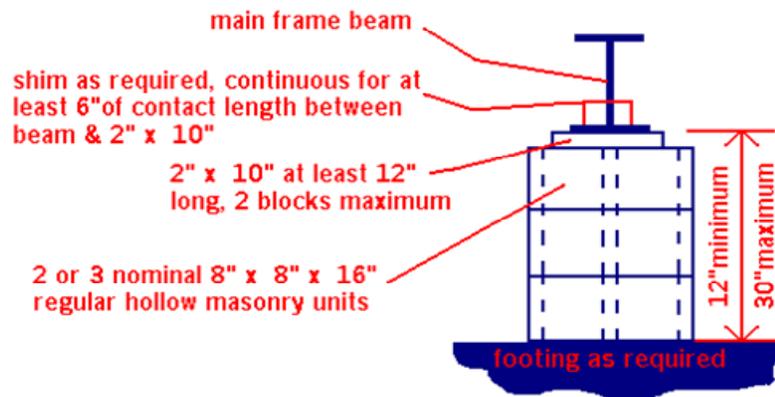
**Pier Detail**

### CONCRETE SLAB DETAIL IV-A

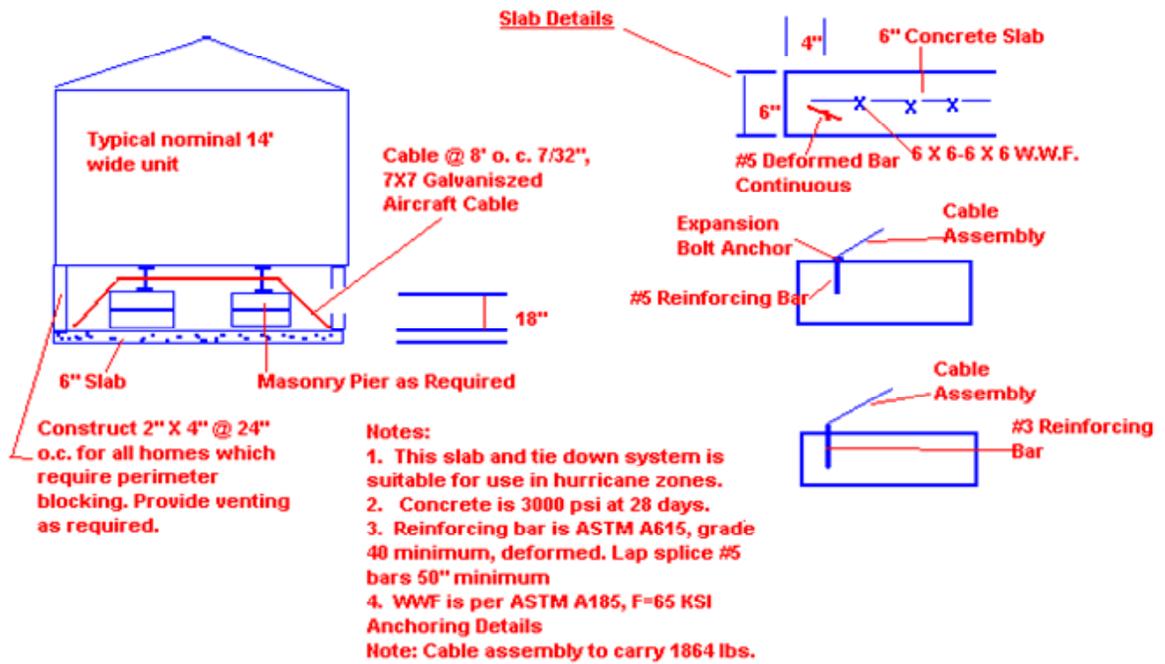


SUPPORT LOCATION DETAIL V-A      REV:  
 NOTES:

1. This detail applies to used homes
  - A. ~~which are used, and~~
  - B. A. for which no manufacturer's installation instructions are available, and
  - C. B. which have floor frames constructed with 2" x 8" or deeper floor joists or are 12' or less wide.
2. Support locations are required within 2' of the end of the main frame and at no more than 8' o.c. under the main frame.

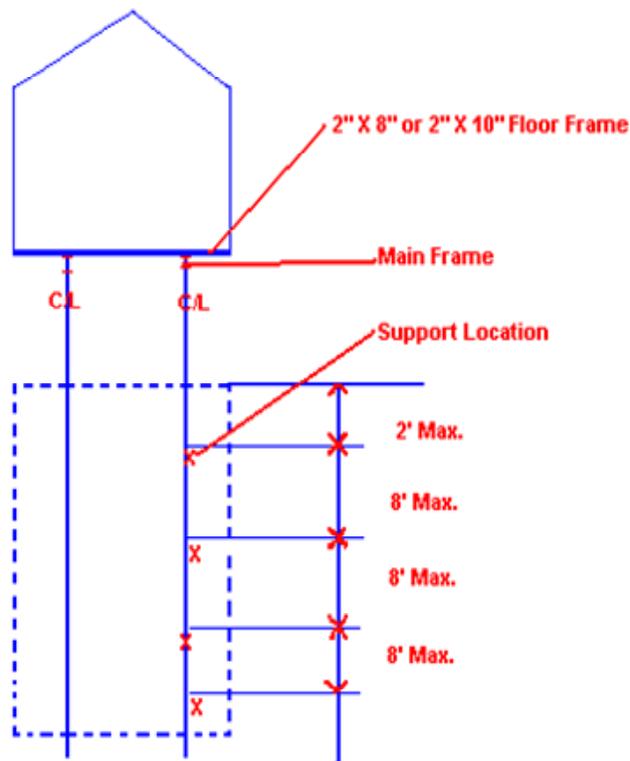


SUPPORT LOCATION DETAIL V-B REV.  
NOTES:

1. This detail applies to used homes:
  - A. ~~which are used, and~~
  - B A. for which no manufacturer's installation instructions are available, and
  - C B. which have floor frames constructed with 2" x 4" or 2" x 6" floor joists and are more than 12' wide.
2. Support locations are required within 2' of the end of the main frame and at no more than 8' o.c. under the main frame. Continuous perimeter support is required under side walls of the unit.

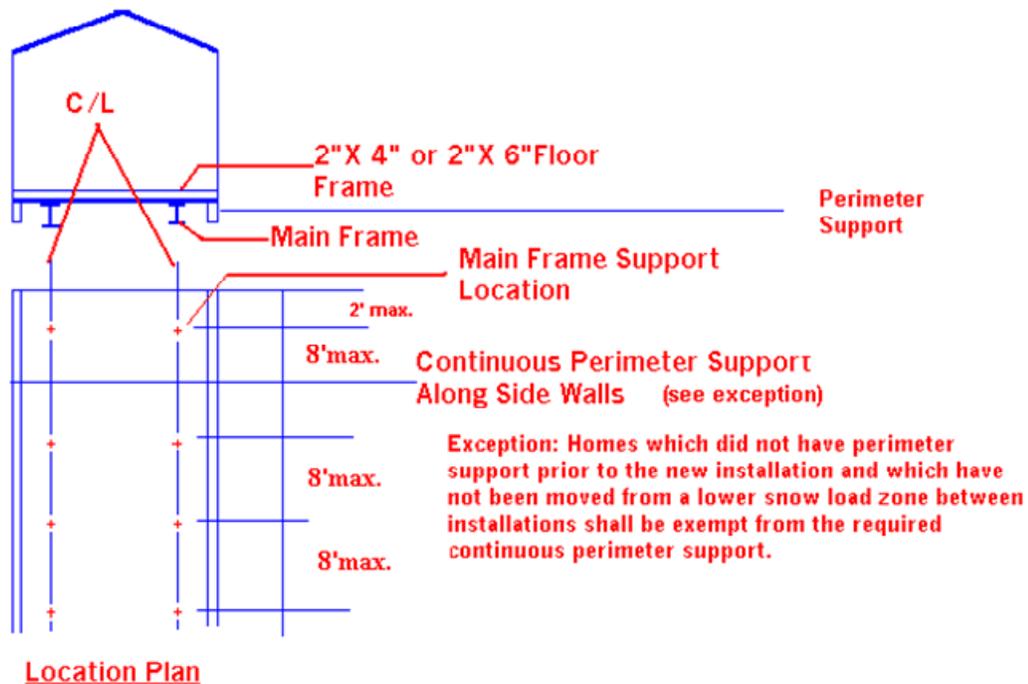

PERIMETER BLOCKING DETAIL VI-A      REV.  
NOTES:

1. This detail applies where perimeter blocking or support is required.
2. Provide venting through sheathing as required by this standard.
3. Provide an access door to the underside of the home as required by other portions of this standard.
4. P.T. treated lumber shall be treated per AWPA C-2 or C-9 for use above grade
5. Provide a weather protective covering for the sheathing.

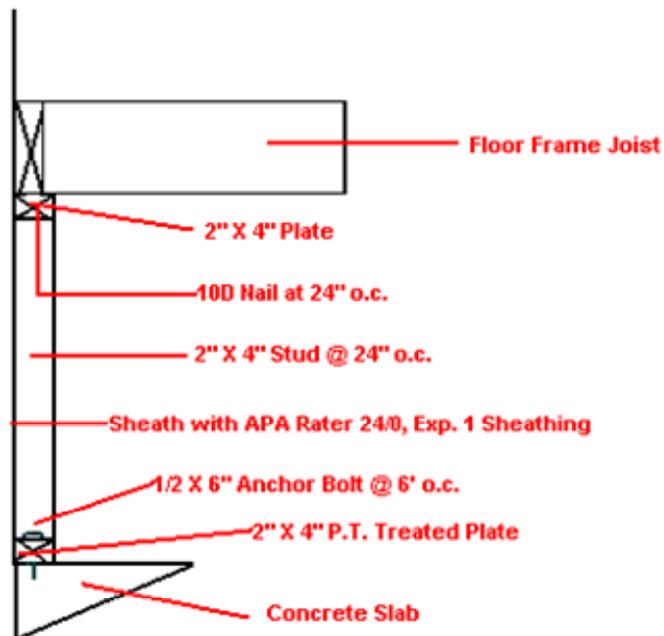

APPENDIX D            Ground Level Installation of Used Manufactured  
Homes (Floor at Grade)

- D-1            General. Ground level installations refer to used manufactured homes installed over an open excavation where the supporting foundations are below finished ground level.
- D-1.1          Grading Permit Requirements. All required permits will be obtained.
- D-1.2          Retaining Walls. Retaining walls to resist the lateral displacement of soil and other materials should be designed to resist the lateral pressure of the retained material in accordance with accepted engineering practice. Retaining walls, if fastened to the manufactured home at the time of installation, should not degrade the stabilizing system of the home. When a retaining wall is not used as a foundation, it should not be attached to the home. Retaining walls should be constructed of treated foundation grade wood, concrete, masonry, other approved materials or combinations of these materials.
- D-1.3          Backfill, Fill and Grading. All fill and backfill soil surrounding the home should be compacted. Grading around the home should be done in such a manner that water will drain from the unit at a slope of 1/2 ft. vertical for every 12 ft. horizontal.

AUTHORITY:        10 M.R.S.A. Part 11, Chapter 951, Subchapter 1, Section 9006,  
Paragraph I and Resolve #26 of 1989.

EFFECTIVE DATE:        February, 1. 1993

EFFECTIVE DATE (ELECTRONIC CONVERSION):    January 11, 1997