

Salt Shed

WIN: 027221.00

Kingfield

2021

Updated 05/15/2020

STATE PROJECT

MAINTENANCE & OPERATIONS

BIDDING INSTRUCTIONS

1. Use pen and ink to complete all paper Bids. Signatures shall be original. Stamped and copied signatures will not be accepted. Bids are not accepted by email or FAX.
2. As a minimum, the following should be received prior to the time of Bid opening:

For a Paper Bid:

- a) a copy of the Notice to Contractors, b) the completed Acknowledgement of Bid Amendments form, c) the completed Schedule of Items, d) two copies of the completed and signed Contract Agreement form, e) a Bid Guaranty, f) the completed Contractor Information Sheet, and g) any other certifications or Bid requirements listed in the Bid Documents as due by Bid opening.

For an Electronic Bid:

NOTE: Not all projects accept Electronic Bids. Please review the Notice to Contractors and see if it specifically states that Electronic Bids will be accepted.

- a) a completed Bid using Expedite® software and submitted via the Bid Express™ web-based service, b) an electronic Bid Guaranty (if required) or a faxed copy of a Bid Bond (with original to be delivered within 72 hours), and c) any other Certifications or Bid requirements listed in the Bid Documents as due by Bid opening.
3. Include prices for all items in the Schedule of Items.
 4. Bid Guaranty acceptable forms are:
 - a) a properly completed and signed Bid Bond on the Department's prescribed form (or on a form that does not contain any significant variations from the Department's form as determined by the Department) for 5% of the Bid Amount or
 - b) an Official Bank Check, Cashier's Check, Certified Check, U.S. Postal Money Order or Negotiable Certificate of Deposit in the amount stated in the Notice to Contractors or
 - c) an electronic bid bond submitted with an electronic bid.

5. All Bid Packages which are mailed or sent express, shall be provided in double (one envelope inside the other) envelopes, for security and other reasons. The *Inner Envelope* shall have the following information provided on it:

Bid Enclosed - Do Not Open

WIN:

Towns:

Date of Bid Opening:

Name of Contractor with mailing address and telephone number:

In Addition to the usual address information, the *Outer Envelope* should have written or typed on it:

Double Envelope: Bid Enclosed

WIN:

Towns:

Date of Bid Opening:

Name of Contractor:

If a paper Bid is to be sent express, please take note that overnight services do not always arrive in time and that delivery may be affected by carrier volume, weather and other factors. Packages using express services should be sent directly to the DOT Headquarters Building, Maine Department of Transportation, 24 Child Street, Augusta. "FedEx First Overnight" delivery is suggested as the package is delivered directly to the DOT Headquarters Building, Mailroom, 24 Child Street, Augusta. Allow extra days for U.S. Postal Service Express Mail which has proven not to be reliable and sometimes does not deliver directly to the DOT Headquarters Building but instead delivers to the State of Maine Mail Distribution Center.

If a paper bid is to be mailed, the mailing address is Maine Department of Transportation, 16 State House Station, Augusta, ME 04333-0016. Allow additional working days for this mail to pass through the state mail system in addition to the US Postal Service as this mail is not delivered directly to the Department of Transportation.

If a paper Bid is to be hand carried, deliver directly to the “Public Entrance” which is located on the Capitol Street side of the DOT Headquarters Building in Augusta. <http://www.maine.gov/mdot/contact>. Hand-carried Bids may be in one envelope, and should be marked with the following information:

Bid Enclosed: Do Not Open

WIN:

Towns:

Date of Bid Opening:

Name of Contractor:

If you need further information regarding Bid preparation, call the DOT Contracts Section at (207) 624-3410.

For complete bidding requirements, refer to Section 102 of the Maine Department of Transportation, Standard Specifications, March 2020 Edition.

NOTICE

The Maine Department of Transportation is attempting to improve the way Bid Amendments/Addendums are handled, and allow for an electronic downloading of bid packages from our website, while continuing to maintain an optional plan holders list.

Prospective bidders, subcontractors or suppliers who wish to download a copy of the bid package and receive a courtesy notification of project specific bid amendments must fill out the on-line plan holder registration form and provide an email address to the MDOT Contracts mailbox at: MDOT.contracts@maine.gov. Each bid package will require a separate request.

Additionally, interested parties will be responsible for reviewing and retrieving the Bid Amendments from our web site, and acknowledging receipt and incorporating those Bid Amendments in their bids using the Acknowledgement of Bid Amendment Form.

The downloading of bid packages from the MDOT website is not the same as providing an electronic bid to the Department. Electronic bids must be submitted via <http://www.BIDX.com>. For information on electronic bidding contact Rebecca Snowden at rebecca.snowden@maine.gov or Diane Barnes at diane.barnes@maine.gov.

STATE OF MAINE DEPARTMENT OF TRANSPORTATION
Bid Guaranty-Bid Bond Form

KNOW ALL MEN BY THESE PRESENTS THAT _____

_____, of the City/Town of _____ and State of _____

as Principal, and _____ as Surety, a

Corporation duly organized under the laws of the State of _____ and having a usual place of

Business in _____ and hereby held and firmly bound unto the Treasurer of

the State of Maine in the sum of _____, for payment which Principal and Surety bind

themselves, their heirs, executors, administrators, successors and assigns, jointly and severally.

The condition of this obligation is that the Principal has submitted to the Maine Department of

Transportation, hereafter Department, a certain bid, attached hereto and incorporated as a

part herein, to enter into a written contract for the construction of _____

_____ and if the Department shall accept said bid

and the Principal shall execute and deliver a contract in the form attached hereto (properly

completed in accordance with said bid) and shall furnish bonds for this faithful performance of

said contract, and for the payment of all persons performing labor or furnishing material in

connection therewith, and shall in all other respects perform the agreement created by the

acceptance of said bid, then this obligation shall be null and void; otherwise it shall remain in full

force, and effect.

Signed and sealed this _____ day of _____ 20_____

WITNESS:

WITNESS

PRINCIPAL:

By _____

By: _____

By: _____

SURETY:

By _____

By: _____

Name of Local Agency: _____

NOTICE

Bidders:

Please use the attached “Request for Information” form when submitting questions concerning specific Contracts that have been advertised for Bid, include additional numbered pages as required. RFI’s may be faxed to 207-624-3431, submitted electronically through the Departments web page of advertised projects by selecting the RFI tab on the project details page or via e-mail to RFI-Contracts.MDOT@maine.gov.

These are the only allowable mechanisms for answering Project specific questions. Maine DOT will not be bound to any answers to Project specific questions received during the Bidding phase through other processes.

When submitting RFIs by Email please follow the same guidelines as stated on the “Request for Information” form and include the word “RFI” along with the Project name and Identification number in the subject line.

Vendor Registration

Prospective Bidders must register as a vendor with the Department of Administrative & Financial Services if the vendor is awarded a contract. Vendors will not be able to receive payment without first being registered. Vendors/Contractors will find information and register through the following link –

<http://www.maine.gov/purchases/venbid/index.shtml>

CONTRACTOR INFORMATION

Contractor Name: _____

Mailing Address: _____

Vendor Customer Number: _____

Contact Information (Primary Contact): _____

Phone: _____ **Cell Phone:** _____

Fax: _____

Email: _____

Mailing Address (if different from above): _____

The company has the following organizational structure:

Sole Proprietorship

Limited Liability Company

Partnership

Joint Venture

Corporation

Other: _____

(Date)

(Signature)

(Name and Title Printed)

STATE OF MAINE DEPARTMENT OF TRANSPORTATION NOTICE TO CONTRACTORS

Sealed Bids addressed to the Maine Department of Transportation, Augusta, Maine 04333 and endorsed on the wrapper "Bids for a Salt Shed in the Town of Kingfield" will be received from contractors at the Reception Desk, MaineDOT Building, Capitol Street, Augusta, Maine, until 11:00 o'clock A.M. (prevailing time) on September 15, 2021 and at that time and place, publicly opened and read. Bids will be accepted from all bidders. The lowest responsive bidder must have completed, or successfully complete, a Building or project specific prequalification to be considered for the award of this contract. **We now accept electronic bids for bid packages posted on the bidx.com website. Electronic bids do not have to be accompanied by paper bids. Please note: The Department will accept a facsimile of the bid bond; however, the original bid bond must then be received at the MDOT Contract Section within 72 hours of the bid opening.** Until further notice, dual bids (one paper, one electronic) will be accepted, with the paper copy taking precedence

Description: WIN: 027221.00

Location: In Franklin County, project is located on Route 27 in Kingfield, Maine.

Outline of Work: Construction of a salt shed and other incidental work.

For general information regarding Bidding and Contracting procedures, contact George Macdougall at (207) 624-3410. Our webpage at <http://www.maine.gov/mdot/contractors/> contains a copy of the Schedule of Items, Plan Holders List, written portions of bid amendments, drawings, bid results and an electronic form for RFI submittal. For Project-specific information fax all questions to Gail Iler at (207) 624-3431, use electronic RFI form or email questions to RFI-Contracts.MDOT@maine.gov, project name and identification number should be in the subject line. Questions received after 12:00 noon of Friday (or if that Friday is a state holiday, Thursday) prior to bid date will not be answered. Bidders shall not contact any other Departmental staff for clarification of Contract provisions, and the Department will not be responsible for any interpretations so obtained. TTY users call Maine Relay 711.

Bid Documents, plans, specifications and bid forms can be viewed and obtained digitally at no cost at <http://www.maine.gov/mdot/contractors/>. Plans, specifications and bid forms may be seen at the MaineDOT Building in Augusta, Maine, and at the Department of Transportation's Regional Office in Wilton. They may be purchased from the Department between the hours of 8:00 a.m. to 4:30 p.m. by cash, credit card (Visa/Mastercard) or check payable to Treasurer, State of Maine sent to Maine Department of Transportation, Attn.: Mailroom, 16 State House Station, Augusta, Maine 04333-0016. They also may be purchased by telephone at (207) 624-3536 between the hours of 8:00 a.m. to 4:30 p.m. Full size plans \$13.00 (\$16.50 by mail). Half size plans \$6.50 (\$8.75 by mail), Bid Book \$10 (\$13 by mail), Single Sheets \$2, payment in advance, all non-refundable.


Each Bid must be made upon blank forms provided by the Department and must be accompanied by a bid bond at 5% of the bid amount or an official bank check, cashier's check, certified check, certificate of deposit, or United States postal money order in the amount of 5% of the bid amount, payable to Treasurer, State of Maine as a Bid guarantee. A Contract Performance Surety Bond and a Contract Payment Surety Bond, each in the amount of 100 percent of the Contract price, will be required of the successful Bidder.

This Contract is subject to all applicable State Laws.

All work shall be governed by *State of Maine, Department of Transportation, Standard Specifications, March 2020 Edition*, price \$10 [\$15 by mail], and *Standard Details, March 2020 Edition*, price \$10 [\$15 by mail]. They also may be purchased by telephone at (207) 624-3536 between the hours of 8:00 a.m. to 4:30 p.m. *Standard Detail* updates can be found at <http://www.maine.gov/mdot/contractors/publications/>.

The right is hereby reserved to the MaineDOT to reject any or all bids.

Augusta, Maine
August 25, 2021

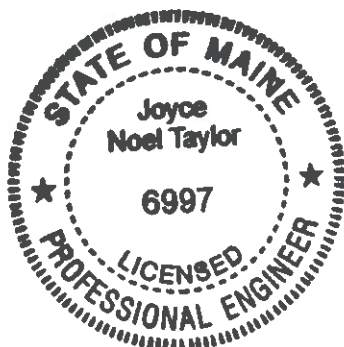

JOYCE NOEL TAYLOR, P. E.
CHIEF ENGINEER

**SPECIAL PROVISION 102.7.3
ACKNOWLEDGMENT OF BID AMENDMENTS**

With this form, the Bidder acknowledges its responsibility to check for all Amendments to the Bid Package. For each Project under Advertisement, Amendments are located at <http://www.maine.gov/mdot/contractors/> . It is the responsibility of the Bidder to determine if there are Amendments to the Project, to download them, to incorporate them into their Bid Package, and to reference the Amendment number and the date on the form below. The Maine DOT will not post Bid Amendments any later than noon the day before Bid opening without individually notifying all the planholders.

Amendment Number	Date

The Contractor, for itself, its successors and assigns, hereby acknowledges that it has received all of the above referenced Amendments to the Bid Package.

CONTRACTOR

Date

Signature of authorized representative

(Name and Title Printed)

7/26/2021

Maine Department of Transportation

Proposal Schedule of Items

Page 1 of 1

Proposal ID: 027221.00

Project(s): 027221.00

SECTION: 1 BUILDING

Alt Set ID: Alt Mbr ID:

Contractor: _____

Proposal Line Number	Item ID Description	Approximate Quantity and Units	Unit Price		Bid Amount	
			Dollars	Cents	Dollars	Cents
0010	815.00 BUILDING - SALT STORAGE BUILDING	LUMP SUM	LUMP	SUM	_____	_____
		Section: 1	Total:		_____	_____
			Total Bid:		_____	_____

By signing below, the Bidder (1) represents that the Bidder has examined the Contract Agreement contained in the Bid Documents, the Contract, all documents referenced in said Contract, and the site and scope of work, (2) does hereby bid and offer to enter into this contract to construct and/or perform the Work in strict accordance with the terms and conditions of this Contract at the unit prices bid in the attached "Schedule of Items", (3) represents that the Bidder has given the Department notice of any errors or ambiguities related to the documents or the work that have been discovered by the Bidder, (4) represents that the above-named organization is the legal entity entering into the resulting contract with the Department if they are awarded the contract and, (5) represents that the undersigned is authorized to enter contractual obligations on behalf of the above-named organization.

Bidder acknowledges that the properly completed and signed Schedule of Items provided with the Bid constitutes the Bidder's offer and that this offer shall remain open for 30 calendar days after the date of opening of bids.

The Bidder hereby certifies, to the best of its knowledge and belief that: the Bidder has not, either directly or indirectly, entered into any agreement, participated in any collusion, or otherwise taken any action in restraint of competitive bidding in connection with its bid, and its subsequent contract with the Department.

Use pen and ink to complete paper bids. Signatures shall be original. Stamped and copied signatures will not be accepted.

Signature Date

(Print Bidder's Name and Title)

CONTRACT AGREEMENT, OFFER & AWARD

AGREEMENT made on the date last signed below, by and between the State of Maine, acting through and by its Department of Transportation (Department), an agency of state government with its principal administrative offices located at Child Street, Augusta, Maine, with a mailing address at 16 State House Station, Augusta, Maine 04333-0016, and _____ (Contractor) a corporation or other legal entity organized under the laws of the State of _____, with its principal place of business located at _____.

The Department and the Contractor, in consideration of the mutual promises set forth in this Agreement (the "Contract"), hereby agree as follows:

A. **The Work.**

The Contractor agrees to complete all Work as specified or indicated in the Contract including Extra Work in conformity with the Contract, **WIN:027221.00 for construction of a Salt Shed in the Town of Kingfield**, Maine. The Work includes construction, maintenance during construction, warranty as provided in the Contract, and other incidental work.

The Contractor shall be responsible for furnishing all supervision, labor, equipment, tools supplies, permanent materials and temporary materials required to perform the Work including construction quality control including inspection, testing and documentation, all required documentation at the conclusion of the project, warranting its work and performing all other work indicated in the Contract.

The Department shall have the right to alter the nature and extent of the Work as provided in the Contract; payment to be made as provided in the same.

B. **Time.**

The Contractor agrees to complete all Work, except warranty work, on or before **August 25, 2022**. Further, the Department may deduct from moneys otherwise due the Contractor, not as a penalty, but as Liquidated Damages in accordance with Sections 107.7 and 107.8 of the *State of Maine Department of Transportation Standard Specifications, March 2020 Edition* and related Special Provisions.

C. Price.

The quantities given in the Schedule of Items of the Bid Package will be used as the basis for determining the original Contract amount and for determining the amounts of the required Performance Surety Bond and Payment Surety Bond, and that the amount of this offer is _____

_____ \$ _____ Performance Bond and Payment Bond each being 100% of the amount of this Contract.

D. Contract.

This Contract, which may be amended, modified, or supplemented in writing only, consists of the Contract documents as defined in the Plans, *Standard Specifications, March 2020 Edition, Standard Details March 2020 Edition* as updated through advertisement, Supplemental Specifications, Special Provisions, Contract Agreement; and Contract Bonds. It is agreed and understood that this Contract will be governed by the documents listed above.

E. Certifications.

By signing below, the Contractor hereby certifies that to the best of the Contractor's knowledge and belief:

1. All of the statements, representations, covenants, and/or certifications required or set forth in the Bid and the Bid Documents, including those in the Contract are still complete and accurate as of the date of this Agreement.
2. The Contractor knows of no legal, contractual, or financial impediment to entering into this Contract.
3. The person signing below is legally authorized by the Contractor to sign this Contract on behalf of the Contractor and to legally bind the Contractor to the terms of the Contract.

F. Offer.

The undersigned, having carefully examined the site of work, the Plans, *Standard Specifications March 2020 Edition*, *Standard Details March 2020 Edition* as updated through advertisement, Supplemental Specifications, Special Provisions, Contract Agreement; and Contract Bonds contained herein for construction of:

WIN:027221.00 for construction of a Salt Shed in the Town of Kingfield.

State of Maine, on which bids will be received until the time specified in the “Notice to Contractors” do(es) hereby bid and offer to enter into this contract to supply all the materials, tools, equipment and labor to construct the whole of the Work in strict accordance with the terms and conditions of this Contract at the unit prices in the attached “Schedule of Items.”

The Offeror agrees to perform the work required at the price specified above and in accordance with the bids provided in the attached “Schedule of Items” in strict accordance with the terms of this solicitation, and to provide the appropriate insurance and bonds if this offer is accepted by the Government in writing.

As Offeror also agrees:

First: To do any extra work, not covered by the attached “Schedule of Items,” which may be ordered by the Resident, and to accept as full compensation the amount determined upon a “Force Account” basis as provided in the *Standard Specifications, March 2020 Edition*, and as addressed in the contract documents.

Second: That the bid bond at 5% of the bid amount or the official bank check, cashier’s check, certificate of deposit or U. S. Postal Money Order in the amount given in the “Notice to Contractors”, payable to the Treasurer of the State of Maine and accompanying this bid, shall be forfeited, as liquidated damages, if in case this bid is accepted, and the undersigned shall fail to abide by the terms and conditions of the offer and fail to furnish satisfactory insurance and Contract bonds under the conditions stipulated in the Specifications within 15 days of notice of intent to award the contract.

Third: To begin the Work as stated in Section 107.2 of the *Standard Specifications March 2020 Edition* and complete the Work within the time limits given in the Special Provisions of this Contract.

Fourth: That this offer shall remain open for 30 calendar days after the date of opening of bids.

Fifth: The Bidder hereby certifies, to the best of its knowledge and belief that: the Bidder has not, either directly or indirectly, entered into any agreement, participated in any collusion, or otherwise taken any action in restraint of competitive bidding in connection with its bid, and its subsequent contract with the Department.

IN WITNESS WHEREOF, the Contractor, for itself, its successors and assigns, hereby execute this Agreement and thereby binds itself to all covenants, terms, and obligations contained in the Contract Documents.

CONTRACTOR

Date

(Signature of Legally Authorized Representative
of the Contractor)

Witness

(Name and Title Printed)

G. Award.

Your offer is hereby accepted.
documents referenced herein.

This award consummates the Contract, and the

MAINE DEPARTMENT OF TRANSPORTATION

Date

By: Bruce A. Van Note, Commissioner

Witness

CONTRACT AGREEMENT, OFFER & AWARD

AGREEMENT made on the date last signed below, by and between the State of Maine, acting through and by its Department of Transportation (Department), an agency of state government with its principal administrative offices located at Child Street, Augusta, Maine, with a mailing address at 16 State House Station, Augusta, Maine 04333-0016, and _____ (Contractor) a corporation or other legal entity organized under the laws of the State of _____, with its principal place of business located at _____.

The Department and the Contractor, in consideration of the mutual promises set forth in this Agreement (the "Contract"), hereby agree as follows:

A. **The Work.**

The Contractor agrees to complete all Work as specified or indicated in the Contract including Extra Work in conformity with the Contract, **WIN:027221.00 for construction of a Salt Shed in the Town of Kingfield**, Maine. The Work includes construction, maintenance during construction, warranty as provided in the Contract, and other incidental work.

The Contractor shall be responsible for furnishing all supervision, labor, equipment, tools supplies, permanent materials and temporary materials required to perform the Work including construction quality control including inspection, testing and documentation, all required documentation at the conclusion of the project, warranting its work and performing all other work indicated in the Contract.

The Department shall have the right to alter the nature and extent of the Work as provided in the Contract; payment to be made as provided in the same.

B. **Time.**

The Contractor agrees to complete all Work, except warranty work, on or before **August 25, 2022**. Further, the Department may deduct from moneys otherwise due the Contractor, not as a penalty, but as Liquidated Damages in accordance with Sections 107.7 and 107.8 of the *State of Maine Department of Transportation Standard Specifications, March 2020 Edition* and related Special Provisions.

C. Price.

The quantities given in the Schedule of Items of the Bid Package will be used as the basis for determining the original Contract amount and for determining the amounts of the required Performance Surety Bond and Payment Surety Bond, and that the amount of this offer is _____

\$ _____ Performance Bond and Payment Bond each being 100% of the amount of this Contract.

D. Contract.

This Contract, which may be amended, modified, or supplemented in writing only, consists of the Contract documents as defined in the Plans, *Standard Specifications, March 2020 Edition, Standard Details March 2020 Edition* as updated through advertisement, Supplemental Specifications, Special Provisions, Contract Agreement; and Contract Bonds. It is agreed and understood that this Contract will be governed by the documents listed above.

E. Certifications.

By signing below, the Contractor hereby certifies that to the best of the Contractor's knowledge and belief:

1. All of the statements, representations, covenants, and/or certifications required or set forth in the Bid and the Bid Documents, including those in the Contract are still complete and accurate as of the date of this Agreement.
2. The Contractor knows of no legal, contractual, or financial impediment to entering into this Contract.
3. The person signing below is legally authorized by the Contractor to sign this Contract on behalf of the Contractor and to legally bind the Contractor to the terms of the Contract.

F. Offer.

The undersigned, having carefully examined the site of work, the Plans, *Standard Specifications March 2020 Edition*, *Standard Details March 2020 Edition* as updated through advertisement, Supplemental Specifications, Special Provisions, Contract Agreement; and Contract Bonds contained herein for construction of:

WIN:027221.00 for construction of a Salt Shed in the Town of Kingfield.

State of Maine, on which bids will be received until the time specified in the “Notice to Contractors” do(es) hereby bid and offer to enter into this contract to supply all the materials, tools, equipment and labor to construct the whole of the Work in strict accordance with the terms and conditions of this Contract at the unit prices in the attached “Schedule of Items.”

The Offeror agrees to perform the work required at the price specified above and in accordance with the bids provided in the attached “Schedule of Items” in strict accordance with the terms of this solicitation, and to provide the appropriate insurance and bonds if this offer is accepted by the Government in writing.

As Offeror also agrees:

First: To do any extra work, not covered by the attached “Schedule of Items,” which may be ordered by the Resident, and to accept as full compensation the amount determined upon a “Force Account” basis as provided in the *Standard Specifications, March 2020 Edition*, and as addressed in the contract documents.

Second: That the bid bond at 5% of the bid amount or the official bank check, cashier’s check, certificate of deposit or U. S. Postal Money Order in the amount given in the “Notice to Contractors”, payable to the Treasurer of the State of Maine and accompanying this bid, shall be forfeited, as liquidated damages, if in case this bid is accepted, and the undersigned shall fail to abide by the terms and conditions of the offer and fail to furnish satisfactory insurance and Contract bonds under the conditions stipulated in the Specifications within 15 days of notice of intent to award the contract.

Third: To begin the Work as stated in Section 107.2 of the *Standard Specifications March 2020 Edition* and complete the Work within the time limits given in the Special Provisions of this Contract.

Fourth: That this offer shall remain open for 30 calendar days after the date of opening of bids.

Fifth: The Bidder hereby certifies, to the best of its knowledge and belief that: the Bidder has not, either directly or indirectly, entered into any agreement, participated in any collusion, or otherwise taken any action in restraint of competitive bidding in connection with its bid, and its subsequent contract with the Department.

IN WITNESS WHEREOF, the Contractor, for itself, its successors and assigns, hereby execute this Agreement and thereby binds itself to all covenants, terms, and obligations contained in the Contract Documents.

CONTRACTOR

Date

(Signature of Legally Authorized Representative
of the Contractor)

Witness

(Name and Title Printed)

G. Award.

Your offer is hereby accepted.
documents referenced herein.

This award consummates the Contract, and the

MAINE DEPARTMENT OF TRANSPORTATION

Date

By: Bruce A. Van Note, Commissioner

Witness

CONTRACT AGREEMENT, OFFER & AWARD

AGREEMENT made on the date last signed below, by and between the State of Maine, acting through and by its Department of Transportation (Department), an agency of state government with its principal administrative offices located at Child Street, Augusta, Maine, with a mailing address at 16 State House Station, Augusta, Maine 04333-0016, and _____ **(Name of the firm bidding the job)** **(Contractor)** a corporation or other legal entity organized under the laws of the State of Maine, with its principal place of business located at _____ **(address of the firm bidding the job)**

The Department and the Contractor, in consideration of the mutual promises set forth in this Agreement (the "Contract"), hereby agree as follows:

A. The Work.

The Contractor agrees to complete all Work as specified or indicated in the Contract including Extra Work in conformity with the Contract, **WIN 12345.00**, for the **Hot Mix Asphalt Overlay** in the town/city of **South Nowhere**, County of **Washington**, Maine. The Work includes construction, maintenance during construction, warranty as provided in the Contract, and other incidental work.

The Contractor shall be responsible for furnishing all supervision, labor, equipment, tools supplies, permanent materials and temporary materials required to perform the Work including construction quality control including inspection, testing and documentation, all required documentation at the conclusion of the project, warranting its work and performing all other work indicated in the Contract.

The Department shall have the right to alter the nature and extent of the Work as provided in the Contract; payment to be made as provided in the same.

B. Time.

The Contractor agrees to complete all Work, except warranty work, on or before **November 15, 2006**. Further, the Department may deduct from moneys otherwise due the Contractor, not as a penalty, but as Liquidated Damages in accordance with Sections 107.7 and 107.8 of the *State of Maine Department of Transportation Standard Specifications, March 2020 Edition* and related Special Provisions.

C. Price.

The quantities given in the Schedule of Items of the Bid Package will be used as the basis for determining the original Contract amount and for determining the amounts of the required Performance Surety Bond and Payment Surety Bond, and that the amount of this offer is (Place bid here in alphabetical form such as One Hundred and Two dollars and 10 cents)
\$ (repeat bid here in numerical terms, such as \$102.10) Performance Bond and Payment Bond each being 100% of the amount of this Contract.

D. Contract.

This Contract, which may be amended, modified, or supplemented in writing only, consists of the Contract documents as defined in the Plans, *Standard Specifications, March 2020 Edition, Standard Details March 2020 Edition*, Supplemental Specifications, Special Provisions, Contract Agreement, and Contract Bonds. It is agreed and understood that this Contract will be governed by the documents listed above.

E. Certifications.

By signing below, the Contractor hereby certifies that to the best of the Contractor's knowledge and belief:

1. All of the statements, representations, covenants, and/or certifications required or set forth in the Bid and the Bid Documents, including those in Appendix A to Division 100 of the *Standard Specifications March 2020 Edition* (Federal Contract Provisions Supplement), and the Contract are still complete and accurate as of the date of this Agreement.
2. The Contractor knows of no legal, contractual, or financial impediment to entering into this Contract.
3. The person signing below is legally authorized by the Contractor to sign this Contract on behalf of the Contractor and to legally bind the Contractor to the terms of the Contract.

F. Offer.

The undersigned, having carefully examined the site of work, the Plans, *Standard Specifications, March 2020 Edition, Standard Details March 2020 Edition*, Supplemental Specifications, Special Provisions, Contract Agreement; and Contract Bonds contained herein for construction of:

WIN 012345.00 South Nowhere, Hot Mix Asphalt Overlay

State of Maine, on which bids will be received until the time specified in the "Notice to Contractors" do(es) hereby bid and offer to enter into this contract to supply all the materials, tools, equipment and labor to construct the whole of the Work in strict accordance with the terms and conditions of this Contract at the unit prices in the attached "Schedule of Items."

The Offeror agrees to perform the work required at the price specified above and in accordance with the bids provided in the attached "Schedule of Items" in strict accordance with the terms of this solicitation, and to provide the appropriate insurance and bonds if this offer is accepted by the Government in writing.

As Offeror also agrees:

First: To do any extra work, not covered by the attached "Schedule of Items," which may be ordered by the Resident, and to accept as full compensation the amount determined upon a "Force Account" basis as provided in the *Standard Specifications, March 2020 Edition*, and as addressed in the contract documents.

Second: That the bid bond at 5% of the bid amount or the official bank check, cashier's check, certificate of deposit or U. S. Postal Money Order in the amount given in the "Notice to Contractors", payable to the Treasurer of the State of Maine and accompanying this bid, shall be forfeited, as liquidated damages, if in case this bid is accepted, and the undersigned shall fail to abide by the terms and conditions of the offer and fail to furnish satisfactory insurance and Contract bonds under the conditions stipulated in the Specifications within 15 days of notice of intent to award the contract.

Third: To begin the Work as stated in Section 107.2 of the *Standard Specifications March 2020 Edition* and complete the Work within the time limits given in the Special Provisions of this Contract.

Fourth: The Contractor will be bound to the Disadvantaged Business Enterprise (DBE) Requirements contained in the attached Notice (Additional Instructions to Bidders) and submit a completed Contractor's Disadvantaged Business Enterprise Utilization Plan with their bid.

Fifth: That this offer shall remain open for 30 calendar days after the date of opening of bids.

Sixth: The Bidder hereby certifies, to the best of its knowledge and belief that: the Bidder has not, either directly or indirectly, entered into any agreement, participated in any collusion, or otherwise taken any action in restraint of competitive bidding in connection with its bid, and its subsequent contract with the Department.

IN WITNESS WHEREOF, the Contractor, for itself, its successors and assigns, hereby execute this Agreement and thereby binds itself to all covenants, terms, and obligations contained in the Contract Documents.

CONTRACTOR

(Print Date here)
Date

(Sign Here)
(Signature of Legally Authorized Representative of the Contractor)

(Witness Sign Here)
Witness

(Print Name Here)
(Name and Title Printed)

G. Award.

Your offer is hereby accepted. documents referenced herein.


This award consummates the Contract, and the

MAINE DEPARTMENT OF TRANSPORTATION

Date

By: Bruce A. Van Note, Commissioner

(Witness)

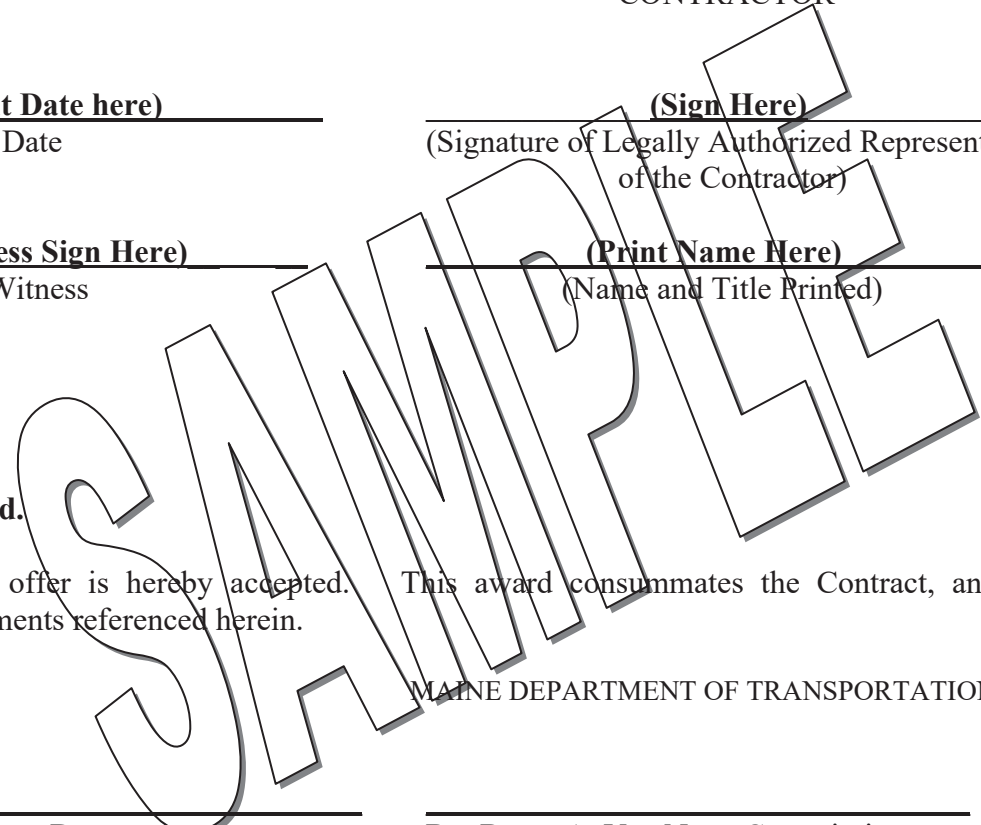

BOND # _____

CONTRACT PERFORMANCE BOND
(Surety Company Form)

KNOW ALL MEN BY THESE PRESENTS: That _____
_____ in the State of _____, as principal,
and.....
a corporation duly organized under the laws of the State of and having a
usual place of business
as Surety, are held and firmly bound unto the Treasurer of the State of Maine in the sum
of _____ and 00/100 Dollars (\$ _____),
to be paid said Treasurer of the State of Maine or his successors in office, for which
payment well and truly to be made, Principal and Surety bind themselves, their heirs,
executors and administrators, successors and assigns, jointly and severally by these
presents.

The condition of this obligation is such that if the Principal designated as Contractor in
the Contract to construct Project Number _____ in the Municipality of
_____ promptly and faithfully performs the Contract, then this
obligation shall be null and void; otherwise it shall remain in full force and effect.

The Surety hereby waives notice of any alteration or extension of time made by the State
of Maine.

Signed and sealed this day of, 20.....

WITNESSES:

SIGNATURES:

CONTRACTOR:

Signature.....

.....

Print Name Legibly

Print Name Legibly

SURETY:

Signature

.....

Print Name Legibly

Print Name Legibly

SURETY ADDRESS:

NAME OF LOCAL AGENCY:

.....
.....
.....

ADDRESS
.....
.....

TELEPHONE.....

.....

BOND # _____

CONTRACT PAYMENT BOND
(Surety Company Form)

KNOW ALL MEN BY THESE PRESENTS: That _____
_____ **in the State of** _____, as principal,
and.....

a corporation duly organized under the laws of the State of and having a
usual place of business in
as Surety, are held and firmly bound unto the Treasurer of the State of Maine for the use
and benefit of claimants as herein below defined, in the sum of
_____ **and 00/100 Dollars (\$** _____ **)**
for the payment whereof Principal and Surety bind themselves, their heirs, executors and
administrators, successors and assigns, jointly and severally by these presents.

The condition of this obligation is such that if the Principal designated as Contractor in
the Contract to construct Project Number _____ in the Municipality of
_____ promptly satisfies all claims and demands incurred for all
labor and material, used or required by him in connection with the work contemplated by
said Contract, and fully reimburses the obligee for all outlay and expense which the
obligee may incur in making good any default of said Principal, then this obligation shall
be null and void; otherwise it shall remain in full force and effect.

A claimant is defined as one having a direct contract with the Principal or with a
Subcontractor of the Principal for labor, material or both, used or reasonably required for
use in the performance of the contract.

Signed and sealed this day of, 20

WITNESS:

SIGNATURES:

CONTRACTOR:

Signature.....

.....

Print Name Legibly

Print Name Legibly

SURETY:

Signature.....

.....

Print Name Legibly

Print Name Legibly

SURETY ADDRESS:

NAME OF LOCAL AGENCY:

.....

ADDRESS


.....

.....


TELEPHONE

.....

Region 3 - Western

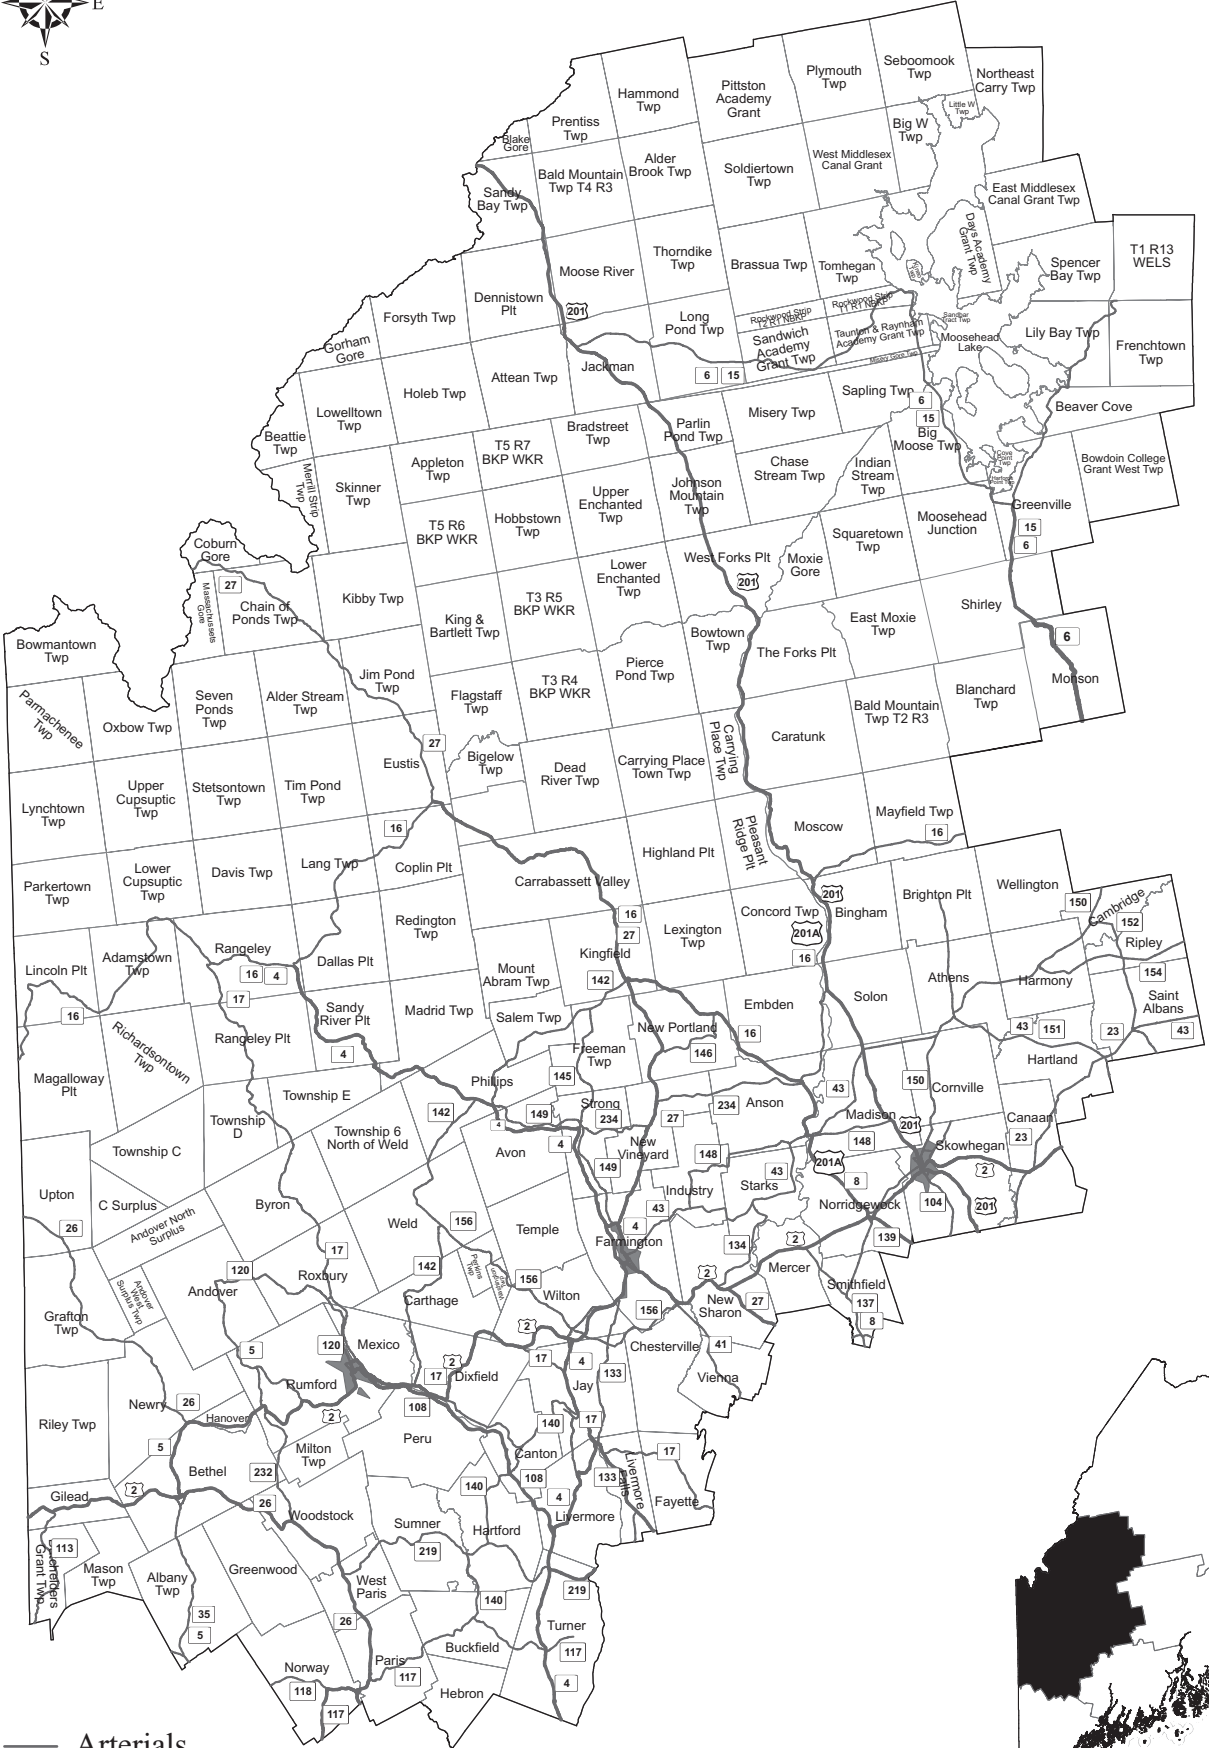

- Arterials
- Major Collectors
- State Urban Areas

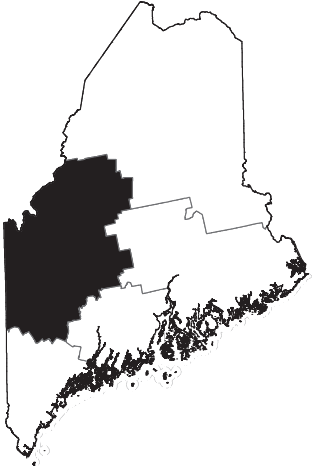

GENERAL NOTES

1. All waste material not used on the project shall be disposed of in acceptable waste areas approved by the Department
2. No separate payment will be made for superintendent or foreman for supervising the work. This will be considered incidental to the contract.
3. All work shall be done in accordance with the Maine Department of Transportation's Best Management Practices for Erosion Control & Sediment Control, February 2008. The Contractor shall be responsible for the Erosion and Sediment Control.
4. The Contractor is responsible for following dig safe requirements and for communicating with and coordinating with any applicable utilities. MaineDOT does not anticipate any utility work on this project. This does not relieve the Contractor of their responsibility.
5. Undetermined Locations" shall be determined by the Department.
6. The Contractor shall be responsible for the payment for temporary electrical services or the use of a generator required to conduct their work.
7. The Contractor shall be responsible for portable toilets and drinking water for their crews and may use on site water for concrete curing
8. The Contractor will coordinate with MaineDOT throughout the duration of the project on schedule, issues, and MaineDOT' s expectations.
9. A test pit was dug on site and ground water was found at approximately five feet below grade. The Contractor shall remove water as required by Standard Specifications to perform the work. This shall be incidental to Item 815.00.

SPECIAL PROVISION
SECTION 103
AWARD AND CONTRACTING
(Post-Bid, Pre-Award Qualifications)

Standard Specification Section 103.3 Post-Bid Qualification Delete the entire section and replace with the following:

After Bid Opening and as a condition for Award of the Contract, the lowest responsive bidder must either be prequalified for the Building Construction category by the Maine Department of Transportation or the Department may require an Apparent Successful Bidder that is not prequalified to demonstrate to the Department's satisfaction that the bidder is responsible, meets the Contractor Requirements set forth in this contract, and is qualified to perform the Work.

If such qualification is required, the Department will provide the Bidder with a written Notice of Post-Bid Qualifications requiring the Bidder to provide written documentation presenting evidence of qualifications.

Contractor Requirements

In order to be considered for the award of this contract, the Bidder and key employees that will be assigned to the Work in this Contract shall have successfully completed projects of similar size and scope and have sufficient experience in Building construction. Said experience shall include, at a minimum, at least three (3) projects of equal or greater complexity than the work required by this Contract completed by the Bidder in the last five (5) years.

Areas of experience shall include, but are not limited to:

- Forming, pouring, and finishing concrete.
- Wood framing.
- Electrical installation.
- Underdrain installation.
- Finish carpentry.
- Roofing.

The Contractor shall maintain current licenses, authorizations, ratings and registrations for the duration of the contract.

The Bidder shall be able to comply with the Contract Requirements, be able to deliver according to the contract schedule, and have a history of satisfactory performance.

The Bidder must have a current, applicable Safety Plan on file with the Department or must submit, prior to Contract award, an acceptable, current Safety Plan or Project and Site Specific Safety Plan to the Department which identifies and addresses job hazards of the expected contract work and complies with all applicable federal, State, and local laws governing safety including all applicable laws and regulations of Occupational Safety and Health Administration (OSHA).

The Bidder may be required to provide any information requested in the “Contractor’s Prequalification Application” form adopted by the Department.

Post-bid Qualification Submittals

The Department will notify the Apparent Successful Bidder of the requirements for post-bid, pre-award qualifications and the Bidder shall provide all of the items within seven (7) days of the notice. The Contractor shall submit two copies or an electronic copy of all required submittals to the Department.

The Bidder may be required to submit evidence of compliance with all Contractor Requirements set forth in this Contract.

If the Bidder does not have a history of satisfactory performance performing similar Work under contracts with the Department that meets the Contractor Requirements regarding experience, the Bidder may be required to submit written documentation setting forth the experience of the Bidder and subcontractor(s) who will be performing the Work specified in the contract documents, including a description of similar construction projects completed in the last five (5) years that highlight the Bidder’s and subcontractors’ related experience. Such information shall include:

1. the Company’s history and experience of work related specifically to the Scope of Work in this contract;
2. the name of the owner for whom the work was performed;
3. the name and telephone number of a contact person;
4. a description of the work performed by the Bidder or their subcontractor; and
5. the total construction cost of each project, and the value of work performed by the Bidder or their subcontractor.

If the Bidder does not have a history of satisfactory performance performing similar Work under contracts with the Department that meets the Contractor Requirements regarding experience, the Bidder may be required to submit written documentation setting forth the experience of the Bidder’s key personnel who will be performing the Work specified in the contract documents, including a description of similar work completed in the last five (5) years that highlight the Bidder’s and subcontractors’ related experience. Such information shall include:

1. the key personnel's experience and number of years performing work related specifically to the Scope of Work in this contract;
2. the name of the owner for whom the work was performed;
3. the name and telephone number of a contact person;
4. a description and value of the work performed by key personnel.

The Bidder may be required to submit the relevant experience of the key personnel and supervisors who will be performing Work under this contract, their experience and number of years performing work related specifically to the Scope of Work in this contract.

The Bidder's submittal may be required to include a statement describing the personnel and equipment available for the Work and demonstrating that the Bidder is able to deliver according to the contract schedule.

If a Bidder has not previously submitted Soil Erosion and Water Pollution Control Plans (SEWPCP) for other Department projects, the Contractor must submit, prior to Contract award, a substantially complete, acceptable, project specific Soil Erosion and Water Pollution Control Plan.

If the Bidder is to provide any information requested in the "Contractor's Prequalification Application" form adopted by the Department, the Notice of Post-Bid Qualifications shall so state.

If a current, applicable copy of the Contractor's Safety Plan is not on file with the Department, the Contractor must submit, an acceptable, current Contractor's Safety Plan or Project and Site Specific Safety Plan to the Department in accordance with Special Provision Section 105 Safety Plan. The plan shall identify and addresses job hazards of the expected contract work and comply with all applicable federal, State, and local laws governing safety including all applicable laws and regulations of Occupational Safety and Health Administration (OSHA).

The Bidder may be required to provide its OSHA 300 Log and its Experience Modification Rate provided by applicable insurance carrier.

Upon receipt of the pre-award submittals, the Department will review the submissions and determine if the submitted evidence or information satisfies the Department requirement that the bidder is qualified to properly carry out the terms of the Contract.

The qualifications submitted will be checked for general conformance with the concept of the project and compliance with the requirements set out in the Contract Documents. This review does not modify the Contractor's duty to comply with the Contract documents. Bidders shall ensure that all information required herein is submitted. Provision of inaccurate information or failure to provide all completed and required

information may result in the Bidder being determined to be “Not Qualified” or disqualified as non-responsive. Within 14 days, the Department will review the required submittals for completeness, conformity with Federal and State requirements, Contract provisions, applicable laws and regulations of Occupational Safety and Health Administration (OSHA), and Department policy and procedures. The Department reserves the right to communicate in writing with Bidders, if needed, to obtain additions to and/or clarification of information contained in the submittals received. Review by the Department, comments by the Department, or any failure to review or comment, shall not absolve the Contractor of its responsibility to develop and implement the Contractor’s Safety Plan or the Project and Site Specific Safety Plan or the SEWPCP in accordance with the Contract, or to shift any responsibility to the Department. The Bidder shall have 3 days to submit additions and clarifications. The Bidder will have no additional opportunity to submit or clarify information. The Department will not provide an opportunity for the Bidder to meet to present evidence.

A Bidder may be determined to be Qualified in accordance with this Special Provision, and still may need to make minor adjustments to the one or more of the plans submitted in order to meet specifications and/or address Department comments. The determination of qualified does absolve the Contractor of the responsibility to submit plans which comply with applicable specifications.

Based on these submissions, the Department will make one of the following determinations:

1. Qualified - The Contractor has satisfied the post-bid, pre-award qualification requirements and demonstrated to the Department’s satisfaction that it is responsible, can meet the Contractor Requirements set forth in this contract, and is qualified to perform this type of work. The Contractor may still be required to make minor revisions to one or more of the plans submitted prior to starting on site work.
2. Not Qualified - Bidder is not qualified to properly carry out the terms of the Contract and/or the submission does not meet specifications and accepted standards and is not acceptable, as determined by the Department.

There is no Appeal process and the determination of "Not Qualified" is final. The Department will reject the bid as non-responsive, and the Award process will proceed without the unqualified Bidder.

The Department will notify the Bidder of its determination in writing. If a determination of “Not Qualified” is rendered, the notice will set forth reasons to the extent practical. Such reasons may include the following:

- A. Not meeting contract Contractor Requirements
- B. Insufficient experience

- C. No Safety Plan or Project and Site Specific Safety Plan or an unacceptable Safety Plan or Project and Site Specific Safety Plan
- D. Default(s) or termination(s) on past or current Contracts.
- E. Failure to pay or settle all bills for labor, Materials or services on past or current Contracts.
- F. Failure to provide Closeout Documentation on past or current Contracts.
- G. Failure to fulfill warranty obligations on past or current Contracts.
- H. Failure to comply with directives of the Department on past or current Contracts.
- I. "Below Standard" performance as determined from the Department's Contractor's Performance Rating process.
- J. Inability of the Contractor to obtain or retain performance or Payment Bonds meeting MDOT requirements.
- K. Failure to accept an Award of a Contract made by the Department to the Contractor.
- L. Making materially false, deceptive, or misleading Statements or omissions, whether or not under oath, regarding a claim on prior Contracts or on the Contractor's Prequalification Application or the Post-Bid Qualifications submittals.
- M. Failure to provide information requested by the Department pursuant to this Special Provision.
- N. Any of the reasons contained in Section 102.02 of the "Rules Regarding Debarment of Contractors", Maine Department of Transportation Register 17-229, Chapter 102 (October 2, 1985).
- O. Debarment or suspension by any federal, State, or local governmental procurement agency or the Contractor's Agreement to refrain from Bidding as part of the settlement with any such agencies.
- P. Other serious misconduct that the Department reasonably determines will substantially and adversely affect the cost, quality or timeliness of Work, or the safety of Workers or the public.

SPECIAL PROVISION
SECTION 104
GENERAL RIGHTS AND RESPONSIBILITIES
(Wage Rates)

104.3.8A. Federal Wage Rates and Labor Laws Delete the entire section 104.3.8A.

104.3.8B State Wage Rates and Labor Laws The State Wage Rates enclosed apply to this work. Federal Wage Rates do not apply to this work.

SPECIAL PROVISION
SECTION 105
GENERAL SCOPE OF WORK
(Limitations of Operations)

1. The Contractor shall notify the Department 48 hours prior to any change in work schedule.
2. Inspections by MaineDOT will be done at key points to be determined by the Department. The Contractor shall plan operations so that the Department will have sufficient advance notification of daily work schedules to provide the necessary inspection and testing. Sufficient notification will be considered 48 hours, unless otherwise agreed by the Department.

SPECIAL PROVISION
SECTION 107
TIME
(Contract Time)

1. The Contractor shall be allowed to commence Work on the Contract provided that the Contract has been awarded, all required plans/submittals have been received and determined to be acceptable by the Department and a preconstruction meeting has been held.
2. The specified Contract Completion Date is August 25, 2022. All Work must be Complete by the Contract Completion Date specified in the Contract, and any authorized extensions.
3. Once operations commence, the Contractor will continue work on the project until it is complete. For every weekday not worked the Contractor will be charged Supplemental Liquidated Damages at the rates given for liquidated damages in Section 107.7.2 of the Standard Specifications; excluding days lost to inclement weather, holidays, and approved absences.
4. Work can be performed at any time except Sundays and Holidays and as provided in Special Provision, Section 107, Contract Time.
5. No work will be allowed on Saturdays without consent from the MaineDOT. Requests to work Saturday must be made by **NOON** time on Thursday.
6. Completion of Physical Work occurs when the Work is complete and has undergone a successful final inspection. Liquidated Damages will cease upon the physical completion of the Work. Completion occurs when the Contractor has finished all Work pursuant to the Contract, the Work is complete and has undergone a successful final inspection and delivered documentation is complete and accepted. Completion does not mean substantial Completion.

SPECIAL PROVISION
SECTION 502
STRUCTURAL CONCRETE
(Cast-in-Place Concrete)

PART 1 – GENERAL

1.1 Summary

This work shall consist of furnishing and constructing all cast-in-place Portland Cement Concrete as shown on the contract drawings and as required to complete the work. This work includes all steel reinforcement, form work, anchor bolts, sleeves and any other accessories necessary to complete the work. All concrete mixes must be batched and designed in accordance with this specification and the approved design.

1.2 References

All work shall comply with the applicable provisions of the following codes:

- A. American Concrete Institute ACI-318-08 “Building Code Requirements for Structural Concrete and Commentary”
- B. American Concrete Institute ACI-301-10 “Specifications for Structural Concrete”.
- C. Concrete-Reinforcing Steel Institute CRSI Handbook, 10th Edition.
- D. ASTM C94 Standard Specification for Ready-Mixed Concrete.

1.3 Submittals

At least 30 days prior to the first placement, a concrete mix design shall be submitted by the contractor to the Department for approval. No concrete shall be placed on the project until the concrete mix design has been approved by the Department. The mix design submitted by the contractor to the Department shall include the following information:

- A. Description of individual coarse aggregate stockpiles, original source, bulk specific gravity, absorption and gradation. A combined coarse aggregate blended gradation shall be provided.
- B. Description of fine aggregate, original source, bulk specific gravity, absorption, colorimetric, gradation, and Fineness Modulus (F.M.).
- C. Description and amount of cement.
- D. Target water-cement ration.
- E. Target water content by volume.
- F. Target strength.
- G. Target air content, slump and concrete temperature
- H. Target concrete unit weight.
- I. Type and dosages of air entraining and chemical admixtures.

Approval by the Department will be contingent upon the ability of the mix design proportions to produce the concrete strength requirement and other factors that may affect durability.

The Contractor shall provide the Department with at least two copies of shop drawing for all reinforcing steel and other accessories to be cast-in-place. Shop drawings shall be submitted at least 30 days in advance of concrete placement and shall be reviewed by the Department prior to placement.

1.4 Testing

Concrete acceptance testing will be performed by the Department. The Department will determine the acceptability of the concrete through a quality assurance program. Quality assurance tests will include compressive strength and air content. Concrete sampling for quality assurance tests will be taken at the discharge end of the pump line.

Compressive strength tests will be completed by the Department in accordance with AASHTO T22 at 28 days, except that no slump will be taken. The test average of two concrete cylinders will determine the compressive strength.

Testing for entrained air in concrete shall be in accordance with AASHTO T152.

Concrete not meeting the standards implied in these specifications or as indicated on the Plans shall be removed and replaced by the Contractor and no cost to the Department.

1.5 Quality Assurance

Manufacturer Qualifications: A firm experienced in manufacturing ready-mixed concrete products and that complies with ASTM C 94/C 94M requirements for production facilities and equipment. Measuring and batching of materials shall be performed at a Department approved batching plant.

Determination of the concrete cover over reinforcing steel for structural concrete shall be made prior to concrete being placed in the forms. Bar supports, chairs, slab bolsters, and side form spacers shall meet the requirements of CRSI Chapter 3, Section 2.5 Class 1, Section 2.6 Class 1A or Section 4. All supports shall meet the requirements for type and spacing as stated in the CRSI Manual of Standard Practice, Chapter 3. Concrete will not be placed until the placing of the reinforcing steel and supports have been approved by the Department. If the Contractor fails to secure Department approval prior to placement, the Contractor's failure shall be cause for removal and replacement at the Contractor's expense.

The Contractor shall notify the Department at least 48 hours prior to the placement, when reinforcing steel will be ready for checking. Sufficient time must be allowed for the checking process and any needed repairs.

PART 2 – PRODUCTS

2.1 Concrete

A. Materials

Materials shall meet the requirements specified in the following sections of Division 700 Materials of the “State of Maine, Department of Transportation, Standard Specifications, March 2020 Edition.”

1. Portland Cement and Portland Pozzolan Cement	701.01
2. Water	701.02
3. Air Entraining Admixtures	701.03
4. Water Reducing Admixture	701.04
5. Water Reducing, High Range Admixture	701.0401
6. Set Retarding Admixtures	701.05
7. Curing Materials	701.06
8. Water Stops	701.07
9. Smoothed Surface Asphalt Roll Roofing (Formerly	701.08
10. Heavy Roofing Felt)	
11. Fly Ash	701.10
12. Calcium Nitrate Solution	701.11
13. Silica Fume	701.12
14. Ground Granulated Blast Furnace Slag	701.13
15. Fine Aggregate for Concrete	703.01
16. Course Aggregate for Concrete	703.02
17. Alkali Silica Reactive Aggregates	703.0201
18. Preformed Expansion Joint Filler	705.01

B. Cement

Cement shall be Portland cement conforming to ASTM C-150 for type I, II or III as specified.

C. Aggregates

1. Concrete aggregate shall conform to ASTM Specification C-33. All aggregates shall be free from frozen materials and other impurities.
2. Fine aggregates shall be clean sand free from clay, loam and other deleterious substances.
3. Coarse aggregate shall be durable, clean, crushed stone or gravel, free from clay, loam and other deleterious substances.

D. Water

Water shall be clean and potable containing no deleterious impurities which may be harmful to concrete or accessories.

E. Admixtures

Prohibited admixture: Calcium chloride, thiocyanates or admixture containing more than 0.05% chloride ions are not permitted.

All admixtures products shall be listed on the MaineDOT Qualified Products List. (<https://www.maine.gov/mdot/research/products/>) Certification: Written conformance to the above mentioned requirements and the chloride ion content of the admixture will be required from the admixture manufacturer prior to mix design review by the Department.

2.2 Steel

Reinforcing steel shall conform to ASTM A-615 and be of an approved manufacturer. All bars shall be new, Grade 60 and shall be at the sizes shown on the drawings.

All reinforcing steel shall meet the requirements of Reinforcing Steel, Section 709.01 of the State of Maine, Department of Transportation, Standard Specifications.

Steel accessories shall be at the sizes and types as shown on the Drawings unless otherwise specified and shall include all spaces, chairs, ties and other devices for properly spacing, supporting and fastening reinforcement in place. Anchor bolts shall be F1554, Grade 36 or better and of the sizes and types shown on the Drawings.

2.3 Accessories

Non-shrink Grout shall be listed on the MaineDOT Qualified Products List (<https://www.maine.gov/mdot/research/products/>)

2.4 Joint Sealants

Joint filler shall be listed on the MaineDOT Qualified Products List (<https://www.maine.gov/mdot/research/products/>)

PART 3 – EXECUTION

3.1 Concrete Proportioning

Concrete shall conform to the following requirements:

Min. Strength 28 Day- psi	Max. Size Coarse Agg.	% Air (1%)	Min-Max Slump	Min Chem. Fac.	Max W/C
4000	¾	5-7.5*	2-4**	611 #/CY	0.45

*Target Air is 6% with-1% ; + 1.5% Range

**Min-Max slump is before the addition of water reducing admixtures.

Coarse aggregate for concrete shall meet the requirements of Section 703.02 for Class “A” or “AA”.

3.2 Formwork

All construction form work shall be of sufficient strength and construction to safely withstand the loads imposed, conforming to ACI 347. Forms shall be suitably tied and/or bolted together to maintain the specified dimensions. All exposed corners shall have 3/4 inch chamfer strips unless otherwise specified. Forms shall be built to conform to the dimensions, location, contours and details shown on the Plans. The faces of forms against which the concrete is to be placed shall be dressed smooth and uniform and shall be free from winds, twists, buckles and other irregularities.

Materials – Forms shall be smooth, treated plywood or steel. Plywood forms shall be coated with form oil and steel forms shall be coated with water or other approved substances to facilitate removal. Only non-staining substances shall be used.

All foreign matter within the forms shall be removed before depositing concrete in them.

All forms shall be inspected and approved by the Department prior to placing any concrete within them.

Build into the forms all collars or sleeves required for piping and wiring, and any anchors and inserts as shown on the Drawings.

Forms shall be left in place until the concrete has developed 80 percent of the design strength, and proven by a break of two cylinders. The formwork may be removed 48 hours after the completion of the concrete placement with the approval of the Department and when the following conditions are met:

- A. Immediately after the forms are removed, defects in the concrete surface shall be repaired in accordance with section 502.13 of the “State of Maine, Department of Transportation, Standard Specifications, March 2020 Edition” and the repaired area is thoroughly dampened with water. The surfaces of exposed concrete shall be cured for the remainder of the 7-day curing period by the application of a product listed on the Maine Department of Transportation Prequalified list of curing compounds. The curing compound shall be applied continuously by an approved pressure spraying or distributing equipment at a rate necessary to obtain an even, continuous membrane, meeting the manufacturer’s recommendation but at a rate of not less than 1 gal/200ft² of surface. Other methods of curing concrete may be used with the prior approval of the Department.
- B. Forms and false work, including blocks and bracing, shall not be removed without the consent of the Department. The Department’s consent shall not relieve the Contractor of responsibility for the safety of the work. In no case shall any portion of the wood forms be left in the concrete. As the forms are removed, all projection metal devices that have been used for holding the forms in place shall be removed in accordance with Section 502.10 and the holes shall be filled as required in Section 502.13 of the “State of Maine, Department of Transportation, Standard Specifications, March 2020 Edition”.

Forms shall be removed so as not to damage the concrete.

3.3 Placing Concrete

Placing of all concrete shall be done in accordance with Section 502.11 of the “State of Maine, Department of Transportation, Standard Specifications, March 2020 Edition”.

All concrete shall be placed before it has taken its initial set, in any case, as specified in Section 502.11. Concrete shall be placed in horizontal layers in such a manner as to avoid separation and segregation. A sufficient number of workers for the proper handling, tamping and operation of vibrators shall be provided to compact each layer before the succeeding layer is placed and to prevent the formation of cold joints between layers. Care shall be taken to prevent mortar from spattering on structural steel, reinforcing steel and forms. Any concrete or mortar that becomes dried on structural steel, reinforcing steel or forms shall be thoroughly cleaned off before the final covering with concrete. Following the placing of the concrete, all exposed surfaces shall be thoroughly a cleaned as required, with care not to injure any surfaces.

Concrete in any section of a structure shall be placed in approximately horizontal layers of such thickness that the entire surface shall be covered by a succeeding layer before the underlying layer has taken its initial set. Layers shall not exceed 18 inches in thickness and shall be compacted to become an integral part of the layer below. Should the placement be unavoidably delayed long enough to allow the underlying layer to take initial set or produce a so-called “cold joint”, the following steps shall be taken:

- A. An incomplete horizontal layer shall be bulk-headed off to produce a vertical joint

- B. Horizontal joints shall be treated as required in Section 502.11(f) of the “State of Maine, Department of Transportation, Standard Specifications, March 2020 Edition”.
- C. Portland Cement concreted with a high range, water reducing admixture shall not be placed when the concrete mix temperature is below 5° or above 85°.
- D. Fresh concrete, threatened with rain damage shall be protected by approved means. Sufficient material for covering the work expected to be done in one day shall be on hand at all times for emergency use. The covering shall be supported above the surface of the concrete.

Concrete mixed in transit mixers shall be placed within 90 minutes of addition of water at the plant. Delivery tickets shall state the time of water addition of water at the plant. Delivery tickets shall state the time of water addition or departure from the plant if this is within 10 minutes. If the concrete cannot be placed within the specified time limitations, the Department may require that all cement be added at the job site. No additional water shall be added without consulting the Department. Any additional water added to the concrete on the site is the Contractor’s sole responsibility and risk. The Contractor shall provide a Certificate of Compliance for each truckload of concrete to the Department at the time of the load placement. The Certificate of Compliance shall be a form acceptable to the Department and shall include the following:

- A. Contract Name & Number
- B. Facility/Building Name
- C. Manufacturing Plant (Batching Facility)
- D. Name of Contractor (Prime Contractor)
- E. Date
- F. Time Batched/Time Discharged
- G. Truck No.
- H. Quantity (Quantity Batched this Load)
- I. Type of concrete by Class and Producer Design Mix No.
- J. Cement Brand or Type, and Shipment Certification No.
- K. Temperature of Concrete at Discharge
- L. Target Weights per cubic yard and Actual Batched Weights for:
 - 1. Cement
 - 2. Course Concrete Aggregate
 - 3. Fine Concrete Aggregate
 - 4. Water (including free moisture in aggregates and water added at the project)
 - 5. Admixtures Brand and Quantity (fluid ounces/cubic yard)
- M. Air Entraining Admixture
- N. Water reducing admixtures
- O. Other admixtures
- P. Placement Location

Power vibrators shall be provided to thoroughly consolidate and compact the concrete. Vibrators shall not be used to push or move concrete laterally in forms. Excessive vibration will not be

permitted. A minimum of two (2) power vibrators shall be on the site when pouring the concrete. Vibrators shall be an approved type, with a frequency of 5,000 to 10,000 cycles per minute and shall be visibly capable of properly consolidating the designed mixture. Sufficient vibrators shall be used to consolidate the incoming concrete within 5 minutes after placing.

A float finish for horizontal surfaces shall be achieved by placing an excess of concrete in the form and removing or striking off the excess with a template or screed, forcing the coarse aggregate below the surface. Creation of concave surfaces shall be avoided. After the concrete has been struck off, the surface shall be thoroughly floated to the finished grade with a suitable floating tool. Aluminum and steel floats are not allowed. Float finish, unless otherwise required, shall be given to all horizontal surfaces. The rate of placing concrete shall be limited to that which can be finished without undue delay and shall not be placed more than 10 ft ahead of strike-off. Neat cement paste, dry cement powder or the use of mortar for topping or plastering of concrete surfaces will not be permitted.

Lightweight, vibrating screeds shall be used on slab structures and shall have the following features:

- A. It shall be portable and easily moved, relocated, or adjusted by no more than four persons.
- B. The power unit shall be operable without disturbing the screeded concrete.
- C. It shall be self-propelled with controls that will allow a uniform rate of travel and by which the rate of travel can be increased, decreased or stopped.
- D. It shall have controlled, uniform, variable frequency vibration, end to end.
- E. It shall be fully adjustable for flats, crowns, or valleys.
- F. The screed length shall be adjustable to accommodate the available work area.

When a lightweight vibrating screed is utilized, the concrete shall be placed or cut to no more than ½ in above the finished grade in front of the front screed. The screed shall be operated such that at least 3 ft of concrete is in position in front of the screed.

The texturing of concrete surfaces shall be applied as approved by the Resident. The surface tolerance and texture shall be acceptable to the Resident, or the placement may be suspended until remedial action has been taken. The Resident may order the removal and replacement of material damaged by rainfall.

Immediately after screeding, floating and texturing, the surface of the concrete shall be tested for trueness, by the Contractor, with a 10 ft straightedge and all irregularities corrected at once in order to provide a final surface within the tolerance required. The surface shall be checked both transversely and longitudinally.

Any area that requires finishing to correct surface irregularities shall be retextured. After the concrete has cured the surface may be tested with a 10 ft straightedge or a lightweight profiler. The maximum deviation of surface in inches below 10 foot straightedge is 1/8inch.

3.4 Protection and Curing of Concrete

All concrete shall be placed /protected in accordance with Section 502.08 Cold Weather Concrete of the “State of Maine, Department of Transportation, Standard Specifications, March 2020 Edition”.

Fresh concrete shall be protected from rain, cold and excessive temperature. Concrete shall be placed at atmospheric temperatures between 40°F and 90°F unless authorized by the Department.

Concrete shall not be placed against frozen surfaces. All frost, ice, and snow shall be removed from all material that will be in contact with fresh concrete. Unless authorized by the Resident, the mixing and placing of concrete shall be discontinued when the atmospheric temperature is below 40°F in the shade and dropping and shall not be resumed until the atmospheric temperature is as high as 35°F in the shade and rising. If authorization is granted for the mixing and placing of concrete under atmospheric conditions different from those specified above, the water shall be heated to a temperature not exceeding 180°F. When either the aggregate or water is heated to above 120°F, they are to be combined first in the mixer before the cement is added. If the atmospheric temperature is below 25°F, the aggregate shall also be heated when directed by the Resident. Materials containing frost or lumps of frozen material shall not be used. Stockpiled aggregates may be heated by the use of dry heat or steam. Aggregates shall not be heated directly by gas or oil flame or on sheet metal over a fire. When aggregates are heated in bins, steam coil or water coil heating or other methods that will not be detrimental to the aggregates may be used. The heating apparatus shall be capable of heating the mass uniformly and preventing the occurrence of spots of overheated material. The temperature of the mixed concrete shall be between 55°F and 70°F when it is placed in the forms. Salt or other chemicals shall not be added to the concrete for any reason whatsoever, except by written permission of the Resident. Contractor shall be wholly responsible for the protection of concrete during cold weather operations and any concrete injured by frost action or overheating shall be removed and replaced at the Contractor's expense.

All concrete and its surfaces shall be kept above 50°F for the first four (4) days of the curing period and above 32°F for the remainder of the period. In the 24 hours following the end of the curing period, the temperature of the concrete shall be decreased on a gradual basis, not to exceed a total change of 40°F.

All concrete surfaces, if not protected by forms, shall be kept thoroughly wet either by sprinkling or by the use of wet burlap, cotton mats or other suitable fabric with clean fresh water for a curing period at least 7 days after placing of concrete or until the end of the curing period. Polyethylene sheets shall not be placed directly on the concrete, but may be placed over the fabric cover to prevent drying except as provided in 3.2 Formwork, Section F.

All slabs and wearing surfaces shall be water cured only and kept continuously wet for the entire approved curing period by covering with one of the following systems:

- A. 2 layers of wet burlap,
- B. 2 layers of wet cotton mats,
- C. 1 layer of wet burlap and either a polyethylene sheet or a polyethylene coated burlap blanket,
- D. 1 layer of wet cotton mats and either a polyethylene sheet or a polyethylene coated burlap blanket.

The first layer of either the burlap or the cotton mats shall be wet and shall be applied as soon as it is possible to do so without damaging the concrete surface. Polyethylene sheets shall not be placed directly on the concrete, but may be placed over the fabric cover to prevent drying.

3.5 Finishing

- A. Exposed Concrete
 - 1. After the removal of forms, remove all form ties to at least 1 inch below surfaces. Remove all loose and honeycombed concrete, fins and other surface irregularities.
 - 2. Concrete patching – After cleaning out all holes, honeycombs and other areas to be patched, moisten surface and apply non-shrink grout or a mixture of one part Portland Cement and 3 parts sand, taking care to match the concrete.
 - 3. All concrete which will be exposed to view, shall be hand rubbed using carborundum bricks, burlap or other approved method. Finished surfaces should present a smooth, even appearance of uniform color.
- B. Unexposed Concrete
 - 1. All unexposed concrete shall have tie holes, honeycombs and other holes filled with patching mortar as above. Fins and other irregularities shall be removed so as to present a uniform surface.
 - 2. Unexposed concrete will not require a rubbed finish after patching.
- C. Penetrations – All wall or floor penetrations by pipes, conduit and other inserts shall be sealed with non-shrink grout around entire penetration to provide a watertight finish.

SPECIAL PROVISION
SECTION 503
REINFORCING STEEL

Description This work shall consist of furnishing and placing of reinforcement in accordance with these specifications and in conformance with the Plans, Supplemental Specifications and Special Provisions.

Materials Materials shall meet the requirements of the following State of Maine Standard Specifications Sections of Division 700-Materials.

Reinforcing Steel	709.01
Welded Steel Wire Fabric	709.02

Schedule of Material When the Department does not furnish reinforcing steel schedules, the Contractor shall submit order lists, bending diagrams and bar layout drawings to the Resident for approval. The reinforcing steel shall not be ordered until these lists and drawings are approved. Approval shall not relieve the Contractor of full responsibility for the satisfactory completion of this item. When the Department allows the use of precast concrete deck panels, or any other significant changes that effect the quantity of reinforcing steel, the Contractor shall be responsible for revising the reinforcing steel schedule; the revised schedule shall be submitted to the Resident for approval.

Protection of Material Reinforcement shall be stored on skids or other supports a minimum of 12 in above the ground surface and protected at all times from damage and surface contamination. The storage supports shall be constructed of wood, or other material that will not damage the surface of the reinforcement or epoxy coating. Bundles of bars shall be stored on supports in a single layer. Each bundle shall be placed on the supports in a single layer. Each bundle shall be placed on the supports out of contact with adjacent bundles.

If it is expected that epoxy-coated bars will be required to be stored outdoors for a period in excess of three months, then they shall be protected from ultraviolet radiation.

Fabrication Bending of reinforcing bars and tolerances for bending of reinforcing bars shall be in conformance with the latest edition of “Manual of Standard Practice of the Concrete Reinforcing Steel Institute” and the “Detailing Manual of the American Concrete Institute”. Unless otherwise specifically authorized, bars shall be bent cold.

Placing and Fastening All steel reinforcement shall be accurately placed in the positions shown on the plans and shall be firmly held there during the placing and setting of the concrete. Immediately before placing concrete, steel reinforcement shall be free from all foreign material, which could decrease the bond between the steel and concrete. Such foreign material shall include, but not be limited to, dirt, loose mill scale, excessive rust, paint, oil, bitumen and dried concrete mortar.

Bars shall be fastened together at all intersections except where spacing is less than 1 ft. in either direction, in which case, fastening at alternate intersections of each bar with other bars will be permitted providing this will hold all the bars securely in position. This fastening may be tightly twisted wire. Welding on epoxy-coated reinforcing steel will not be permitted under any condition.

Proper distances from the forms shall be maintained by means of stays, blocks, ties, hangers or other approved means. Blocks used for this purpose shall be precast Portland cement mortar blocks of approved shape and dimensions. Chairs may be used for this purpose and, when used, must be plastic, plastic coated, epoxy coated or plastic tipped. Layers of bars may be separated by precast Portland cement mortar blocks or other approved devices. The use of pebbles, pieces of broken stone or brick, metal pipe or wooden blocks shall not be permitted. The placing of reinforcement as concrete placement progresses, without definite and secure means of holding the steel in its correct position, shall not be permitted except in the case of welded steel wire fabric or bar mats.

Epoxy-coated reinforcing bars supported on formwork shall rest on coated wire bar supports, or on bar supports mad of dielectric material or other acceptable materials. Wire bar supports shall be coated with dielectric material for a minimum distance of 2 from the point of contact with the reinforcing bars. Reinforcing bars used as support bars shall be epoxy-coated. In walls, spreader bars shall be epoxy-coated.

Tie wire for epoxy-coated reinforcing steel shall be soft annealed wire that has been nylon, epoxy or plastic coated.

Field bending or cutting of epoxy-coated reinforcing bars will not be allowed, unless otherwise indicated on the plans or permitted by the Resident. When field bending or cutting is allowed, all damaged coating areas shall be repaired in accordance with the patching requirements.

Bars in the foundation walls shall be placed so as to clear anchor bolts.

When specified on the contract plans, reinforcing steel shall be anchored into drilled holes.

The anchoring material shall be one of the products listed on the Maine Department of Transportation's list of Prequalified Type 3 Anchoring Materials. Installation shall be in accordance with the manufacturer's published recommendations.

At each anchor location, existing reinforcing will be located to avoid drilling through existing bars. Where interferences are found to exist, location adjustments will be determined by the Resident.

Minimum embedment lengths of reinforcing bars shall comply with the manufacturer's published recommendations for the anchoring material selected. These embedment lengths shall

be verified by the Resident before installation of the reinforcing bars. The reinforcing steel lengths indicated on the Plans may be reduced, at the Contractor’s option, to the determined minimum embedment lengths.

Reinforcement shall be inspected and approved by the Resident before any concrete is placed.

Splicing Reinforcing bars shall be spliced in accordance with the requirements of this section, and in the locations shown on the plans. No modifications of, or additions to, the splice arrangements shown on the plans shall be made without the Resident’s prior approval. Any additional splices authorized shall be staggered as much as possible. All splices shall be made in a manner that will ensure that not less than 75% of the minimum clear distance to other bars will be maintained, as compared to the cover and clear distance requirements for the unspliced bar.

Lapped splices shall be made by placing the bars in contact and wiring them together. Splice laps shall be made in accordance with the following table, unless otherwise noted on the plans.

Minimum Lap Splice Length (inches) ¹									
Bar Type	Bar Size								
	#3	#4	#5	#6	#7	#8	#9	#10	#11
Plain	14	18	22	26	33	43	54	68	83
Epoxy Coated	21	27	33	39	50	64	80	103	124

¹ Lap Splice lengths are based on the following parameters: Minimum center to-center spacing between bars of 6 in; nominal yield strength of the reinforcing steel of 60 ksi; minimum 28 –day compression strength of concrete of 4350 psi. When any of the preceding parameters is altered, appropriate minimum lap slice lengths will be determined by the Resident. When lap splices are placed horizontally in an element where the concrete depth below the splice will be 12 in, or more, the indicated lap splice lengths shall be multiplied by a factor of 1.4.

Mechanical couplers may be used for splicing reinforcing bars, provided they are approved by the Resident and conform to the following requirements:

- a. Tension Couplers- Couplers shall be able to develop 1.25 times the theoretical yield strength of the spliced bar in tension. Bolted and wedge-lock type couplers will not be allowed.
- b. Compression Couplers- Coupler shall be capable of maintaining the splice bars in alignment prior to and during concrete placement. For reinforcing bars designed to act in compression, the individual bar ends shall be within 1½° of being “square” to the final 12 in of the bar. Additionally, abutting bar ends shall be in contact, and the angle of the gap between abutting bar ends shall be 3°, or less.
- c. Mechanical Couplers Any mechanical couplers using a threaded splicer and dowel in combination, requiring a lapped splice with the reinforcing bars, shall have a minimum lap

splice length as required by this Section. Welded splices may be made by the “Thermit” process or, with the approval of the Resident, by the shielded metal arc welding process or the self-shielded flux-core arc welding process. The latter two processes shall be used in strict conformation with the requirements of the latest edition of AWS D1.4 “Structural Welding Code – Welding Reinforcing Steel” and any applicable provisions of Section 504, Structural Steel. The Contractor shall submit complete details of their proposed method of making welded splices for the Resident’s approval.

Lapping Sections of welded steel wire fabric shall securely fasten to adjoining sections and overlap. All laps shall be in accordance with Wire Reinforcement Institute Manual of Standard Practice.

Bar mats shall be spliced as required for the individual bars.

Substitution Substitution of different size bars shall not be permitted except with the written authorization of the Resident.

SPECIAL PROVISION
SECTION 656
(Temporary Soil Erosion and Water Pollution Control)

Standard Specification, Section 656.1 and 656.2 are deleted. All applicable Sections of Standard Specification 656 will remain in effect for this Contract.

The information and requirements set forth in this Special Provision will constitute the Soil Erosion and Water Pollution Control Plan (SEWPCP) for this Project. Any costs associated with this Special Provision will be considered incidental to the Contract.

All Work shall be done in accordance with the latest revision of the Maine Department of Transportation Best Management Practices for Erosion and Sediment Control (a.k.a. Best Management Practices manual or BMP Manual). The latest version is dated February 2008 and is available at:

<http://www.maine.gov/mdot/env/documents/bmp/BMP2008full.pdf>

The soil erosion and water pollution control measures associated with this Work are as follows:

1. The on-site person responsible for implementation of this plan, shall be the Contractor's Superintendent or other supervisory employee (the "Environmental Coordinator") with the authority to immediately remedy any deficient controls and shall provide the Resident with their numbers (telephone number, cellular phone and pager numbers, if applicable) where the Environmental Coordinator can be reached 24 hours a day.
2. All areas where soil is disturbed shall be permanently mulched on a daily basis and seeded on a weekly basis (if seeded by hand, it shall be done on a daily basis). All previously mulched areas shall be maintained and re-mulched on a daily basis if bare areas develop until an acceptable growth of grass has been obtained.
3. All disturbed ditches shall receive erosion control blanket or stone rip rap, as required, prior to the end of the working day.
4. Winter stabilization BMPs shall be applied in accordance with the MaineDOT BMP Manual between November 1 and April 15 or during frozen ground conditions.
5. Where necessary, catch basins and drainage inlets shall utilize Storm Drain Inlet Protection in accordance with the MaineDOT BMP Manual.
6. If the Work includes the handling or storage of petroleum products or Hazardous Materials including the on site fueling of Equipment, the Resident must be provided with a Spill Prevention Control and Countermeasure Plan (SPCCP) plan from the Contractor. At a minimum, the SPCCP shall include:

SPECIAL PROVISION
SECTION 656
(Temporary Soil Erosion and Water Pollution Control)

- The name and emergency response numbers (telephone number, cellular phone and pager numbers, if applicable) of the Contractor's representative responsible for spill prevention and response;
 - General description and location of (1) handling, transfer, storage, and containment facilities of such products or hazardous Matter/Substances ("activities and facilities") and (2) potential receptors of such products or hazardous Matter/Substance including oceans, lakes, ponds, rivers, streams, wetlands, and sand and gravel aquifers ("sensitive resources") including potential conveyances (adjacent open and closed drainage systems), the distances between said activities and facilities and said sensitive resources;
 - Description of preventative measures to be used to minimize the possibility of a spill including Equipment and/or Materials to be used to prevent discharges including containment and diversionary structures, inspections and personnel training;
 - A contingency response plan to be implemented if a spill should occur including a list of emergency phone/pager numbers including the Contractor's representative, Maine DEP Spill Response, the National Response Center (if spill enters the water), the Resident, and local police and fire authorities, a list of emergency response equipment and locations and description of the capabilities of the equipment, a description of the general response and clean up protocols by product or Matter/Substances and an overview of the verbal and written notification procedures for federal, state and local officials. For a related provision, see *Standard Specification, Section, 105.2.3 - Project Specific Emergency Planning*.
7. The Environmental Coordinator must inspect and maintain, daily, all controls for the duration of the project.
 8. If the Project Resident directs additional soil disturbance that requires temporary erosion and sedimentation control measures included within this Special Provision, all additional Work will be paid for as Changes Permitted.
 9. If the Project Resident directs additional soil disturbance that requires temporary erosion and Sedimentation control measures not included within this Special Provision, Standard Specification, Section 656.1 will be reinstated and the Contractor shall prepare and submit a SEWPCP and properly implement its approved SEWPCP. All associate costs will be paid for as Extra Work. Any applicable permits shall be obtained by MaineDOT.

SPECIAL PROVISION
SECTION 815
Buildings

Description. The work shall consist of the furnishing and construction of the Salt Shed building at the Maine Department of Transportation Lot located at 558 Main Street, Kingfield, Maine in accordance with these contract documents.

Materials. All backfill, not otherwise specified, shall be Granular Borrow and shall meet the requirements of Section 703.19 Granular Borrow.

Aggregate Subbase shall meet the requirements of Standard Specification, Section 703.06 Aggregate for Base and Subbase – Grading D.

Construction. The Department will provide the Contractor with two (2) horizontal and vertical control points establishing the top of slab elevation and two (2) corners of the slab. The Contractor shall provide the additional layout necessary to complete the Work.

All work shall meet the requirements of governmental agencies having jurisdiction and comply with applicable standards and codes. The Contractor shall submit two (2) copies of shop drawings to Department for review at least 15 calendar days prior to incorporation into the work. Shop drawings shall be approved prior to incorporation into the work.

Roof, siding and paint colors shall be selected by Department from manufacturer's standard colors.

Excavation shall meet the requirements of Section 203 Excavation and Embankment.

When the structure is to rest on an excavated surface other than rock, special care shall be taken not to disturb the bottom of the excavation. If the surface upon which the structure is to rest is disturbed, it shall be regraded and recompacted to the extent directed by the Resident.

Suitable material taken from excavation shall be used in the construction of subgrade and for backfilling as indicated on the plans, or as directed, except that if the volume of suitable excavated material exceeds that required to construct the site to the grades indicated, the excess shall be used as directed or wasted.

If excavated material is not suitable for backfilling, then granular borrow shall be placed at a vertical plane 18" past the end of the footing from 12" below the bottom of the footing up to the final grade elevation as indicated on the plans.

Backfilling shall meet the requirements of Section 203 Excavation and Embankment. Backfilling shall consist of placing suitable material in all spaces not occupied by structures up to the elevation of the existing ground or other elevations shown on the plans or designated. Backfill material shall be granular borrow or other material designated on the plans and shall be at or near optimum moisture content and shall not contain stones larger than 3 in, frozen lumps, chunks of clay, mineral matter or any other objectionable matter.

For reinforced concrete sections, no backfill shall be placed until the masonry has been in place at least 14 days or until concrete cylinders cured with the structure establish that design strength has been reached.

Unless otherwise approved the material shall be deposited and spread upon compacted material in full width layers not more than 8 inches in depth, loose measure. Sand or gravel soils shall be compacted by vibratory type compaction equipment or by pneumatic tired equipment and, if necessary, by the addition of water. The compacting operations shall be continued until each layer is satisfactorily compacted to its full depth and width.

Unless otherwise indicated on the plans or directed, all sheeting and bracing used during structural excavation shall be removed by the Contractor following the completion of the work, and all voids resulting from use of the sheeting and bracing backfilled where necessary.

Subgrades shall be promptly graded and rolled to minimize absorption of water. When excavating results in a subgrade of unsuitable soil, the Resident may require the Contractor to remove the unsuitable material and backfill the area with approved material.

Placing and compacting of Aggregate Subbase shall meet the requirements of Standard Specification, Section 304 Aggregate Base and Subbase Course.

Variations from Materials Specified. Whenever and wherever items have been identified by describing a proprietary product, such identification is intended to be descriptive, but not restrictive, and is used to indicate the quality and characteristics of products that are satisfactory. Bids shall be considered as offering the item specified in the Invitation for Bid. The Department will consider all alternates submitted by the Contractor, but is not bound to accept any which, in its opinion, is not in the Department's best interest and are determined by the Department to be of equal value in all material respects to the proprietary items specified. The evaluation of and determination as to equality of the product offered shall be the responsibility of the Department and will be based on information furnished by the Contractor, as well as information reasonably available to the purchasing activity.

Quality and Standards Materials and manufactured products incorporated into the work shall be new unless otherwise specified, free from defect, and in conformity with the contract. When material is fabricated or treated with another material or where any combination of materials is assembled to form a finished product, any or all of which are covered by specifications, the Department may reject the finished product if any of the components do not comply with the specifications. The Department may reject materials not conforming to the Specifications at any time, and the Contractor shall remove them immediately from the project site unless otherwise instructed by the Department. The Contractor shall not store or use rejected materials on any Department project.

If there is no applicable standard set forth in this contract for particular Work, then the Contractor shall perform that Work in accordance with industry standards prevailing at the time of bid. If the Department determines that Work is non-conforming, the Contractor shall remove, replace, or otherwise correct all unacceptable work as directed by the Department at the expense of the Contractor, without cost or liability to the Department.

Submittals The Contractor shall submit manufacturers' specifications, product data and installation instructions for all items furnished. The Contractor shall not be relieved of responsibility for any deviation from the requirements of the specifications unless the contractor has specifically informed the owner in writing of such deviation at the time of submission and the owner has given written approval to the specific deviation. The Contractor shall not be relieved from responsibility for errors or omissions. No portion of the work shall be commenced until the Department has approved the submittal.

Delivery, Storage, and Handling

- Store materials off the ground and protected from the weather.
- Deliver products in manufacturers' original containers, dry, undamaged, with seals and labels intact.

Installation

- Installation, handling and storage of all materials shall comply with manufacturer's instructions and recommendations.
- The Contractor shall make provisions to allow safe access to the work for the Department in order to inspect the work, facilitate ongoing inspection of the work and to measure the work for payment purposes.
- Complete installation to provide weathertight service.
- Completed installation for the roof shall conform, to all applicable National, State and local codes

Environmental Requirements and Waste Materials All waste materials shall be removed and disposed of in accordance with all federal, state, and local laws.

All materials removed from the site shall be the property of the contractor. Sale of these materials on site, and removal by persons other than the contractor or his personnel, shall be at the risk of the contractor. Once the contract is signed, responsibility for the safety of the public within the confines of the project shall be the responsibility of the contractor. The contractor shall be responsible for any and all materials dropped from his trucks distant from the project. The contractor shall make his own arrangement for disposal of materials taken from the site, and there will be no burning of materials on or adjacent to the site.

Hazardous Materials If the Contractor encounters any condition that indicates the presence of uncontrolled petroleum or hazardous Materials, the Contractor shall immediately stop Work, notify the Department, treat any such conditions with extreme caution, and secure the area of potential hazard to minimize health risks to Workers and the public, and to prevent additional releases of contaminants into the environment. Such conditions include the presence of barrels, tanks, unexpected odors, discoloration of soil or water, an oily sheen on soil or water, excessively hot earth, smoke, or any other condition indicating uncontrolled petroleum or hazardous Materials. The Contractor shall continue Work in other areas of the Project unless otherwise directed by the Department. The Contractor shall comply with all federal, State, and local laws concerning the handling, storage, treatment, and disposal of uncontrolled petroleum or hazardous Material.

Permits, Fees, and Notices. The Contractor shall also acquire, at its sole expense, all licenses, Permits and other permissions that are necessary, appropriate and legally required to perform the Work. The contractor shall give all notices and comply with all laws, ordinances, rules, regulations, and lawful orders of any public authority bearing on the performance of the work. If the contractor performs any work knowing it to be contrary to such laws, ordinances, rules, and regulations, and without such notice to the Department, he shall assume full responsibility therefore and shall bear all cost attributable thereto.

Closeout Procedures. The Contractor shall make final changeover of permanent locks and deliver keys to Department, and complete final cleaning requirements, including touchup painting, touch up and otherwise repair and restore marred exposed finishes to eliminate visual defects.

Final Cleaning. The Contractor shall clean each surface or unit to condition expected in an average commercial building cleaning and maintenance program and comply with manufacturer's written instructions.

1. Clean Project site, yard, and grounds, in areas disturbed by construction activities, including landscape development areas, of rubbish, waste material, litter, and other foreign substances.
2. Sweep paved areas broom clean. Remove petrochemical spills, stains, and other foreign deposits.
3. Remove tools, construction equipment, machinery, and surplus material from Project site.
4. Remove snow and ice to provide safe access to building.
5. Clean exposed exterior and interior hard-surfaced finishes to a dirt-free condition, free of stains, films, and similar foreign substances. Avoid disturbing natural weathering of exterior surfaces. Restore reflective surfaces to their original condition.
6. Remove debris and surface dust from limited access spaces, including roofs, plenums, shafts, trenches, equipment vaults, manholes, attics, and similar spaces.
7. Sweep concrete floors broom clean in unoccupied spaces.
8. Remove labels that are not permanent.
9. Touch up and otherwise repair and restore marred, exposed finishes and surfaces. Replace finishes and surfaces that cannot be satisfactorily repaired or restored or that already show evidence of repair or restoration.
10. Do not paint over "UL" and similar labels, including mechanical and electrical nameplates.
11. Wipe surfaces of mechanical and electrical equipment, and similar equipment. Remove excess lubrication, paint and mortar droppings, and other foreign substances. Replace parts subject to unusual operating conditions.

Closeout Documentation. The following documents shall be added to the required list of closeout documentation:

Project Record Drawings Warranties
Maintenance & Operations Manual

The Contractor shall prepare and submit Project Record Documents, operation and maintenance manuals, and similar final record information.

Warranty The Contractor shall guarantee work for one (1) year from date of Final Acceptance by the Department. The Physical Work must be Complete and in Conformity with the Contract and the Closeout Documentation, exclusive of the All Bills Paid and Request for Final Payment Letters, in order for the Department to finally "accept" the Project. All defects, including leaks occurring during guarantee period, shall be corrected without cost to the Owner. The contractor unconditionally warrants and guarantees to the owner that all work will be of good quality, free from faults and defects, and in conformance with the specification.

All work not conforming to these requirements, including substitutions not properly approved and authorized, may be considered defective. If required by the owner, the contractor shall furnish satisfactory evidence as to the kind and quality of materials and equipment. If the Department discovers any warranty defects during the warranty period, the Contractor agrees to perform all remedial work, at no additional cost or liability to the Department. Remedial Work will be completed within two weeks unless a more immediate response is required for safety or convenience, as determined by the Department.

The Contractor agrees that the warranty obligations provided by this Contract shall be reported as an outstanding obligation in the event of bankruptcy, dissolution, or the sale, merger, or cessation of operations of the Contractor.

Operations and Maintenance Manual The Contractor shall prepare operation and maintenance manuals, including the following:

- Emergency data.
- Operation data for systems, subsystems, and equipment.
- Maintenance data for the care and maintenance of systems and equipment.

Method of Measurement The Salt Storage Building will be measured for payment as one lump sum, complete in place and accepted.

Basis of Payment The Salt Storage Building will be paid for at the contract lump sum price, complete and accepted which shall be full compensation for the work indicated on the plans and as called for in the contract, including excavation, borrow, gravel, concrete foundation, hot mix asphalt pavement, foundation drain pipe, stone, geotextile, the additional underground electrical as noted on the plans, backfill, labor, equipment and materials for building construction and other contract related incidentals necessary to complete the work.

Grading of the backslopes beyond the pavement limits, loam, seed and mulch will be the responsibility of the Department.

Payment will be made under:

Pay Item
815.00 Building - Salt Shed

Pay Unit
Lump Sum

SPECIAL PROVISION
SECTION 02724
FOUNDATION DRAIN PIPE

PART 1 – GENERAL

1.1 Summary

- A. Work included: Provide and install non-pressure pipe and fittings of the sizes and types and in the locations shown on the Drawings and as specified herein.

1.2 Delivery, Storage and Handling

- A. Provide all labor necessary to assist the Department to inspect pipe, fittings, gaskets and other materials.
- B. Carefully inspect all materials at the time of delivery and just prior to installation.
- C. Carefully inspect all pipe and fittings for:
 - 1. Defects and damage.
 - 2. Deviations beyond allowable tolerances for joint dimensions.
 - 3. Debris and foreign matter.
- D. Examine area and structures to receive piping for:
 - 1. Defects such as weak structural components that adversely affect the execution and quality of work.
 - 2. Deviations beyond allowable tolerance for pipe clearances.
- E. All materials and methods not meeting the requirements of the Contract Documents will be rejected.
- F. Immediately remove all rejected materials from the Project site.
- G. Start work only when conditions are correct to the satisfaction of the Department.

PART 2 – PRODUCTS

2.1 Non-Perforated Pipe and Fittings

- A. Size 4” dia. And 6” dia. Inclusive
 - 1. PVC Schedule 40
 - 2. ASTM D-2665
 - 3. Fittings and joints to be compatible with pipe.

2.2 Perforated Pipe and Fittings

- A. Size 4” dia. And 6” dia. Inclusive:
 - 1. MDOT, TYPE “B” meeting requirements of Section 605.
 - 2. Corrugated Polyethylene Drainage Tubing for underdrain. ASSHTO M-252.

3. Coiled pipe shall not be used.

PART 3 – EXECUTION

3.1 Inspection

- A. Examine areas to receive piping for the following:
 1. Obstructions that adversely affect the installation and quality of the work.
 2. Deviations beyond allowable tolerances for clearances.
- B. Examine pipe and fittings before installation to assure no defective materials are incorporated. No single piece of pipe shall be laid unless it is generally straight.
- C. Remove and replace all defective materials at no additional cost to the Department.
- D. Start work only when conditions are satisfactory.

3.2 Installation

- A. Install all pipe and fittings to the lines and grades shown on the Drawings and/or as approved by the Department.
- B. Begin laying pipe at the downstream end.
- C. During installation, close open ends with temporary watertight plugs to prevent earth, water and other material from entering the pipe.
- D. Exact location of the drain termination shall be determined on site by the Resident.

SPECIAL PROVISION
SECTION 06100
ROUGH CARPENTRY

PART 1 – GENERAL

1.1 Summary

- A. This work consists of all labor, materials and equipment necessary to complete the work as shown on the Drawings and as specified herein.

1.2 References

- A. International Building Code, Latest Edition.

1.3 Workmanship

- A. Only experienced personnel shall be engaged in this work.

1.4 Delivery, Storage and Handling

- A. Deliver the materials to the job site and store in a safe area, out of the way of traffic, shored up off the ground surface and covered to protect from weather.

PART 2 – PRODUCTS

2.1 Dimension Lumber

- A. Dimension lumber shall be Eastern Spruce or other wood approved by the Department and shall comply with grading requirements of the Northeastern Lumber Manufacturers Association for Common, Number 2 or better, and shall bear the grade stamp.
- B. When specified on the Plans or in part 4, stress grade structural lumber shall be provided. Stress grade lumber shall bear appropriate stamp for the specified grade and species.
- C. Wood for pressure treating and special installation shall be southern yellow pine meeting the requirements of the Southern Pine Inspection Bureau (SPIB) for Number 2 or better.
- D. All lumber shall not exceed 19% moisture content.

2.2 Plywood

- A. All plywood shall be 4/5-ply minimum and shall comply with U.S. Product Standard PS-1 for softwood plywood and shall bear the specified grade and stamp of the American Plywood Association.
- B. Unless otherwise shown on the Drawings, plywood shall meet the following requirements:

<u>Use</u>	<u>Thickness</u>	<u>Grade</u>	<u>Glue</u>	<u>Span Rating</u>
Roof	5/8" T&G	OSB Structural 1	Exterior	40/20
Exterior Sheathing	1/2"	OSB Structural 1	Exterior	32/16
Interior Sheathing	1/2"	C-D	Exterior	32/16
Electrical Backboard	3/4"	BC	Exterior	N/A

- C. Unless otherwise shown on the Drawings, all OSB shall be coated oriented strand board (OSB) sheathing in lieu of exterior wall sheathing, equivalent to "Advantech" by Huber Industries. Appropriate Sizes and Grades of plywood may be substituted at the contractor's option.

2.3 Accessories

- A. Nails shall be new, galvanized as appropriate, common nails of appropriate lengths and sizes to adequately join the wood. Use galvanized where exposed to weather or pressure treated lumber or where shown on the Drawings.
- B. Joist hangers, framing anchors shall be 18-gauge, galvanized steel such as manufactured by Kant Sag, Simpson, or approved equivalent.
- C. Special nails shall be used where shown on the Drawings or as recommended by manufacturer.
- D. Glue shall be an all purpose subfloor and construction adhesive, suitable for interior and exterior use, as manufactured by DAP, GE, Ohio Sealants, of approved equivalents.

2.4 Pressure Treated Lumber (P.T.)

- A. Lumber or plywood in contact with ground or fresh water shall be treated in accordance with AWWA Standards C2 and LP-22 and shall be rated 0.60 retention.
- B. Lumber in direct contact with concrete, masonry, or steel, not in contact with soil or fresh water shall be treated in accordance with AWWA Standards C2 and LP-2 and shall be rated 0.40 retention.
- C. Pressure treatment shall be water borne chromate copper arsenate (ACQ).
- D. Wood shall be dried after treatment.

PART 3 – EXECUTION

3.1 Preparation

- A. Carefully select individual lumber pieces so that knots and obvious defects will not interfere with placing bolts or proper nailing.
- B. Cut out and discard defects which render a piece unable to serve its intended function.
- C. Lumber will be rejected by the Department if it is excessively warped, twisted, bowed, mildewed or molded, as well as if it is improperly installed.

3.2 Erection

- A. All framing work shall produce joints which are tight, true, and well nailed with members assembled in accordance with the Drawings and with pertinent codes and regulations.
- B. All framing and fastening shall equal or exceed HUD Minimum Property Standards, Manual of Accepted Practices and the requirements of the IBC.
- C. Do not shim any framing member.
- D. Install horizontal and sloped members with crown up.
- E. Do not notch, cut or bore members for pipes, ducts, conduits, or for any other reason, except as shown on the Drawings and as approved the Department.
- F. Bearing surfaces on which structural members rest shall provide a full, even support.
- G. Joists, rafters and similar members shall be fastened with at least two (2) galvanized steel hangers or anchors and nailed completely.
- H. Install solid block bridging at midpoint of joists or as shown on the Drawings.
- I. Provide all shims, blocking and bracing as shown on the Drawings and as approved by the Department to complete the work.
- J. In addition to normal framing operations, install wood blocking or backing required to support the work of other trades.

3.3 Plywood Sheathing

- A. Unless otherwise specified or approved by the Department, install plywood with the face grain perpendicular to framing and central joints over supports. Leave 1/16-inch gap where adjacent plywood panels meet.
- B. Stagger plywood joints so that all joints do not lie on the same support. Nail as shown in the recommended fastening schedule in this Section.

3.4 Nailing

- A. Use galvanized nails except as otherwise indicated. Make tight connections between members. Countersink nail heads on exposed carpentry work and fill holes.
- B. Install fasteners without splitting wood; pre-drill as required.
- C. All nailing shall comply with the IBS, Recommended Fastening Schedule (found in table 2304.9.1), unless special requirements are shown on the Drawings.

3.5 Concrete Bearing

- A. All wood which bears against concrete, earth, steel or masonry shall be pressure treated as specified on the Drawings or as approved by the Department.

SPECIAL PROVISION
SECTION 07467
METAL SIDING/ROOFING

PART 1 – GENERAL

1.1 Summary

- A. Provide preformed metal siding and roofing where shown on the Drawings, as specified herein and as needed for a complete and proper installation.
- B. Related Work: Documents affecting work of this Section include, but are not necessarily limited to, Section 06100 - Rough Carpentry.

1.2 Quality Assurance

- A. Use adequate number of skilled workmen who are thoroughly trained and experienced in the necessary crafts who are completely familiar with the specified requirements and the methods needed for proper performance of the work of this Section.

1.3 Submittals

- A. Product Date: Within 15 calendar days after the Contractor has received the Department's notice to Proceed, submit:
 - Materials list of items proposed to be provided under this Section
 - Manufacturer's specifications and other data needed to prove compliance with the specified requirements.
 - Shop drawings in sufficient detail to show fabrication, installation, anchorage and interface of the work of this Section with the work of adjacent trades;
 - Sample of two (2) full panel width by 6" length of finished exterior siding, interior liner and permanent trim pieces.
 - Sample of each fastener employed, one each.
 - Manufacturer's recommended installation procedures which, when approved by the Department, will become the basis for accepting or rejecting actual installation procedures used on the work.

PART 2 – PRODUCTS

2.1 Preformed Metal Siding and Roofing

- A. Metal siding shall be 26 gauge Everlast II with a galvalume finish, or equivalent.
- B. Panels shall be a maximum length possible to minimize end laps.

2.2 Accessory Items

- A. Provide subgirts, perimeter trim, closures and other required components as needed to comprise the complete preformed metal siding system, using the materials and gauges recommended by the manufacturer and approved by the Department, and providing finish on exposed surfaces precisely matching the finish on the other exposed surfaces.
- B. Provide fasteners, washers and sealants as recommended by the manufacturer.

PART 3 - EXECUTION

3.1 Surface Conditions

- A. Examine the areas and conditions under which work of this Section will be performed. Correct conditions detrimental to timely and proper completion of the work. Do not proceed until unsatisfactory conditions are corrected.

3.2 Installation

- A. Install the work of this Section in strict accordance with the manufacturer's recommended installation procedures as approved by the Department.
- B. Set siding and roofing plumb, level and true to line, without warp or rack, to a tolerance of 1 in 600.
- C. Touch up mars, scratches, and cut edges to match original finish.

SPECIAL PROVISION
SECTION 07920
SEALANTS AND CAULKING

PART 1 – GENERAL

1.1 Summary

- A. Provide all labor, materials and equipment to complete sealing and caulking as shown on the drawings and as specified herein.

1.2 Scope of Work

- A. Sealing and caulking shall be performed on all exterior joints including but not limited to:
 - 1. Around door, frames and windows.
 - 2. Joints around wall, ceiling and penetrations such as electrical boxes, pipes, etc.
 - 3. Joints between dissimilar building materials such as brick and wood, wood and metal, etc., where water might enter.
- B. Interior caulking of all wall, floor, and ceiling penetrations.
- C. Sealing of concrete joints is covered on the plans.

1.3 References

- A. All sealants and caulking shall comply with ASTM C920, Standard Specification for elastomeric joint sealants.

PART 2 – PRODUCTS

2.1 Exterior Caulking

- A. Exterior caulking between prefinished surfaces shall be a one component silicone joint sealant; “Spectrum 1” by Tremco Sealant Systems, Dow Corning “795 Silicone Building Sealant”, or approved equivalent.
- B. Exterior caulking for use on paintable surfaces shall be an acrylic latex joint sealant; “Tremco Acrylic Latex Caulk”; Bostik “Chem-Caulk 600”, or approved equivalents.

2.2 Interior Caulking

- A. Interior caulking for bedding electrical boxes, outlets, pipes or other wall penetrations and around interior doors, frames and windows shall be a non-hardening sealant; “Tremco Acoustical Sealant”, Bostik “Chem-Caulk 600”, or approved equivalents.
- B. Interior caulking per penetrations through fire wall or smoke barriers such as conduits, pipes and ducts shall be a one component fire resistant caulk or putty; 3M Fire Barrier Caulk “CP25” or Putty “303”, or approved equivalents.

2.3 Joint Filler

- A. Joint filler for backing caulking shall be non-absorbent precompressed foam sealant; “Will-Seal 150”, by Will-Seal Construction Foams; “York-Seal 100” by York Manufacturing, Inc., or approved equivalents.

PART 3 – EXECUTION

3.1 Preparation

- A. All joints and spaces to be caulked shall be dry, clean and free from dust and loose materials.
- B. If necessary mask or otherwise protect adjacent surfaces.

3.2 Installation

- A. All sealants and caulking shall be installed according to the manufacturer’s recommendations.
- B. Caulking shall be applied with suitable equipment such as with a caulking gun.
- C. Use foam backing for joints deeper than ½-inch. Pack into joint allowing at least ¼-inch for caulking.
- D. Caulking shall be applied so that surfaces are slightly concave, tight and smooth. Joints shall be air and water tight.
- E. Caulk or putty around fire and smoke wall penetrations shall be applied so as to provide a complete fire barrier sealing system.
- F. Remove excess caulking and clean adjacent surfaces with approved cleaners.

SPECIAL PROVISION
SECTION 08250
DOORS, FRAMES AND HARDWARE

PART 1 – GENERAL

1.1 Summary

- A. This work shall include all labor, materials and equipment necessary to complete the work as shown on the drawings and as specified herein.

1.2 Submittals

- A. Contractor shall submit two (2) copies of shop drawings to the Department 15 calendar days prior to installation. Only doors for which there are reviewed and approved shop drawings shall be incorporated into the work.

1.3 Quality Assurance

- A. Only experienced skilled workmen shall be engaged in this work.

1.4 Delivery Storage and Handling

- A. Deliver doors and all necessary equipment in manufacturer's unopened containers.
- B. Store material in a protected area to prevent damage.
- C. Protect doors and equipment during and after installation from splashing or the accumulation of paint, concrete, mortar, or other foreign material.

PART 2 – PRODUCTS

2.1 Acceptable Manufacturers

- A. Therma-Tru Smooth Star flush panel fiberglass door.
- B. Sargent Lock Co. 10 lines Series Bored Locks
- C. Approved equivalents.

2.2 Fiberglass Doors and Frames

- A. Fiberglass doors shall be insulated core doors, 1-3/4" thick, of the sizes and type as shown on the drawings and as specified herein.
- B. Frames shall be pre-assembled units made of Grade A pine.

- C. Doorstops, latches, doorknobs, hinges, fasteners, etc., for all doors installed shall be provided by the Contractor.

2.3 Door Hardware

- A. Door hardware shall be equivalent to Sargent.
- B. All hardware shall be lever-style handles with a dull chrome finish.
- C. Door closers shall be full rack and pinion type contained in a permanent mold aluminum body and equipped with a single valve installed on all doors.
- D. Hinges shall be full mortise type, 4"x4", concealed ball bearing, stainless steel, three (3) per door, equivalent to Hager Tri Con Hinges #BB800.
- E. Door stops for interior doors shall be as manufactured by H.B. Ives, wall mounted #65 door stop, aluminum finish.

2.4 Weather-stripping

- A. Acceptable Manufacturers:
 - 1. National Guard Products, Inc.
 - 2. Reese
 - 3. Approved equivalents.
- B. Head and jamb weather-stripping shall be nylon brush gasket, National Guard Products #C607, 1/2" X 1/4" or approved equivalent.
- C. Door bottom seal shall be equivalent to National Guard Products aluminum and vinyl seal, and surface mount nylon brush gasket #D698.

PART 3 – EXECUTION

3.1 Doors and Frames

- A. Install units in compliance with the manufacturer's specifications and as approved by the Department.
- B. Frames must be rigid and present a neat appearance.
- C. Frames must be installed with not less than three wall anchors per jamb and an anchor to the floor at each jamb.
- D. The partition shall enter the frame so that the two work as a unit.
- E. Install all units plumb, level, straight and snug fitted.
- F. Take care not to damage door surface, Defects in surface finish such as hammer marks, scratches, and chips shall be repaired to the satisfaction of the Department.

3.2 Hardware

- A. Install hardware on all doors as specified.

- B. Install doorstops for all doors at heights recommended by the manufacturer.
- C. Provide necessary shims and block to properly install units.

3.3 Finish

- A. Paint all doors as shown in Finish Schedule of the Specifications, Section 09000.
- B. All colors and products are to be selected and approved by the Department.

3.4 Cleanup and Protections

- A. Clean all doors completely. Wash all windows with approved glass cleaner.
- B. Protect all door units, replacing any breakage or defective parts until accepted by the Department.

SPECIAL PROVISION
SECTION 08360
OVERHEAD DOORS

PART 1 - GENERAL

1.1 Summary

- A. Work includes the furnishing and installation of overhead door and accessories of the types and sizes in the locations shown on the Drawings.

1.2 Shop Drawings

- A. Two copies of the shop drawings shall be submitted to the Department for all doors fabricated off site and to be installed on site.
- B. All shop drawings shall be submitted to the Department for review at least fifteen (15) days prior to incorporation into the work. All shop drawings shall be reviewed and approved by the Department prior to incorporating into the work.

1.3 Delivery, Storage and Handling

- A. Deliver doors and all necessary equipment in manufacturers unopened containers.
- B. Store materials in a protective area to prevent damage of any nature.
- C. Handle using manufacturer's recommendations.

1.4 Protection

- A. Protect doors and equipment during and after installation from splashing or the accumulation of paint, concrete, mortar or other foreign material.

PART 2 – PRODUCTS

2.1 Materials

- A. Doors shall be of the following construction:
 - 1. 1½" minimum thick sections.
 - 2. Galvalume interior and exterior skin.
 - 3. Thermal break between all interior and exterior metal skin.
- B. Acceptable manufacturers:
 - 1. Overhead Door Corporation Thermacore, Series 591
 - 2. Raynor Company, ThermaSeal Basic
 - 3. Approved Equivalents.

2.2 Seals

- A. Doors shall be equipped with the following seals:
 - 1. Joint seals between sections.
 - 2. Perimeter seals on ends of the exterior surface.
 - 3. A top seal in the top section to seal against the header.
 - 4. An astragal on the bottom section.
- B. Doors shall have an air infiltration rate of 0.1 CFM/ft at a pressure difference of 0.112 H O.
- C. All seals shall be factory installed.

2.3 Weather-stripping

- A. Head and jamb weather-stripping shall be EPDM rubber tube seals and door bottoms shall be rubber bulb-type seal.

2.4 Tracks and Hardware

- A. Doors shall be equipped with 3" galvanized tracks.
- B. Track rollers shall be hardened steel with ball bearing.
- C. Tracks shall be angle mounted at 45° or as approved by the Department.
- D. Hinges shall be galvanized steel, strap type hinge with 20 gauge reinforcement strips at each hinge location.
- E. Doors shall be installed on high lift tracks.
- F. Contractor shall build door jamb as required for proper installation of all door tracks and hardware.

2.5 Operators

- A. Provide Hoist type door operator Min 1/2 HP, equivalent to LiftMaster Model H-75-11 L4.
- B. Provide three-button control. Up/Down/Stop in waterproof box.
- C. Provide auxiliary chain hoist.
- D. Provide solenoid break to prevent door coasting.
- E. Provide emergency manual operation feature.
- F. Provide external radio control terminals.

2.6 Options

- A. Doors shall be equipped with a bottom-sensing edge that stops or reverses the door's travel when meeting an obstruction.

2.7 Warranty

- A. Doors and hardware shall have a manufacturer's warranty for one year for all materials and workmanship.

PART 3 – EXECUTION

3.1 Installation

- A. Install doors and hardware in accordance with approved shop drawings and manufacturer's instructions.
- B. Test operation of doors and make all necessary adjustments to insure proper operation.

Part 4 – SUPPLEMENTAL SPECIFICATIONS

4.1 Door Size

- A. Door shall be 18'-0" high and 16'-0" wide as indicated on contract drawings.

SPECIAL PROVISION
SECTION 09900
PAINING

PART 1 – GENERAL

1.1 Summary

- A. This work shall consist of all labor, materials and equipment necessary to complete painting as shown on the Drawings and as specified herein.
- B. In general, all unfinished surfaces shall be painted or stained unless otherwise specified.

1.2 Submittals

- A. Contractor shall submit color samples, manufacturer and paint specifications to the Department for review fifteen (15) days prior to incorporation into the work. Provide two (2) copies of product information.

1.3 Scope of Work

- A. This work shall include prefinishing and painting or staining of all exposed surfaces and specified unexposed surfaces, except factory or prefinished surfaces. Also included is touching up of prefinished surfaces as required and/or as approved by the Department.

PART 2 –PRODUCTS

2.1 Paint

- A. All materials shall be top quality products of the type and texture as shown on the Drawings and/or as specified in Part 4 of these specifications.
- B. Acceptable manufacturers include: Glidden, Olympic, California, Benjamin Moore, Sherwin Williams and other approved equivalents.
- C. All colors shall be as selected by the Department from samples submitted by the Contractor.

2.2 Painting Accessories

- A. Turpentine shall be pure gum spirits conforming to ASTM DB-65.
- B. Putty shall be as recommended by paint or stain manufacturers and as approved by the Department.

PART 3 – EXECUTION

3.1 Preparation

- A. Prior to painting or staining ensure that all surfaces are finished and ready for application.
1. Wood Surfaces:
 - Stain to smooth finish and clean all dust from surfaces. Fill any nail holes, cracks, and other irregularities with approved putty. Pre-color all putty to be used under natural finish wood.
 - Shellac all knots and pitch streaks or pockets to prevent bleeding.
 - Apply prime coat as recommended by manufacturer. Sand lightly where necessary to smooth surface.
 2. Metal surfaces:
 - Clean all grease, rust and dirt from surface. Feather edges of chipped paint on pre-painted items.
 - If so approved by the Department, sandblast or wire brush all metal surfaces to obtain a suitable surface for painting. This procedure will normally be required for refinishing previously painted surfaces which are chipping or peeling.
 - Prime metal surfaces with approved metal primers.
 - Galvanized and prefinished surfaces shall not to be painted unless specified in Painting Schedule.

3.2 All Surfaces

- A. Apply paint or stain only to clean, dry surfaces. Do not paint or stain in the rain or in very humid conditions.
- B. Use masking tape, drop cloths and other means protection to adequately protect adjacent surfaces from dip, spatters and overruns.

3.3 Application

- A. Apply paint or stain as recommended by the manufacturer on properly prepared surfaces according to the paint schedule in Part 4 of these Specifications.
- B. Thoroughly brush or roll all coats to achieve a uniformly smooth coverage.
- C. Allow each coat to dry 48 hours or longer if recommended by manufacturer before applying subsequent coats.
- D. Do not apply paint, stain, varnish or shellac when temperatures are below 45°F unless provision for heating is made.
- E. All finishes shall be smooth, free from runs and sags, streak, brush fibers and other defects. All edges shall be straight and sharp.
- F. Refinish and paint to match any existing adjacent areas which were distributed as a result of the work.

3.4 Cleanup and Protection

- A. Clean all areas of drippings, spatters and debris. Remove all masking tape and clean glass and other areas as required.
- B. Touch up all defective areas to the satisfaction of the Department.
- C. Protect all surfaces until acceptance by the Department.

3.5 Touch-Up Materials

- A. Partially used cans shall also be left with the Owner.

PART 4 – SUPPLEMENTAL SPECIFICATIONS

4.1 Paint Schedule

SURFACE	PRIMER	FINISH
Fiberglass Door and Frame	1 Coat Acrylic Latex	2 Coats Acrylic Latex Semi-gloss
Interior Plywood and misc. wood	1 Coat Acrylic Latex	2 Coats Acrylic Latex Egg Shell

SPECIAL PROVISION
SECTION 16500
Lighting

PART 1 – GENERAL

1.1 Summary

- A. This work shall include all labor, materials and equipment necessary to install lighting fixtures and accessories as shown on the drawings and as specified herein.
- B. All work shall conform to the National Electrical Code and other applicable codes.

1.2 Submittals

- A. Contractor shall submit two (2) copies of all lighting equipment and accessories to the Department at least fifteen (15) days prior to incorporation into the work.
- B. Provide photometric data on all lighting units.

1.3 Permits

- A. Contractor shall obtain and pay for electrical permit from local electrical inspector.
- B. Copies of permit shall be sent to the Department.

PART 2 – PRODUCTS

2.1 Interior Lights

- A. H.E. Williams Fully Enclosed & Gasketed Industrial LED Light Fixture,
Model # 96-8-L80/830-HIAFR-SSCMB/SSLATCH-DRV-120
With Occupancy Sensor #OCCWS HB350W-L4W-120

2.2 Exterior Lights

- A. LED Flood Light Equivalent to Lithonia D-Series Size 3 with Photocell and switch.

PART 3 – EXECUTION

3.1 Installation

- A. Install light fixture where shown on the drawings, complete with lamps, lenses and all accessories securely fastened in place.

- B. Follow manufacturer's instructions and recommendations completely.
- C. Light fixtures shall be installed in accordance with the latest edition of the "National Electrical Code"

3.2 Cleanup and Testing

- A. Test all fixtures and equipment to the satisfaction of the Department.
- B. Repair or replace any defective fixtures, lamps or finishes.
- C. Clean all fixtures and lenses at the completion of the project.

3.3 Warrantee

- A. All materials and work shall be warranted for one (1) year from date of acceptance by the Department.
- B. Contractor shall supply a minimum of 10% spare lamps and 5% spare ballasts to the Department at completion.
- C. Any additional lamps beyond the spares provided shall be replaced at no additional cost to the Department during the warranty period.

SPECIAL PROVISION
SECTION 066500
EXTERIOR SYNTHETIC TRIM

PART 1 - GENERAL

1.1 Summary

A. Section Includes:

1. Exterior synthetic wood trim.
2. Shop finishing.

B. Related Sections:

1. Division 01: Administrative, procedural, and temporary work requirements.

1.2 References

- A. ASTM C1185 – Standard Test Methods for Sampling and Testing Non-Asbestos Fiber-Cement Flat Sheet, Roofing and Siding Shingles, and Clapboards.
- B. ASTM D 570 – Standard Test Method for Water Absorption of Plastics.
- C. ASTM D 1761 – Standard Test Methods for Mechanical Fasteners in Wood.
- D. AWPA E10 – Standard Method of Testing Wood Preservatives by Laboratory Soil-Block Cultures.

1.3 Submittals

- A. Manufacturer's Certification: Submit manufacturer's certification that materials comply with specified requirements and are suitable for intended application.
- B. Warranty Documentation: Submit manufacturer's standard warranty.

1.4 Delivery, Storage and Handling

- A. Do not deliver materials until proper protection can be provided, and until needed for installation.
- B. Store and handle materials in accordance with manufacturer's instructions.
- C. Keep synthetic trim on flat, level surface.

1.5 Warranty

- A. Warranty period for Exterior Synthetic Trim: 20 year limited warranty:
 1. No decay due to rot.

2. No excess swelling from moisture.
3. Resist termite damage.

PART 2 - PRODUCTS

2.1 Manufacturers

A. Acceptable Manufacturers:

1. Boral Composites Inc, phone 888-926-7529, www.boraltrim.com
2. Approved equivalent

2.2 Materials

A. Composition:

1. Post-Industrial Recycled Content: Minimum 68 percent, by weight.
2. Post-Consumer Recycled Content: Minimum 2 percent, by weight.
3. Rapidly Renewable Content: Minimum 5 percent, by weight.
4. Total Recycled and Rapidly Renewable Content: Minimum 75 percent, by weight.
5. Pigments and dyes.

B. Physical Properties:

1. Density, ASTM C 1185: 40 to 50 pcf.
2. Water Absorption, ASTM D 570: Less than 1.5 percent.
3. Fungi Rot, AWWA E10:
 - a. White Rot: Negligible loss.
 - b. Brown Rot: Negligible loss.
4. Termite Resistance: AWWA E1: Greater than 9.0, with 10 being impervious.

C. Mechanical Properties:

1. Flexural Strength, ASTM C 1185: Greater than 1,600 psi.
2. Nail Withdrawal, ASTM D 1761: Greater than 40 lbf.in.

D. Thermal Properties:

1. Coefficient of Linear Expansion, ASTM D 6341, Typical: 1.40E-05 in/in/degree F, tested at minus 30 to 140 degrees F.
2. Flame Spread, ASTM E 84: Less than 25.
3. Smoke Developed, ASTM E 84: Less than 450.

2.3 Finishes

A. Primer.

1. Acrylic based
2. Low VOC
3. Factory applied all sides

2.4 Fasteners

- A. Nails or screws, galvanized or stainless steel

PART 3 - EXECUTION

3.1 Preparation

- A. Prior to installation, examine surfaces to receive exterior synthetic trim.
- B. Do not begin installation until unacceptable conditions are corrected.

3.2 Installation

- A. Install in accordance with manufacturer's instruction at locations indicated on the Drawings.
- B. Do not install exterior synthetic trim in structural or load-bearing applications
- C. Set plumb, level and square.
- D. Install exterior synthetic trim with flush, tight joints.
- E. Install fasteners
 - 1. Maximum of 24 inches on center
 - 2. Within 2 inches of end of boards
- F. Fill nail and screw holes with acrylic caulk, wood filler, or auto body filler.
- G. Repair minor damages to exterior synthetic trim in accordance with manufacturer's instructions.
- H. Painting (IMPORTANT): Trim must be painted with a top coat over the factory-applied primer. Failure to paint the exterior synthetic trim will void the warranty.
 - 1. Apply top coat to exterior synthetic trim over factory-applied primer within 150 days of installing trim.

SPECIAL PROVISION
SECTION 074640
VINYL SIDING AND SOFFITS

PART 1 – GENERAL

1.1 Section Includes

- A. Vinyl siding.
- B. Vinyl trim and accessories.

1.2 Related Sections

- A. Section 06100 - Rough Carpentry: Framing and sheathing.
- B. Section 07900 - Joint Sealers.

1.3 References

- A. ASTM D 256 - Test Method for Determining the Pendulum Impact Resistance of Notched Specimens of Plastics.
- B. ASTM D 635 - Test Method for Rate of Burning and/or Extent and Time of Burning of Self-Supported Plastics in a Horizontal Position.
- C. ASTM D 638 - Test Method for Tensile Properties of Plastics.
- D. ASTM D 648 - Test Method for Deflection Temperature of Plastics Under Flexural Load.
- E. ASTM D 696 - Test Method for Coefficient of Linear Expansion of Plastics.
- F. ASTM D 1929 - Test Method for Ignition Properties of Plastics.
- G. ASTM D 2843 - Test Method for Density of Smoke from the Burning or Decomposition of Plastics.
- H. ASTM D 3679 - Specification for Rigid Poly Vinyl Chloride (PVC) Siding.
- I. ASTM D 4226 - Test Methods for Impact Resistance of Rigid Poly Vinyl Chloride (PVC) Building Products.
- J. ASTM E 84 - Test Method for Surface Burning Characteristics of Building Materials.

1.4 Submittals

- A. Samples: Siding/soffit design, size, and color for approval.
- B. Manufacturer's installation instructions.

1.5 Certificate: Manufacturer's certification that siding/soffit as supplied meets or exceeds the conditions specified herein.

Quality Assurance

- A. Manufacturer: Maintain rigorous production quality control standards to ensure that vinyl siding and soffit will perform as expected for its intended use.

1.6 Delivery, Storage, and Handling

- A. Store products in manufacturer's unopened packaging until ready for installation.
- B. Pack siding and soffits two squares per carton and clearly mark each carton with manufacturer's name, siding style, color, identifying lot number, and VSI Certification Stamp.
- C. Store vinyl siding, soffits, and accessories in clean, dry area, out of direct sunlight.
- D. Handle material to prevent damage. Do not allow cartons to crease.

1.7 Warranty

- A. Upon completion, provide a written transferable, lifetime limited warranty.

PART 2 - PRODUCTS

2.1 Manufacturers

- A. Acceptable Manufacturer: CertainTeed Corporation
PO Box 860
Valley Forge, PA 19482

2.2 Materials

- A. Vinyl Siding and Soffits - General Requirements: Produced from polyvinyl chloride (PVC) compounds meeting ASTM D 3679 requirements for compound class number 2.
 - 1. Vinyl Siding Institute Certified.
 - 2. Average Impact Strength: 3.86 ft. lbs./in. (26.61 kPa) of notch at 73.4 degrees F (23 degrees C), per ASTM D 256.
 - 3. Average Impact Strength: 2.4 ft. lbs./in. (16.55 kPa) of notch at 32 degrees F (0 degrees C), per ASTM D 256.
 - 4. Tensile Strength: 6,700 psi (46,195 kPa), per ASTM D 638.
 - 5. Modulus of Elasticity: 410,000 psi (2,826,850 kPa), per ASTM D 638.
 - 6. Deflection Temperature: 170 degrees F (77 degrees C), per ASTM D 648.
 - 7. Fire Properties:

- a. Average Time of Burning: Less than 5 seconds, when tested in accordance with ASTM D 635.
 - b. Average Extent of Burning: Less than 5 mm, when tested in accordance with ASTM D 635.
 - c. Flame Spread Index: 20 (Class A), when tested in accordance with ASTM E 84.
 - d. Smoke Developed Index: Less than 450, when tested in accordance with ASTM E 84.
 - e. Ignition Temperature: When tested in accordance with ASTM D 1929, no self ignition and no flaming; no smoldering at less than 680 degrees F (360 degrees C).
8. Interlock: Post-form style lock with positive interlock; both ends of panels factory cut and notched for overlap.
 9. Nail Slots: Elongated 1-inch (25 mm) slots spaced approximately 1/4 inch (6 mm) apart in nailing hem to allow for expansion and contraction.
 10. Weep Holes: Small holes under the bottom butt of siding panels to prevent vapor build-up and allow accumulated moisture to escape.

2.3 Siding

A. Vinyl Siding: "Monogram 46" - Double 4-inch Clapboard Vinyl Siding

1. Finish: Rough Cedar
2. Each 8-inch wide horizontal siding panel nominally configured as two 4 inch panels in the clapboard style with 3/4 inch butt height.
3. TriBeam panel reinforcement system with double thick rolled over nail hem.
4. Length: 12 feet 1 inch.
5. Thickness: 0.046 inch.
6. Color: As selected by The Department from manufacturers standards.

2.4 Accessories

A. Standard Accessories:

1. Consistent with shape, size, and properties shown on the drawings and as required for complete installation.
2. Produced from the same compound materials and with comparable properties as the siding.
3. Color: Matching or color coordinated with siding as chosen by The Department.

PART 3 – EXECUTION

3.1 Examination

- A. Confirm that all critical dimensions are as specified on the drawings.
- B. Beginning installation indicates Installer's acceptance of substrate as suitable to accept siding and soffits.

3.2 Preparation

- A. Repair substrate flaws or defects before applying siding or soffits.
- B. Where necessary, fur surfaces to an even plane and free from obstructions before application.

3.3 Installation

- A. Install siding and soffits in accordance with the latest edition of "Vinyl Siding Installation Manual," published by the Vinyl Siding Institute (VSI) and special details from the drawings.
- B. Install vinyl siding, soffits, and accessories in accordance with best practice, with all joint members plumb and true.

3.4 Field Quality Control

- A. After installation of siding and soffits, check entire surface for obvious flaws or defects.
- B. Replace and repair any problem areas, paying close attention to the substrate for causes of the problem.

3.5 Cleaning

- A. After application of siding and soffits, clean as necessary to remove all fingerprints and soiled areas.
- B. Upon completion of siding application, clean entire area, removing all scrap, packaging, and unused materials related to this work.

SPECIAL PROVISION
SECTION 08250
DOORS, FRAMES AND HARDWARE

PART 1 – GENERAL

1.1 Summary

- A. This work shall include all labor, materials and equipment necessary to complete the work as shown on the drawings and as specified herein.

1.2 Submittals

- A. Contractor shall submit two (2) copies of shop drawings to the Department 15 calendar days prior to installation. Only doors for which there are reviewed and approved shop drawings shall be incorporated into the work.

1.3 Quality Assurance

- A. Only experienced skilled workmen shall be engaged in this work.

1.4 Delivery Storage and Handling

- A. Deliver doors and all necessary equipment in manufacturer's unopened containers.
- B. Store material in a protected area to prevent damage.
- C. Protect doors and equipment during and after installation from splashing or the accumulation or paint, concrete, mortar, or other foreign material.

PART 2 – PRODUCTS

2.1 Acceptable Manufacturers

- A. Therma-Tru Smooth Star flush panel fiberglass door.
- B. Sargent Lock Co. 10 lines Series Bored Locks
- C. Approved equivalents.

2.2 Fiberglass Doors and Frames

- A. Fiberglass doors shall be insulated core doors, 1-3/4" thick, of the sizes and type as shown on the drawings and as specified herein.
- B. Frames shall be pre-assembled units made of Grade A pine.

- C. Doorstops, latches, doorknobs, hinges, fasteners, etc., for all doors installed shall be provided by the Contractor.

2.3 Door Hardware

- A. Door hardware shall be equivalent to Sargent.
- B. All hardware shall be lever-style handles with a dull chrome finish.
- C. Door closers shall be full rack and pinion type contained in a permanent mold aluminum body and equipped with a single valve installed on all doors.
- D. Hinges shall be full mortise type, 4"x4", concealed ball bearing, stainless steel, three (3) per door, equivalent to Hager Tri Con Hinges #BB800.
- E. Door stops for interior doors shall be as manufactured by H.B. Ives, wall mounted #65 door stop, aluminum finish.

2.4 Weather-stripping

- A. Acceptable Manufacturers:
 - 1. National Guard Products, Inc.
 - 2. Reese
 - 3. Approved equivalents.
- B. Head and jamb weather-stripping shall be nylon brush gasket, National Guard Products #C607, 1/2" X 1/4" or approved equivalent.
- C. Door bottom seal shall be equivalent to National Guard Products aluminum and vinyl seal, and surface mount nylon brush gasket #D698.

PART 3 – EXECUTION

3.1 Doors and Frames

- A. Install units in compliance with the manufacturer's specifications and as approved by the Department.
- B. Frames must be rigid and present a neat appearance.
- C. Frames must be installed with not less than three wall anchors per jamb and an anchor to the floor at each jamb.
- D. The partition shall enter the frame so that the two work as a unit.
- E. Install all units plumb, level, straight and snug fitted.
- F. Take care not to damage door surface, Defects in surface finish such as hammer marks, scratches, and chips shall be repaired to the satisfaction of the Department.

3.2 Hardware

- A. Install hardware on all doors as specified.

- B. Install doorstops for all doors at heights recommended by the manufacturer.
- C. Provide necessary shims and block to properly install units.

3.3 Finish

- A. Paint all doors as shown in Finish Schedule of the Specifications, Section 09000.
- B. All colors and products are to be selected and approved by the Department.

3.4 Cleanup and Protections

- A. Clean all doors completely. Wash all windows with approved glass cleaner.
- B. Protect all door units, replacing any breakage or defective parts until accepted by the Department.

2020 STANDARD DETAIL UPDATES

Standard Details and Standard Detail updates are available at:
<http://maine.gov/mdot/contractors/publications/standarddetail/>

<u>Detail #</u>	<u>Description</u>	<u>Revision Date</u>
507(20)	Steel Approach Railing 3-Bar	2/11/2021
507(21)	Steel Approach Railing 3-Bar	2/11/2021
507(22)	Steel Approach Railing 3-Bar	2/11/2021
507(23)	Steel Approach Railing 3-Bar	2/11/2021
507(27)	Steel Approach Railing	2/11/2021
526(01)	Portable Concrete Barrier	1/14/2021
526(01A)	Portable Concrete Barrier	1/14/2021
526(01B)	Portable Concrete Barrier	1/14/2021
526(02)	Portable Concrete Barrier	1/14/2021
526(02A)	Portable Concrete Barrier	1/14/2021
526(03)	Portable Concrete Barrier	1/14/2021
526(04)	Portable Concrete Barrier	1/14/2021
526(04A)	Portable Concrete Barrier	1/14/2021
526(04B)	Portable Concrete Barrier	1/14/2021
603(10)	Concrete Pipe Ties	6/10/2021
605(01)	Underdrain	8/13/2021
606(23)	Standard Bridge Transition – Type “1”	2/11/2021
606(24)	Standard Bridge Transition – Type “1A”	2/11/2021
608(02)	Detectable Warnings	6/10/2021
609(09)	Precast Concrete Vertical Curb	2/11/2021
643(11)	ATCC Cabinet	12/14/2020
801(11)	Pedestrian Ramp Notes	6/10/2021
801(12)	Pedestrian Ramp Requirements	8/13/2021
801(13)	Ramp Length Table	6/10/2021
801(14)	Parallel Pedestrian Ramp	6/10/2021
801(15)	Perpendicular Pedestrian Ramp – Option 1	6/10/2021
801(16)	Parallel Pedestrian Ramp – Option 2A	6/10/2021
801(17)	Perpendicular Pedestrian Ramp – Option 2A	6/10/2021
801(18)	Parallel Pedestrian Ramp – Option 2B	6/10/2021

801(19)	Perpendicular Pedestrian Ramp – Option 2B	6/10/2021
801(20)	Parallel Pedestrian Ramp – Option 3	6/10/2021
801(21)	Perpendicular Pedestrian Ramp – Option 3	6/10/2021
801(22)	Side Street Pedestrian Ramp	6/10/2021
801(23)	Parallel Pedestrian Ramp – Esplanade	6/10/2021
801(24)	Perpendicular Pedestrian Ramp – Esplanade	6/10/2021
801(25)	Island Crossings	6/10/2021
801(26)	Blended Transition	6/10/2021
801(27)	Pedestrian Ramp Adjacent to Driveway or Entrance	6/10/2021
802(05)	Roadway Culvert End Slope Treatment	1/03/2017

SUPPLEMENTAL SPECIFICATIONS
(Corrections, Additions, & Revisions to Standard Specifications – March 2020)

SECTION 102
BIDDING

102.11 Bid Responsiveness Revise the paragraph that states
“The Bid is not signed by a duly authorized representative of the Bidder.” So that it reads:

“The Bid is not signed by a duly authorized representative of the Bidder.

- **Properly submitted electronic bids meet this requirement.**
- **Paper bids must include at least one signed copy of the Contract Agreement Offer & Award form.”**

SECTION 104
GENERAL RIGHTS AND RESPONSIBILITIES

104.2.1 Furnishing of Right-of-Way Revise the last sentence in the first paragraph by removing
“105.4.5 – Special Detours” and replacing it with “**105.4.5 – Maintenance of Existing Structures.**”.

SECTION 106
QUALITY

106.6 Acceptance Revise this Subsection by replacing the paragraph beginning with “Acceptance of Hot Mix Asphalt Pavement will be based” with:

“Acceptance of Hot Mix Asphalt Pavement will be based on Method A or C Statistical Acceptance, or Method B or D Acceptance as specified. The method of acceptance for each item is defined in Special Provision, Section 403, Hot Mix Asphalt Pavement. When items of Hot Mix Asphalt Pavement are not so designated, Method A will be utilized whenever there are more than 1000 tons per Hot Mix Asphalt Pavement item, and Method B will be utilized when there are less than or equal to 1000 tons per Hot Mix Asphalt Pavement item.”

Revise Subsection “B” by removing it and replacing it with:

“B. Items not designated for Statistical Acceptance will utilize Method B or D Acceptance testing to validate the quality of the material incorporated into the Project. For material paid under Item 403.209 – Method D, or designated to be visually accepted, the Contractor shall provide the Department with a Certification Letter that indicates that the material supplied complies with the Specifications. Test results representative of the certified material shall be attached to the letter.

The Department will randomly sample and test the certified Material for properties noted in Table 1 of Section 502 - Structural Concrete or Table 14 of Section –401.21 Acceptance Method B & D. Material will be subject to rejection as noted in Structural Concrete Section 502.195 - Quality Assurance Method C Concrete or Hot Mix Asphalt, Section 401.2022 Pay Adjustment – Method B & D.”

106.7.1 Standard Deviation Method Revise 106.7.1, subsection H by removing the following from the first paragraph:

“Method B: $PF = [70 + (Quality\ Level * 0.33)] * 0.01$ ”

SECTION 110 INDEMNIFICATION, BONDING, AND INSURANCE

110.3.9 Administrative & General Provisions Amend this subsection by adding “**Automobile Liability**” under letter A) Additional Insured to the list of exceptions.

SECTION 206 STRUCTURAL EXCAVATION

206.01 Description – *Structural Earth Excavation, Below Grade* delete the entire sentence and replace with “**shall consist of the removal of excavation required for unknown or unanticipated subsurface condition. See 206.04 – Method of Measurement for pay limits.**”

206.04 Method of Measurement – Drainage and Minor Structures Paragraph 1, sentence 2, delete the remainder of the sentence beginning with “...provided the maximum allowable...”

And replace with: “**...in accordance with the following limits:**”

- **Vertical pay limits:**
 - **Below a plane parallel with and 12 inches below the bottom of the drainage or minor structure or**
 - **Below the excavation limits shown in the Bid Documents; whichever is greater.**

- **Horizontal pay limits – The maximum allowable horizontal dimensions shall not exceed those bounded by vertical surfaces 18 inches outside the base, or extreme limits of, the structure, and to the vertical neat lines of underdrain trenches, as shown in the Contract Documents.**

SECTION 401 HOT MIX ASPHALT PAVEMENT

401.19 Contractor Quality Control Amend this Section by adding the following to the end:

“Failure to comply with the approved QCP will result in work suspension and pay reductions as outlined in Section 106.4.6. The Quality Control Plan Value shall be the total bid value for all items covered by the QCP as identified in Special Provision 403.”

SECTION 502 STRUCTURAL CONCRETE

502.09 Forms and Falsework Amend this subsection by adding the subsection title **“502.10 Placing Concrete”** after section “D” Removal of Forms and False work” and after the paragraph beginning with “2. Forms and False work, including blocking...”. So that a new subsection starts and reads:

“502.10 Placing Concrete

A. **General Concrete shall not be placed until forms”**

502.1701 Quality Control, Method A and B Revise this Section so that the first paragraph and the first sentence of the second paragraph read:

“502.17 Quality Control The Contractor shall control the quality of the concrete through testing, inspection, and practices which shall be described in the QCP, sufficient to assure a product meeting the Contract requirements. The QCP shall meet the requirements of Section 106, Quality, and this specification. No work under this item shall proceed until the QCP is submitted to and approved by the Department. Failure to comply with the approved QCP will result in work suspension and pay reductions as outlined in Section 106.4.6. The Quality Control Plan Value shall be the total bid value for all cast-in-place items covered by the QCP, using the P value listed in Special Provision 502. If no P value is listed, a value of \$350, or bid value per cubic yard, whichever is less, shall be used.

502.1701 Quality Control, Method A and B The QCP shall address all elements that affect the quality of the structural concrete including, but not limited to, the following: “

502.18, Method of Measurement, Revise Subsection ‘F’ by removing the word ‘transverse’ so that it reads: **“Saw cut grooving of concrete wearing surfaces, complete and accepted, will be measured for payment as one lump sum.”**

502.19, Basis of Payment, Revise the third paragraph by removing the word ‘transverse’ so that it reads: **“Saw cut grooving of concrete wearing surfaces will be paid for at the Contract Lump Sum Price, which shall be payment for furnishing all materials, labor, and equipment, including depth gauges and all incidentals, to satisfactorily complete the work.”**

(Also see 535.24 and 535.25 for related changes)

SECTION 506
SHOP APPLIED PROTECTIVE COATING – STEEL

506.13 Surface Preparation Amend this section by adding this paragraph to the end:

“Steel shall meet the requirements of SSPC SP8 Pickling prior to being immersed in the zinc tanks. Verification of the surface preparation shall be included in the QC documentation.”

SECTION 523
BEARINGS

523.22 Fabrication Amend this subsection by adding the following: **“Elastomeric Bearings shall be fabricated in accordance with AASHTO M251.”**

SECTION 526
CONCRETE BARRIER

Amend this section by deleting it in its entirety and replacing it with:

“526.01 Description This work shall consist of the furnishing, constructing, erecting, setting, resetting, and removal of concrete barrier and associated elements in accordance with these specifications, the Standard Details, and the lines and grades shown on the Plans or established by the Resident.

The types of concrete barrier are designated as follows:

Portable Concrete Barrier Type I Double faced removable barrier in accordance with the Standard Details.

Permanent Concrete Barrier Type II Double faced barrier as shown on the Plans.

Permanent Concrete Barrier Type IIIa Single faced barrier 32 inches high in accordance with the Standard Details or as shown on the Plans.

Permanent Concrete Barrier Type IIIb Single faced barrier 42 inches high in accordance with the Standard Details or as shown on the Plans.

Permanent Concrete Transition Barrier Barrier of various heights joining steel bridge rail to steel guardrail in accordance with the Standard Details or as shown on the Plans.

Permanent Texas Classic Rail Barrier Traffic rail or sidewalk rail, in accordance with the Standard Details or as shown on the Plans.

526.02 Materials

a. **Concrete** Concrete for barriers, both permanent and portable, shall have a design strength of 5,000 psi.

For cast-in-place barrier: The concrete shall be Class LP, in accordance with Standard Specification Section 502, Structural Concrete.

For precast barrier: The concrete shall meet the requirements of Standard Specification 712.061, Structural Precast Concrete Units, except that the stripping strength for precast barriers is 4,000 psi.

b. **Reinforcing Steel** Reinforcing steel shall meet the requirements of Section 503, Reinforcing Steel.

c. **Structural Steel** Plates and barrier connections shall meet the requirements specified in Standard Specification 504 - Structural Steel and shall be hot dip galvanized after fabrication in accordance with Standard Specification 506, Shop Applied Protective Coating – Steel

d. **Bolts** Bolts shall meet the requirements specified in Section 713.02, High Strength Bolts.

e. **Connecting Pins for Portable Concrete Barrier** Portable concrete barriers must be connected using a 1- inch diameter pin. The connecting pin must be smooth, not deformed, i.e., reinforcing bar may not be used, and shall meet the strength requirements of ASTM A449 steel. Materials with greater strength may be used with the approval of the Department.

f. **Anchor Pins for Portable Concrete Barrier** Anchoring to concrete or asphalt will be required when specified on the Plans. When required, portable concrete barriers must be anchored using a 1 ½ - inch diameter anchor pin. The anchor pin must be smooth, not deformed, i.e., reinforcing bar may not be used, and shall meet the strength requirements of ASTM A36 steel. Materials with greater strength may be used with the approval of the Department.

g. **Device Crashworthiness** MaineDOT is transitioning to MASH2016 criteria for Portable Concrete Barrier on the following schedule:

New Portable Concrete Barrier shall be crash tested and/or evaluated to MASH2016 criteria.

Current Portable Concrete Barrier in useful serviceable condition that is successfully tested to NCHRP Report 350 or MASH2009 criteria may be utilized through December 31, 2029.

Other current Portable Concrete Barrier that is deemed acceptable by the Department may be utilized on projects off the National Highway System through December 31, 2024.

526.03 Construction Requirements

Cast-in-place barriers shall be fabricated in accordance with Standard Specification Section 502, Structural Concrete. Precast barriers shall be fabricated in accordance with Standard Specification 534, Precast Structural Concrete.

Concrete finish for permanent barrier shall be rubbed as defined in Standard Specification Section 502, Structural Concrete, 502.13 D2 or an approved equal.

Portable concrete barrier shall be generally free from fins and porous areas and shall present a neat and uniform appearance.

Permanent barrier shall have a protective coating applied in accordance with Standard Specification Section 515, Protective Coating for Concrete Surfaces.

Reflective delineators for concrete median barrier shall meet the requirements of Special Provision 645, Highway Signing.

Preformed Joint Filler shall meet the requirements specified in Subsection 705.01, Preformed Expansion Joint Filler.

Permissible dimensional tolerances for all concrete barriers shall be as follows:

- a. Cross-sectional dimensions shall not vary from design dimensions by more than $\frac{1}{4}$ inch. The vertical centerline shall not be out of plumb by more than $\frac{1}{4}$ inch.**
- b. Longitudinal dimensions shall not vary from the design dimensions by more than $\frac{1}{4}$ inch per 10 feet of barrier section and shall not exceed $\frac{3}{4}$ inches per section.**
- c. Location of anchoring holes shall not vary by more than $\frac{1}{2}$ inch from the dimensions shown in the concrete barrier details on the Plans.**
- d. Surface straightness shall not vary more than $\frac{1}{4}$ inch under a 10-foot straightedge.**
- e. The barrier shall have no significant cracking. Significant cracking is defined as fractures or cracks passing through the section, or any continuous crack extending for a length of 12 inches or more, regardless of position in the section.**

526.04 Method of Measurement Permanent Concrete Barrier Type II, IIIa, IIIb, Texas Classic Rail, and Precast Median Barrier will be measured for payment by lump sum, complete in place.

Portable concrete barrier, both anchored and unanchored will be measured for payment by lump sum. Lump sum measurement will include verification of the installation and removal of all portable concrete at the completion of the Contractor's operations.

The Contractor shall replace sections of portable concrete barrier, including anchored barrier damaged by the traveling public when directed by the Resident. Replacement sections will be measured for payment in accordance with Standard Specification 109.7, Equitable Adjustments to Compensation and Time.

Transition barrier will be measured by each, complete in place.

526.05 Basis of Payment The accepted quantities of Concrete Barrier Type II, IIIa, IIIb, Texas Classic Rail, and Precast Median Barrier will be paid for at the Contract lump sum price for the type specified, complete in place.

The accepted quantities of Portable Concrete Barrier Type I, both anchored and unanchored will be paid for at the Contract lump sum price. Such payment shall be full compensation for furnishing all materials, assembling, moving, resetting, transporting, temporarily storing, removing barrier, furnishing new parts as necessary, and all incidentals necessary to complete the work.

Portable barrier shall become the property of the Contractor upon completion of the use of the barrier on the project and shall be removed from the project site by the Contractor.

Transition barrier will be paid for at the Contract price each, complete in place.

The accepted quantity of all types of concrete barrier, whether portable or permanent, will be paid for at the lump sum or per each price, as applicable, which payment shall be full compensation for all materials, including reinforcing steel, protective coating, reflective delineators, steel plates and hardware, equipment, labor and incidentals required, as necessary, to complete the work.

Payment will be made under:

	<u>Pay Item</u>	<u>Pay Unit</u>
526.301	Portable Concrete Barrier, Type I	Lump Sum
526.304	Portable Concrete Barrier, Anchored Type I	Lump Sum
526.312	Permanent Concrete Barrier Type II	Lump Sum
526.321	Permanent Concrete Barrier Type IIIa	Lump Sum
526.323	Texas Classic Rail	Lump Sum
526.331	Permanent Concrete Barrier Type IIIb	Lump Sum
526.34	Permanent Concrete Transition Barrier	Each
526.502	Precast Concrete Median Barrier	Lump Sum”

SECTION 527
ENERGY ABSORBING UNIT

527.02 Materials Amend this section by deleting it in its entirety and replacing it with:

“MaineDOT is transitioning to MASH2016 criteria for Work Zone Traffic Control Devices on the following schedule:

Portable Crash Cushions will be crash tested and/or evaluated to MASH2016 criteria by January 1, 2030. Current Category 3 devices in useful serviceable condition that are successfully tested to NCHRP Report 350 or MASH2009 criteria may be utilized through December 31, 2029.

Work Zone Crash Cushions shall be selected from the Department’s Qualified Products List of Crash Cushions/Impact Attenuators or approved equal.”

SECTION 535
PRECAST, PRESTRESSED CONCRETE SUPERSTRUCTURE

535.24, Installation of Slabs, Beams, and Girders Revise the 5th paragraph by replacing “6.0 and 9.0” to “5.0 and 8.0” so it reads: **“Ready mixed grout shall achieve a design compressive strength of 6,000 psi at 28 days, have an entrained air content of between 5.0 and 8.0 percent, be non-shrink, flowable, and contain a non-shrink additive listed on the Department QPL for expansive cements.”**

535.25, Installation of Precast/Prestressed Deck Panels Revise the 2nd paragraph by replacing “6.0 and 9.0” to “5.0 and 8.0” so it reads: **“Ready mixed grout shall achieve a design compressive strength of 6,000 psi at 28 days, have an entrained air content of between 5.0 and 8.0 percent, be non-shrink, flowable, and contain a non-shrink additive listed on the Department QPL for expansive cements.”**

SECTION 606
GUARDRAIL

Amend this section by replacing it with the following:

606.01 Description This work shall consist of furnishing and installing guardrail components in accordance with these specifications and in reasonably close conformity with the lines and grades shown on the plans or as established. Guardrail is designated as:

31” W-Beam Guardrail - Mid-Way Splice

Galvanized steel w-beam, 8” wood or composite offset blocks, galvanized steel posts

Thrie Beam

Galvanized steel thrie beam, 8” wood or composite offset blocks, galvanized steel posts

Median guardrail shall consist of two beams of the above types, mounted on single posts.

Bridge mounted guardrail shall consist of furnishing all labor, materials, and equipment necessary to install guardrail as shown on the plans. This work shall also include drilling for and installation of offset blocks if specified, and incidental hardware necessary for satisfactory completion of the work.

Remove and Reset and Remove, Modify, and Reset guardrail shall consist of removing the existing designated guardrail and resetting in a new location as shown on the plans or directed by the Resident. Remove, Modify, and Reset guardrail and Modify guardrail include the following guardrail modifications: Removing plate washers at all posts, except at anchorage assemblies as noted on the Standard Details, adding offset blocks, and other modifications as listed in the Construction Notes or General Notes. Modifications shall conform to the guardrail Standard Details.

Bridge Connection shall consist of the installation and attachment of beam guardrail to the existing bridge. This work shall consist of constructing a concrete end post or modifying an existing end post as required, furnishing, and installing a terminal connector, necessary hardware, and incidentals required to complete the work as shown on the plans. Bridge Transition shall consist of a bridge connection and furnishing and installing guardrail components as shown in the Standard Details.

606.02 Materials Materials shall meet the requirements specified in the following Sections of Division 700 - Materials:

Timber Preservative	708.05
Metal Beam Rail	710.04
Guardrail Posts	710.07
Guardrail Hardware	710.08

Guardrail components shall meet the applicable standards of "A Guide to Standardized Highway Barrier Hardware" prepared and approved by the AASHTO-AGC-ARTBA Joint Cooperative Committee, Task Force 13 Report.

Posts for underdrain delineators shall be "U" channel steel, 8 ft long, 2 ½ lb/ft minimum and have 3/8-inch round holes, 1-inch center to center for a minimum distance of 2 ft from the top of the post.

Reflectorized Flexible Guardrail Markers shall be mounted on all guardrails. A marker shall be mounted onto guardrail posts at the flared guardrail terminal end point and tangent point, both at the leading and trailing ends of each run of guardrail. The marker's flexible posts shall be gray with either silver-white or yellow reflectors (to match the edge line striping) at the tangents, red at leading ends, and green at trailing ends. Whenever the guardrail terminal is not flared, markers will only be required at the terminal end point. These shall be red or green as appropriate. Markers shall be installed on the protected side of guardrail posts unless otherwise approved by the Resident. Reflectorized flexible guardrail markers shall be from the Department's Qualified Products List of Delineators. The marker shall be gray, flexible, durable, and of a non-discoloring material to which 3-inch by 9-inch reflectors shall be applied, and capable of recovering from repeated impacts and meeting MASH 16 requirements. Reflective material shall meet the requirements of Section 719.01 for ASTM D 4956 Type III reflective sheeting. The marker shall be secured to the guardrail post with two fasteners, as shown in the Standard Details.

Reflectorized beam guardrail (“butterfly”-type) delineators shall be mounted on all “w”-beam guardrail. The delineators shall be mounted within the guardrail beam at guardrail posts. Delineators shall be fabricated from high-impact, ultraviolet & weather resistant thermoplastic. Reflectorized beam guardrail delineators shall be placed at approximately 62.5 ft intervals or every tenth post on tangents and at approximately 31.25 ft intervals or every fifth post on curves. Exact locations of the delineators shall be as directed by the Resident. On divided highways, the left-hand delineators shall be yellow, and the right-hand delineators shall be silver/white. On two directional highways, the right-hand side shall be silver/white, and no reflectorized delineator used on the left. All reflectors shall have reflective sheeting applied to only one side of the delineator facing the direction of traffic as shown in the Standard Details. Reflectorized sheeting for guardrail delineators shall meet the requirements of Section 719.01.

Single wood post shall be of cedar, white oak, or tamarack, well-seasoned, straight, and sound and have been cut from live trees. The outer and inner bark shall be removed, and all knots trimmed flush with the surface of the post. Posts shall be uniform taper and free of kinks and bends.

Single steel post shall conform to the requirements of Section 710.07 b.

Single steel pipe post shall be galvanized, seamless steel pipe conforming to the requirements of ASTM A120, Schedule No. 40, Standard Weight.

Acceptable multiple mailbox assemblies shall be listed on the Department’s Qualified Products List and shall be MASH 16 tested and approved.

Flared and Tangent w-beam guardrail terminals and guardrail offset blocks shall be from the Department’s Qualified Products List. Flared terminals shall be installed with a 4 ft offset as shown in the Manufacturer’s installation instructions.

Anchorage assemblies used to anchor trailing ends, radius guardrail, or other ends not exposed to traffic shall meet the applicable standards of "A Guide to Standardized Highway Barrier Hardware" prepared and approved by the AASHTO-AGC-ARTBA Joint Cooperative Committee, Task Force 13 Report, Drawing SEW02a.

Existing materials damaged or lost during adjusting, removing and resetting, or removing, modifying, and resetting, shall be replaced by the Contractor without additional compensation. Existing guardrail posts and guardrail beams found to be unfit for reuse shall be replaced when directed by the Resident.

606.03 Posts Posts for guardrail shall be set plumb in holes or they may be driven if suitable driving equipment is used to prevent battering and distorting the post. When posts are driven through pavement, the damaged area around the post shall be repaired with approved bituminous patching. Damage to lighting and signal conduit and conductors shall be repaired by the Contractor.

When set in holes, posts shall be on a stable foundation and the space around the posts, backfilled in layers with suitable material, thoroughly tamped.

The reflectorized flexible guardrail markers shall be set plumb with the reflective surface facing the oncoming traffic. Markers shall be installed on the protected side of guardrail posts. Markers, which become bent or otherwise damaged, shall be removed and replaced with new markers.

Single wood posts shall be set plumb in holes and backfilled in layers with suitable material, thoroughly tamped. The Resident will designate the elevation and shape of the top. The posts, that are not pressure treated, shall be painted two coats of good quality oil base exterior house paint.

Single steel posts shall be set plumb in holes as specified for single wood posts or they may be driven if suitable driving equipment is used to prevent battering and distorting the post.

Additional bolt holes required in existing posts shall be drilled or punched, but the size of the holes shall not exceed the dimensions given in the Standard Details. Metal around the holes shall be thoroughly cleaned and painted with two coats of approved aluminum rust resistant paint. Holes shall not be burned.

606.04 Rails Brackets and fittings shall be placed and fastened as shown on the plans. Rail beams shall be erected and aligned to provide a smooth, continuous barrier. Beams shall be lapped with the exposed end away from approaching traffic.

End assemblies shall be installed as shown on the plans and shall be securely attached to the rail section and end post.

All bolts shall be of sufficient length to extend beyond the nuts but not more than ½ inch. Nuts shall be drawn tight.

Additional bolt holes required in existing beams shall be drilled or punched, but the size of the holes shall not exceed the dimensions given in the Standard Details. Metal around the holes shall be thoroughly cleaned and painted with two coats of approved aluminum rust resistant paint. Holes shall not be burned.

606.045 Offset Blocks The same offset block material is to be provided for the entire project unless otherwise specified.

606.05 Shoulder Widening At designated locations the existing shoulder of the roadway shall be widened as shown on the plans. All grading, paving, seeding, and other necessary work shall be in accordance with the Specifications for the type work being done.

606.06 Mail Box Post Single wood post shall be installed at the designated location for the support of the mailbox. The multiple mailbox assemblies shall be installed at the designated location in accordance with the Standard Details and as recommended by the Manufacturer. Attachment of the mailbox to the post will be the responsibility of the home or business owner.

606.07 Abraded Surfaces All galvanized surfaces of new guardrail and posts, which have been abraded so that the base metal is exposed, and the threaded portions of all fittings and fasteners and cut ends of bolts shall be cleaned and painted with two coats of approved rust resistant paint.

606.08 Method of Measurement Guardrail will be measured by the linear foot from center to center of end posts along the gradient of the rail except where end connections are made to masonry or steel structures, in which case measurement will be as shown on the plans. When connected to radius rail, measurement will be to the end of the last tangent beam.

Guardrail terminal, reflectorized flexible guardrail marker, terminal end, anchorage assembly, bridge transition, bridge connection, multiple mailbox post, and single post will be measured by each unit of the kind specified and installed.

Widened shoulder will be measured as a unit of grading within the limits shown on the plans.

Excavation in solid rock for placement of posts will be paid under force account unless otherwise indicated in the Bid Documents.

606.09 Basis of Payment The accepted quantities of guardrail will be paid for at the contract unit price per linear foot for the type specified, complete in place. Reflectorized beam guardrail (“butterfly”-type) delineators will not be paid for directly but will be considered incidental to guardrail items. Reflectorized flexible guardrail marker, terminal end, anchorage assembly, bridge transition, bridge connection, multiple mailbox post, and single post will be paid for at the contract unit price each for the kind specified complete in place.

Guardrail terminals will be paid for at the contract price each, complete in place which price shall be full payment for furnishing and installing all components including the terminal section, posts, offset blocks, "w" beam, cable foundation posts, plates and for all incidentals necessary to complete the installation within the limits as shown on the Standard Details or the Manufacturer’s installation instructions. Pay limits for a flared terminal will be 37.5 feet. Pay limits for a tangent terminal will be 50 feet. Each guardrail terminal will be clearly marked with the Manufacturer’s name and model number to facilitate any future needed repair. Such payment shall also be full compensation for furnishing all material, excavating, backfilling holes, assembling, and all incidentals necessary to complete the work, except that for excavation for posts or anchorages in solid ledge rock, payment will be made under 109.7.5 – Force Account. Type III Retroreflective Adhesive Sheeting shall be applied to the approach buffer end sections and sized to substantially cover the end section. On all roadways, the ends shall be marked with alternating black and retroreflective yellow stripes. The stripes shall be 3 in wide and sloped down at an angle of 45 degrees toward the side on which traffic is to pass the end section. Guardrail terminals shall also include a set of installation drawings supplied to the Resident.

Anchorage to bridge end posts will be part of the bridge work. Connections thereto will be considered included in the unit bid price for guardrail.

Guardrail to be placed on a radius of curvature of 150 ft or less will be paid for under the designated radius pay item for the type guardrail being placed.

Widened shoulder will be paid for at the contract unit price each complete in place and will be full compensation for furnishing and placing, grading and compaction of aggregate subbase and any required fill material.

Adjust guardrail will be paid for at the contract unit price per linear foot and will be full compensation for adjusting to grade. Payment shall also include adjusting guardrail terminals where required.

Modify guardrail will be paid for at the contract unit price per linear foot and will be full compensation for furnishing and installing offset blocks, additional posts, and other specified modifications; removing, modifying, installing, and adjusting to grade existing posts and beams; removing plate washers and backup plates, and all incidentals necessary to complete the work. Payment shall also include removing and resetting guardrail terminals where required.

Remove and Reset guardrail will be paid for at the contract unit price per linear foot and will be full compensation for removing, transporting, storing, reassembling all parts, necessary cutting, furnishing new parts when necessary, reinstalling at the new location, and all other incidentals necessary to complete the work. Payment shall also include removing and resetting guardrail terminals when required.

Remove, Modify, and Reset guardrail will be paid for at the contract unit price per foot and will be full compensation for the requirements listed in Modify guardrail and Remove and Reset guardrail.

Bridge Connections will be paid for at the contract unit price each. Payment shall include, attaching the connection to the endpost including furnishing and placing concrete and reinforcing steel necessary to construct new endposts if required, furnishing and installing the terminal connector, and all miscellaneous hardware, labor, equipment, and incidentals necessary to complete the work.

Bridge Transitions will be paid for at the contract unit price each. Payment shall include furnishing and installing the thrie beam or “w”-beam terminal connector, doubled beam section, and transition section, where called for, posts, hardware, precast concrete transition curb, and any other necessary materials and labor, including the bridge connection as stated in the previous paragraph.

No payment will be made for guardrail removed, but not reset and all costs for such removal shall be considered incidental to the various contract pay items.

Payment will be made under:

<u>Pay Item</u>		<u>Pay Unit</u>
606.1301	31” W-Beam Guardrail - Mid-Way Splice – Single Faced	Linear Foot
606.1302	31” W-Beam Guardrail - Mid-Way Splice – Double Faced	Linear Foot
606.1303	31” W-Beam Guardrail - Mid-Way Splice, 15’ Radius and Less	Linear Foot
606.1304	31” W-Beam Guardrail - Mid-Way Splice, Over 15’ Radius	Linear Foot
606.1305	31” W-Beam Guardrail - Mid-Way Splice Flared Terminal	Each
606.1306	31” W-Beam Guardrail - Mid-Way Splice Tangent Terminal	Each
606.1307	Bridge Transition (Asymmetrical) – Type IA	Each
606.1721	Bridge Transition - Type I	Each
606.1722	Bridge Transition - Type II	Each
606.1731	Bridge Connection - Type I	Each

606.1732	Bridge Connection - Type II	Each
606.178	Guardrail Beam	Linear Foot
606.25	Terminal Connector	Each
606.257	Terminal Connector - Thrie Beam	Each
606.259	Anchorage Assembly	Each
606.265	Terminal End-Single Rail - Galvanized Steel	Each
606.266	Terminal End-Single Rail - Corrosion Resistant Steel	Each
606.275	Terminal End-Double Rail - Galvanized Steel	Each
606.276	Terminal End-Double Rail - Corrosion Resistant Steel	Each
606.353	Reflectorized Flexible Guardrail Marker	Each
606.354	Remove and Reset Reflectorized Flexible Guardrail Marker	Each
606.356	Underdrain Delineator Post	Each
606.358	Guardrail, Modify	Linear Foot
606.362	Guardrail, Adjust	Linear Foot
606.365	Guardrail, Remove, Modify, and Reset	Linear Foot
606.366	Guardrail, Remove and Reset	Linear Foot
606.367	Replace Unusable Existing Guardrail Posts	Each
606.47	Single Wood Post	Each
606.48	Single Galvanized Steel Post	Each
606.50	Single Steel Pipe Post	Each
606.51	Multiple Mailbox Support	Each
606.568	Guardrail, Modify - Double Rail	Linear Foot
606.63	Thrie Beam Rail Beam	Linear Foot
606.64	Guardrail Thrie Beam - Double Rail	Linear Foot
606.65	Guardrail Thrie Beam - Single Rail	Linear Foot
606.66	Terminal End Thrie Beam	Each
606.70	Transition Section - Thrie Beam	Each
606.71	Guardrail Thrie Beam - 15 ft radius and less	Linear Foot
606.72	Guardrail Thrie Beam - over 15 ft radius	Linear Foot
606.73	Guardrail Thrie Beam - Single Rail Bridge Mounted	Linear Foot
606.74	Guardrail - Single Rail Bridge Mounted	Linear Foot
606.753	Widen Shoulder for Low Volume Guardrail End	Each
606.754	Widen Shoulder for Flared Guardrail Terminal	Each
606.78	Low Volume Guardrail End	Each
606.80	Buried-in-Slope Guardrail End	Each

SECTION 609 CURB

609.02 Materials Revise the paragraph beginning “The Contractor shall submit a concrete mix...” so that it reads:

“The Contractor shall submit a concrete mix design for the Portland Cement Concrete to the Resident, with a minimum designed compressive strength of 3000 psi concrete fill.”

609.03 Vertical Stone Curb, Terminal Section and Transition Sections and Portland Cement Concrete Curb, Terminal Sections and Transition Sections Revise this section by underlining the section number and title so that it reads in the spec book as:

“609.03 Vertical Stone Curb, Terminal Section and Transition Sections and Portland Cement Concrete Curb, Terminal Sections and Transition Sections”

Revise the last paragraph beginning with “The Contractor may elect...” so that it reads:

“The Contractor may elect to substitute concrete to backfill Stone Curbing or Stone Edging at their option. If the concrete backfill option is elected, the Concrete Fill shall meet the requirements of 609.02.”

SECTION 610

STONE FILL, RIPRAP, STONE BLANKET, AND STONE DITCH PROTECTION

610.02 Materials Amend this subsection by adding the following to the end of the material list:
“Stone Ditch Protection 703.29”

SECTION 618

SEEDING

618.08 Mulching Revise this Section so that the third sentence reads: “Mulch for Seeding Method Number 1 shall only be cellulous fiber mulch Section 619.04 (b) or straw mulch Section 619.04 (a).”

SECTION 619

MULCH

619.03 General Amend this Section by adding the following sentence to the end: **“Straw mulch shall be used in all wetland areas.”**

SECTION 626

FOUNDATIONS, CONDUIT, AND JUNCTION BOXES FOR HIGHWAY SIGNING, LIGHTING, AND SIGNALS

626.034 Concrete Foundations Revise this Section by changing ‘626.037’ to ‘**626.036**’ in the Second Paragraph which begins with “Foundations shall consist of cast-in-place...”.

Revise the 10th paragraph beginning with “Before placing concrete, the required elbows...” by removing “...in accordance with **Standard Specification 633.**”

626.036 Precast Foundations Revise the last sentence of paragraph one so that it reads:
“Construction of precast foundations shall conform to the Standard Details and all requirements of 712.061.”

SECTION 627 PAVEMENT MARKINGS

627.06 Application Revise this subsection by replacing the paragraph beginning with “ On other final pavement markings...” with the following:

“On other final pavement markings and on curb, where the paint is applied by hand painting or spraying, application shall be one uniform covering coat at least 16 mils thick. Before the paint has dried, the glass beads shall be applied by a pressure system that will force the glass beads onto the undried paint as uniformly as possible.

Painted lines and markings shall be applied in accordance with the manufacturer’s published recommendations. These recommendations will be supplied to the Resident prior to installation.”

SECTION 643 TRAFFIC SIGNALS

643.021 Materials Amend this subsection by adding the following at the end:

“MaineDOT is transitioning to MASH2016 criteria for Work Zone Traffic Control Devices on the following schedule:

Temporary Traffic Control Signals will be crash tested and/or evaluated to MASH2016 criteria by January 1, 2030. Current Category 4 devices in useful serviceable condition that are successfully tested to NCHRP Report 350 or MASH2009 criteria may be utilized through December 31, 2029.”

643.09 Service Connection Revise this subsection by removing the paragraph that begins with “Traffic signal services shall have...”.

And by removing the paragraphs beginning with “ A service ground rod shall be installed...” and “A total of 4, 10’ service...” and replace them with **“A total of 4, 10’ service ground rods shall be installed and properly connected together on the outside of the cabinet foundation. One ground rod shall be located at each corner and shall be either flush or slightly below finished grade. The connection between the ground rod and the ground wire shall be an exothermic connection such as a Cadweld. The ground wire from the interconnected ground rods shall be routed through a conduit in the foundation and into the base of the cabinet”**.

SECTION 645

HIGHWAY SIGNING

Section 645.023 Sign Support Structures. Under letter “c.”, revise the fifth paragraph beginning with “In addition to the required details...” by removing the words **”and foundation”** from the 5th sentence.

Section 645.08 Method of Measurement. Revise the second paragraph beginning with “Bridge-type, cantilever and...” by removing the words **”including the foundation”** .

Section 645.09 Basis of Payment. Revise the third paragraph beginning with “The accepted bridge-type, cantilever and...” by removing the word **”foundation”** from the second sentence. Add the following sentence to the end of the paragraph **”Conduits, Junction Boxes, and Foundations will be paid for under Section 626.”**

SECTION 652 MAINTENANCE OF TRAFFIC

Amend this Section by adding the following new subsection:

“652.2.6 Device Crashworthiness MaineDOT is transitioning to MASH2016 criteria for Work Zone Traffic Control Devices on the following schedule:

Category 1 (Cones, Drums, Tubular Markers, Flexible Delineators, and similar devices that have little chance of causing windshield penetration, tire damage, or other significant effect on the control or trajectory of a vehicle) – All Category 1 devices will be manufacturer self-certified as MASH2016 by January 1, 2025. Current Category 1 devices in useful serviceable condition that are not self-certified as MASH2016 compliant may be utilized through December 31, 2024.

Category 2 (Barricades, Portable Sign Supports, Category 1 devices with attachments, and similar devices that are not expected to produce significant vehicular velocity change but may be otherwise hazardous) – All Category 2 devices will be crash tested and/or evaluated to MASH2016 criteria by January 1, 2025. Current Category 2 devices in useful serviceable condition that are successfully tested to NCHRP Report 350 or MASH2009 criteria may be utilized through December 31, 2024.

Category 3 (Portable Concrete Barrier, Portable Crash Cushions, Truck Mounted Attenuators, Category 2 devices weighing more than 100 pounds, and similar devices that are expected to produce significant vehicular velocity change or other harmful reactions) – All Category 3 devices will be crash tested and/or evaluated to MASH2016 criteria by January 1, 2030. Current Category 3 devices in useful serviceable condition that are successfully tested to NCHRP Report 350 or MASH2009 criteria may be utilized through December 31, 2029. (See Standard Specification 526 for additional Portable Concrete Barrier information).

Category 4 (Trailer Mounted Devices: Arrow Boards, Temporary Traffic Control Signals, Area Lighting, Portable Changeable Message Sign, and other similar devices.) – All Category 4 devices will be crash tested and/or evaluated to MASH2016 criteria by January 1,

2030. Current Category 4 devices in useful serviceable condition that are successfully tested to NCHRP Report 350 or MASH2009 criteria may be utilized through December 31, 2029.”

652.4 Flaggers Revise the first paragraph of this section so that it reads:

“The Contractor shall furnish flaggers as required by the TCP or as otherwise specified by the Resident. All flaggers must have successfully completed a flagger test approved by the Department and administered by a Department-approved Flagger-Certifier who is employing that flagger. All flaggers must carry an official certification card with them while flagging that has been issued by their employer.”

SECTION 681

PRECAST AGGREGATE-FILLED, CONCRETE BLOCK GRAVITY WALL

681.08 Basis of Payment Amend this section by adding the Item Number “**681.10**” in front of the item “Precast Aggregate-Filled Concrete Block Gravity Wall” at the end of the section.

SECTION 703

AGGREGATES

Add the following to Section 703 - Aggregates

703.01 Fine Aggregate for Concrete Fine aggregate for concrete shall consist of natural sand or, when approved by the Resident, other inert materials with similar characteristics or combinations thereof, having strong, durable particles. Fine aggregate from different sources of supply shall not be mixed or stored in the same pile nor used alternately in the same class of construction or mix without permission of the Resident.

All fine aggregate shall be free from injurious amounts of organic impurities. Should the fine aggregate, when subjected to the colorimetric test for organic impurities, AASHTO T 21, produce a color darker than the reference standard color solution (laboratory designation Plate III), the fine aggregate shall be rejected.

Fine aggregate shall have a sand equivalent value of not less than 75 when tested in accordance with AASHTO T 176.

Fine aggregate sources shall meet the Alkali Silica Reactivity (ASR) requirements of Section 703.0201.

The fineness modulus shall not be less than 2.26 or more than 3.14. If this value is exceeded, the fine aggregate will be rejected unless suitable adjustments are made in proportions of coarse and fine aggregate. The fineness modulus of fine aggregate shall be determined by adding the cumulative percentages of material by weight retained on the following sieves: Nos. 4, 8, 16, 30, 50, 100 and dividing by 100.

Fine aggregate, from an individual source when tested for absorption as specified in AASHTO T 84, shall show an absorption of not more than 2.3 percent.

Sieve Designation	Percentage by Weight Passing Square Mesh Sieves
$\frac{3}{8}$ inch	100
No. 4	95-100
No. 8	80-100
No. 16	50-85
No. 30	25-60
No. 50	10-30
No. 100	2-10
No. 200	0-5.0

703.02 Coarse Aggregate for Concrete Coarse aggregate for concrete shall consist of crushed stone or gravel having hard, strong, durable pieces, free from adherent coatings and of which the composite blend retained on the $\frac{3}{8}$ inch sieve shall contain no more than 15 percent, by weight of flat and elongated particles when performed in accordance with test method ASTM D 4791, Flat Particles, Elongated Particles, or Flat and Elongated Particles in Coarse Aggregate, using a dimensional ratio of 1:5.

The coarse aggregate from an individual source shall have an absorption no greater than 2.0 percent by weight determined in accordance with AASHTO T 85 modified for weight of sample.

The composite blend shall have a Micro-Deval value of 18.0 percent or less as determined by AASHTO T 327 or not exceed 40 percent loss as determined by AASHTO T 96.

Coarse aggregate sources shall meet the Alkali Silica Reactivity (ASR) requirements of Section 703.0201.

Coarse aggregate shall conform to the requirements of the following table for the size or sizes designated and shall be well graded between the limits specified.

Sieve Designation	Percentage by Weight Passing Square Mesh Sieves			
	Grading A	AA	S	LATEX
Aggregate Size	1 inch	¾ inch	1½ inch	½ inch
2 inch			100	
1½ inch	100		95-100	
1 inch	95-100	100	-	
¾ inch	-	90-100	35-70	100
½ inch	25-60	-	-	90-100
⅜ inch	-	20-55	10-30	40-70
No. 4	0-10	0-10	0-5	0-15
No. 8	0-5	0-5	-	0-5
No. 16	-	-	-	-
No. 50	-	-	-	-
No. 200	0 - 1.5	0 - 1.5	0 - 1.5	0 - 1.5

703.0201 Alkali Silica Reactive Aggregates All coarse and fine aggregates proposed for use in concrete shall be tested for Alkali Silica Reactivity (ASR) potential under AASHTO T 303 (ASTM C 1260), Accelerated Detection of Potentially Deleterious Expansion of Mortar Bars Due to Alkali-Silica Reaction, prior to being accepted for use. Acceptance will be based on testing performed by an accredited independent lab submitted to the Department. Aggregate submittals will be required on a 5-year cycle, unless the source or character of the aggregate in question has changed within 5 years from the last test date.

As per AASHTO T 303 (ASTM C 1260): Use of a particular coarse or fine aggregate will be allowed with no restrictions when the mortar bars made with this aggregate expand less than or equal to 0.10 percent at 30 days from casting. Use of a particular coarse or fine aggregate will be classified as potentially reactive when the mortar bars made with this aggregate expand greater than 0.10 percent at 30 days from casting. Use of this aggregate will only be allowed with the use of cement-pozzolan blends and/or chemical admixtures that result in mortar bar expansion of less than 0.10 percent at 30 days from casting as tested under ASTM C 1567.

Acceptable pozzolans and chemical admixtures that may be used when an aggregate is classified as potentially reactive include, but are not limited to the following:

- a. Class F Coal Fly Ash meeting the requirements of AASHTO M 295
- b. Ground Granulated Blast Furnace Slag (Grade 100 or 120) meeting the requirements of AASHTO M 302
- c. Densified Silica Fume meeting the requirements of AASHTO M 307
- d. Lithium-based admixtures
- e. Metakaolin

Pozzolans or chemical admixtures required to offset the effects of potentially reactive aggregates will be incorporated into the concrete at no additional cost to the Department.

703.05 Aggregate for Sand Leveling Aggregate for sand leveling shall be sand of hard durable particles free from vegetable matter, lumps or balls of clay and other deleterious substances. The aggregate shall meet the grading requirements of the following table.

Sieve Designation	Percentage by Weight Passing Square Mesh Sieves
¾ inch	85-100
No. 200	0-5.0

703.06 Aggregate for Base and Subbase The following shall apply to Sections (a.) and (c.) below. The material shall have a Micro-Deval value of 25.0 or less as determined by AASHTO T 327. If the Micro- Deval value exceeds 25.0, the Washington State Degradation DOT Test Method T113, Method of Test for Determination of Degradation Value (January 2009 version) shall be performed, except that the test shall be performed on the portion of the sample that passes the ½ in sieve and is retained on the No. 10 sieve. If the material has a Washington Degradation value of less than 15, the material shall be rejected. The material used in Section (b.) below shall have a Micro-Deval value of 25.0 or less as determined by AASHTO T 327. If the Micro-Deval value exceeds 25.0 the material may be used if it does not exceed 25 percent loss on AASHTO T 96, Resistance to Degradation of Small-Size Coarse Aggregate by Abrasion and Impact in the Los Angeles Machine.

Recycled Asphalt Pavement (RAP) shall not be used for or blended with aggregate base or subbase.

- a. Aggregate for base, Type A and B shall be crushed ledge or crushed gravel of hard durable particles free from vegetable matter, lumps or balls of clay and other deleterious substances. The gradation of the part that passes a 3 inch sieve shall meet the grading requirements of the following table:

Sieve Designation	Percentage by Weight Passing Square Mesh Sieves	
	Type A	Type B
½ inch	45-70	35-75
¼ inch	30-55	25-60
No. 40	0-20	0-25
No. 200	0-6.0	0-6.0

At least 50 percent by weight of the material retained on the No. 4 sieve shall have at least one fractured face as tested by AASHTO T 335.

Type A aggregate for base shall only contain particles of rock that will pass the 2 inch square mesh sieve.

Type B aggregate for base shall only contain particles of rock that will pass the 4 inch square mesh sieve.

- b. Aggregate for base, Type C shall be crushed ledge or crushed gravel of hard durable particles free from vegetable matter, lumps or balls of clay and other deleterious substances. The material shall meet the grading requirements of the following table:

Sieve Designation	Percentage by Weight Passing Square Mesh Sieves	
	Type C	
4 inches	100	
3 inches	90-100	
2 inches	75-100	
1 inch	50-80	
½ inch	30-60	
No. 4	15-40	
No. 200	0-6.0	

At least 50 percent by weight of the material coarser than the No. 4 sieve shall have at least one fractured face as tested by AASHTO T 335.

- c. Aggregate for subbase shall be sand or gravel of hard durable particles free from vegetable matter, lumps or balls of clay and other deleterious substances. The gradation of the part that passes a 3 inch sieve shall meet the grading requirements of the following table:

Sieve Designation	Percentage by Weight Passing Square Mesh Sieves	
	Type D	Type E
½ in	35-80	
¼ inch	25-65	25-100
No. 40	0-30	0-50
No. 200	0-7.0	0-7.0

Type D aggregate for subbase gravel may contain up to 50 percent by weight Recycled Concrete Aggregate (RCA). When RCA is used, the portion of the resulting blend of gravel and RCA retained on a ½” square mesh sieve shall contain a total of no more than 5 percent by weight of other recycled materials such as brick, concrete masonry block, or asphalt pavement as determined by visual inspection.

RCA shall be substantially free of wood, metal, plaster, and gypsum board as defined in Note 9 in Section 7.4 of AASHTO M 319. RCA shall also be free of all substances that fall under the category of solid waste or hazardous materials.

Aggregate for subbase shall not contain particles of rock which will not pass the 6 inch square mesh sieve.

703.08 Recycled Asphalt Pavement Recycled asphalt pavement shall consist of salvaged asphalt materials from milled pavements or production waste that has been processed before use to meet the requirements of the job mix formula. It shall be free of winter sand, granular fill, construction debris, or other materials not generally considered asphalt pavement.

703.081 RAP for Asphalt Pavement Recycled Asphalt Pavement (RAP) may be introduced into hot-mix asphalt pavement at percentages approved by the Department according to the MaineDOT Policies and Procedures for HMA Sampling and Testing.

If approved by the Department, the Contractor shall provide documentation stating the source, test results for average residual asphalt content, and stockpile gradations showing RAP materials have been sized to meet the maximum aggregate size requirements of each mix designation. The Department will obtain samples for verification and approval prior to its use.

The maximum allowable percent of RAP shall be determined by the asphalt content, the percent passing the 0.075 mm sieve, the ratio between the percent passing the 0.075 mm sieve and the asphalt content, and Coarse Micro-Deval loss values as tested by the Department.

The maximum percentage of RAP allowable shall be the lowest percentage as determined according to Table 4 below:

Classification	Maximum RAP Percentage Allowed	Asphalt content standard deviation	Percent passing 0.075 mm sieve standard deviation	Percent passing 0.075 mm sieve / asphalt content ratio	Residual aggregate M-D loss value
Class III	10%	≤ 1.0	N/A	≤ 4.0	≤ 18
Class II	20%	≤ 0.5	≤ 1.0	≤ 2.8	
Class I	30%	≤ 0.3	≤ 0.5	≤ 1.8	

Table 4: Maximum Percent RAP According to Test Results

The Department will monitor RAP asphalt content and gradation during production by testing samples from the stockpile at approximately 15,000 T intervals (in terms of mix production). The allowable variance limits (from the numerical average values used for mix designs) for this testing are determined based upon the maximum allowable RAP percentage and are shown below in Table 5.

Table 5: RAP Verification Limits

Classification	Asphalt content (compared to aim)	Percent passing 0.075 mm sieve (compared to aim)
Class III	± 1.5	± 2.0
Class II	± 1.0	± 1.5
Class I	± 0.5	± 0.7

For specification purposes, RAP will be categorized as follows:

Class III – A maximum of 10.0 percent of Class III RAP may be used in any base, intermediate base, surface, or shim mixture. A maximum of 20.0 percent of Class III RAP may be used in hand-placed mixes for item 403.209.

Class II – A maximum of 20.0 percent Class II RAP in any base, binder, surface, or shim course.

Class I – A maximum of 20.0 percent Class I RAP may be used in any base, intermediate base, surface, or shim mixture without requiring a change to the specified asphalt binder. A maximum of 30.0 percent Class I RAP may be used in in any base or intermediate base mixture provided that a PG 58-28 or PG 58-34 asphalt binder is used. A maximum of 30.0 percent Class I RAP may be used in any surface or shim mixture provided that PG 58-34 asphalt binder is used. Mixtures exceeding 20.0 percent Class I RAP must be evaluated and approved by the Department.

The Contractor may use up to two different RAP sources in any one mix design. The total RAP percentage of the mix shall not exceed the maximum allowed for the highest classification RAP source used (i.e. if a Class I & Class III used, total RAP must not exceed 30.0%). The blended RAP material must meet all the requirements of the classification for which the RAP is entered (i.e. 10% Class III with 20% Class I, blend must meet Class I criteria). The Department may take belt cuts of the blended RAP to verify the material meets these requirements. If the Contractor elects to use more than one RAP source in a design, the Contractor shall provide an acceptable point of sampling blended RAP material from the feed belt.

In the event that RAP source or properties change, the Contractor shall notify the Department of the change and submit new documentation stating the new source or properties a minimum of 72 hours prior to the change to allow for obtaining new samples and approval.

SECTION 710 FENCE AND GUARDRAIL

710.06 Fence Posts and Braces Revise the first Paragraph so that it reads:

“Wood posts shall be of cedar, white oak, or tamarack or other AWPAs approved species, of the diameter or section and length shown on the plans.”

Remove the fourth paragraph which starts “ That portion of wood posts...”.

Revise the paragraph beginning with “Braces shall be of spruce, eastern hemlock ... so that it now reads:

“Braces shall be of spruce, eastern hemlock, Norway pine, pitch pine, or tamarack timbers or other AWPAs approved species, or spruce, cedar, tamarack or other AWPAs approved species round posts of sufficient length to make a diagonal brace between adjacent posts. All wood posts and braces shall be pressure-treated in accordance with AASHTO M 133 and AWPAs U1, UC4A Commodity Specification B: Posts. “

710.07 Guardrail Posts Revise this section so that the first sentence of section a. reads:

“a. Wood posts shall be of Norway pine, southern yellow pine, pitch pine, Douglas fir, red pine, white pine, or eastern hemlock or other AWPAs approved species.”

Revise the next paragraph so that it reads:

Wood posts and offset brackets shall be preservative treated in accordance with the requirements of AASHTO M 133 and AWPAs U1, UC4A Commodity Specification B: Posts.

SECTION 712 MISCELLANEOUS HIGHWAY MATERIAL

712.061 Structural Precast Units Amend this section by adding the following sentence to the end of the first paragraph of the Construction subsection:

“Facilities certified by NPCA or PCI shall provide to the Fabrication Engineer a copy of their annual audit to include deficiency reports and corrective actions.”

Revise this section by changing the letter “b” of ASTM C1611 of the Concrete Testing subsection so that it reads:

“b. Air content shall be 5.0% to 8.0%.”

SECTION 718
TRAFFIC SIGNALS MATERIAL

718.03 Signal Mounting Amend the paragraph beginning with “All trunions, brackets and...” by adding “**For polycarbonate signal heads with more than 3 sections or requiring mounting extensions greater than 12 inches in length, reinforcing plates shall be used to reinforce the housings at the point of attachment.**” to the end of the paragraph.

718.08 Controller Cabinet Revise this subsection by replacing the paragraph beginning with “The cabinet shall be supplied with LED light panels...” on or about page 7-66 with “**The cabinet shall be supplied with white LED light panels which shall automatically illuminate via a door open switch whenever one of the four main cabinet doors are opened for the ground mount cabinet or two main doors for the side of pole cabinet. The ground mounted cabinet shall contain four LED light panels per side totaling eight panels for the cabinet; one panel each at the top and bottom portion of the front side and back side on the Control side and Power/Auxiliary side of the cabinet. Each light panel shall produce a minimum of 250 lumens for a total minimum lumen output of 2000 lumens with all eight panels illuminated. The minimum output per side would be 1000 lumens. The LED panels shall be protected by a clear shatterproof shield. The side of pole mounted cabinet shall contain four light panels; one at the top of the rack assembly and one at the bottom rack assembly on each side of the cabinet. A second door open status switch per door shall activate a controller input to log a report event that one of the doors was opened. All door open status switches shall be connected to the same controller input. For the ground mount cabinet, there shall be two switches on each of the four main doors. For the side-of-pole mount cabinet, there shall be two switches on each of the two main doors.**”

Revise this subsection by replacing the paragraph beginning with “The cabinet shall be supplied with a generator panel ...” on or about page 7-68 with:

“The cabinet shall be supplied with a generator panel. The generator panel shall consist of a manual transfer switch and a twist-lock connector for generator hookup. The transfer switch knob and twist-lock connector shall be located inside a stainless steel enclosure with a separate lockable door accessed with a Corbin #2 key. The unit shall be mounted on the left, exterior of the control side wall of the ground mount cabinet a minimum of 36” above the surrounding grade and on the lower left side of the pole mounted cabinet. The generator transfer switch shall be a Reliance C30A1N Signa Series or approved equal. “

Revise this subsection by removing the following from the paragraph beginning with “The ground mounted cabinet shall be supplied and installed with an electric service meter socket trim and electrical service disconnect switch ...” on or about page 7-69: “**(removed: thus preventing that space from being used either by equipment supplied as part of the project, or future equipment that would be installed in the rack system. Joe indicated that he would add this language to the detail so it is covered.)**”.

Revise this subsection by replacing the following in the paragraph beginning with “The Contractor shall reconfigure the default user name...” on or around page 7-70; “MaineDOT IT” with “**MaineDOT Traffic Division**”.

In the paragraph beginning with “Tests shall be conducted by the contractor...” on or around page 7-73, amend this subsection by removing “**in the state of Maine and**” after “The facility shall be”.

Amend this Section by adding the following subsection:

718.13 Field Monitoring Unit (FMU) This item of work shall conform to this specification. This item shall consist of furnishing and installing a Field Monitoring Unit (FMU) and software, as well as all needed accessories required for a full and complete installation, including but not limited to power adapters, Ethernet cables, and interface cables, as described herein.

Where applicable, communications from MaineDOT’s cloud-based Central Management System (CMS) to the on-street traffic signal controllers shall be made through fiber optic interconnect cable connected back to existing internet connections and/or the Field Monitoring Unit (FMU). The Contractor shall furnish and install all materials necessary for a complete and operational fiber optic interconnection to all project intersections as shown on the plans. All connections to the CMS cloud-based system shall be via a secure VPN network.

The FMU shall be the only remote connection device used by isolated intersections to connect to the cloud-based system. All connections shall be encrypted VPN tunnels. The Contractor shall coordinate all configuration settings with MaineDOT IT and the Engineer.

The FMU central web based interface shall be a separate element from the CMS.

MATERIALS: The materials for this work shall conform to the following requirements:

1. The work under this item specifies the requirements for the FMU. The FMU shall operate independent of the brand/type of intersection controller deployed in the ATC traffic cabinet.
2. The FMU shall conform to the following requirements:
 - 2.1 The FMU shall function correctly between -34 degrees C and +74 degrees C.
 - 2.2 The FMU shall be provided with appropriately rated connectors that allows the FMU to be exchanged by unplugging connectors, without tools.
 - 2.3 The FMU shall monitor and log all ATC Controller and ATC cabinet faults and or alarms.
 - 2.4 The FMU shall be wired directly to the ATC cabinet.
 - 2.5 The FMU shall have an internal cellular modem running at 4G LTE.
 - 2.5.1 The Cellular modem shall be designed to be replaced / upgraded to 5G service when available.
 - 2.6 The FMU shall incorporate an integrated GPS and cell modem.
 - 2.7 The configuration of the FMU shall be accomplished by accessing the internal web server with a browser. It shall be possible to configure the FMU without any special software.

- 2.8 The FMU shall be powered via a standard 120V input power.
- 2.9 The FMU shall allow for the routing of the controller configuration packets to and from the controller (either by Ethernet or serial communications) for any type of controller utilized by the MaineDOT. In this way it shall be possible to configure the controller and utilize the controller specific software to interrogate the controller, and the FMU shall provide the communications pipe which allows this to be accomplished.
- 2.10 The FMU shall, within the size limitations above, include a battery and battery charging/monitoring circuit, to allow the FMU to function correctly even when all power to the intersection has failed. The battery shall continue to power the FMU for a minimum of 5 hours after all power has failed to the intersection.
- 2.11 The FMU shall incorporate an integrated GPS which will allow the FMU to geo-locate itself on the FMU management software map, without configuration.
- 2.12 The FMU shall operate without requiring a static IP address. The only configuration required at the FMU is to enter the URL of where the FMU management software is hosted.
- 2.13 In the event that the cell service is interrupted or is not available, the FMU shall store any events that occur in internal memory and forward these events automatically to the FMU management software when the cell service is restored. In this way, a complete record of events at the device can be maintained even if cell service is interrupted for a period. The system will store 5000 events.
- 2.14 The FMU shall utilize HTTP and HTTPS protocols, and XML data structures, for communication with the FMU management software. In this way the data will be open for future expansion and competition. The use of secret proprietary protocols is not permitted.
- 2.15 The FMU shall include Ethernet communications via an Ethernet Port with RJ45 connector.
- 2.16 The FMU shall include weather proof antennas.

3. Map Display FMU Management Software

- 3.1 The FMU shall include a scrollable, zoomable map display, with the intersections and other monitored devices shown as representative icons on the map. The map shall include the ability to see the intersections using Google Streetview.
- 3.2 The alarm status of the intersection shall be clearly indicated on the icon on the map, so that the user can see at a glance which intersections are in alarm.
- 3.3 The map display shall also include a list of intersections, with the number and priority of alarms indicated on the list. Intersections in high priority alarm shall be moved to the top

of the list, followed by medium priority, low priority and then finally by intersections not in alarm.

- 3.4 The icons shall change to be able to clearly indicate if an intersection is offline.
- 3.5 Clicking on the icon on the map shall expose a box with the current parameters of the intersection shown.
- 3.6 The default map display position and zoom shall be configurable by user, so that the user's view will default to show the intersections that the user is responsible for managing.
- 3.7 The map view shall have the ability to show Google traffic overlays on the map.

4. Intersection Detail Display FMU Management Software

- 4.1 It shall be possible to drill down, either from the map icon or from the list, to a device level detail for the intersection, which as a minimum shall display the following parameters:
 - 4.1.1 The alarm status, with priority indicated, and a text description of the alarm (if an alarm is present for this device).
 - 4.1.2 The time since the last communication with the device
 - 4.1.3 The following parameters (real time now values, minimum for the day values, maximum for the day values, and average for the day values)
 - 4.1.3.1 The AC mains voltage (value)
 - 4.1.3.2 The battery back-up voltage (value)
 - 4.1.3.3 The cabinet temperature (value)
 - 4.1.3.4 The cabinet humidity (value)
 - 4.1.3.5 The presence of AC power (OK or Fail)
 - 4.1.3.6 The flashing status of the intersection (OK or Flashing)
 - 4.1.3.7 Stop Time status (OK or Stop Time Active)
 - 4.1.3.8 The cabinet door status (Open or Closed)
 - 4.1.3.9 The intersection fan status (Fan On or Fan off)
 - 4.1.4 It shall be possible to view graphs of each of the value parameters in graphical form, over the recent two-week period. This includes real time graphs of:
 - 4.1.4.1 The AC mains voltage
 - 4.1.4.2 The battery back-up voltage
 - 4.1.4.3 The cabinet temperature

4.1.4.4 The cabinet humidity

5. **Diagnostics and Log Display FMU Management Software**

- 5.1 From the device level detail within the FMU management software, it shall be possible to drill down to get the raw data; the error logs; and the communications logs to allow a technician to fault-find problems.
- 5.2 It shall be possible to filter the logs by Device; by Device Type and/or by Group as well as between dates.
- 5.3 It shall be possible to print these selected logs to a local printer or a PDF file.
- 5.4 It shall be possible to export these logs to Excel on the local computer for further analysis.

6. **Alarms FMU Management Software**

- 6.1 The FMU management software shall have a comprehensive alarm generation capability
- 6.2 It shall be possible to configure alarms to be generated on any parameter becoming out of tolerance, including analog values, digital values and enumerated values.
- 6.3 Alarms shall be configurable to be of Low, High or Critical Priority.
- 6.4 The alarm priority shall be displayed throughout the FMU management software, on all displays, using color codes such as red-critical; yellow – high; and amber-low to indicate the priority of the alarm.
- 6.5 The current active alarms shall be accessible for view via an expandable window, to see which alarms are active and when the alarm occurred. The highest priority alarms shall rise to the top of the list.

7. **Alerts FMU Management Software**

- 7.1 The FMU management software shall have comprehensive alerting capability, to enable the response personnel to be notified when an abnormal situation has occurred.
- 7.2 It shall be possible to configure alerts to one or more personnel for each alarm. This will cause, as selected, an SMS and/or an email to be sent to the person when an alarm occurs.
- 7.3 The alert shall be configurable to optionally send via email and/or via SMS a message when an alarm clears.
- 7.4 The intention is that the FMU management software provides the alerts to the user in near real time. The SMS and email shall be issued within 30 seconds of the occurrence of event which results in an alert being issued.

8. **Hosting and Connectivity and Service FMU / FMU Management Software**

8.1 The contractor shall supply the FMU with the FMU manufacturers 10 year options for Connectivity and Service, as part of the purchase price. The Connectivity and Service agreement shall include at a minimum:

- 8.1.1 Cellular Connectivity
- 8.1.2 No cellular overage charges
- 8.1.3 Extended warranty on the hardware for the period of the Connectivity and Service Agreement
- 8.1.4 Over-the-air software updates
- 8.1.5 Over-the-air security updates
- 8.1.6 Future Connected Vehicles Service

SECTION 720 STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINAIRES AND TRAFFIC SIGNALS

720.12 Wood Sign Posts Revise the first sentence so that it reads:

Wood sign posts shall be rectangular, straight and sound timber, cut from live growing native spruce, red pine, hemlock, cedar trees or other AWPAs approved species, free from loose knots or other structurally weakening defects of importance, such as shake or holes or heart rot.

Revise the third paragraph that starts with “When pressure treated...” so that it reads:

All sign posts shall be pressure-treated in accordance with AASHTO M 133 and AWPAs Standard U1, UC4A, Commodity Specification A: Sawn Products.