




Canton Public Water Supply Elevation Contours & Potential Erodible Soils



5000 0 5000 10000 Feet

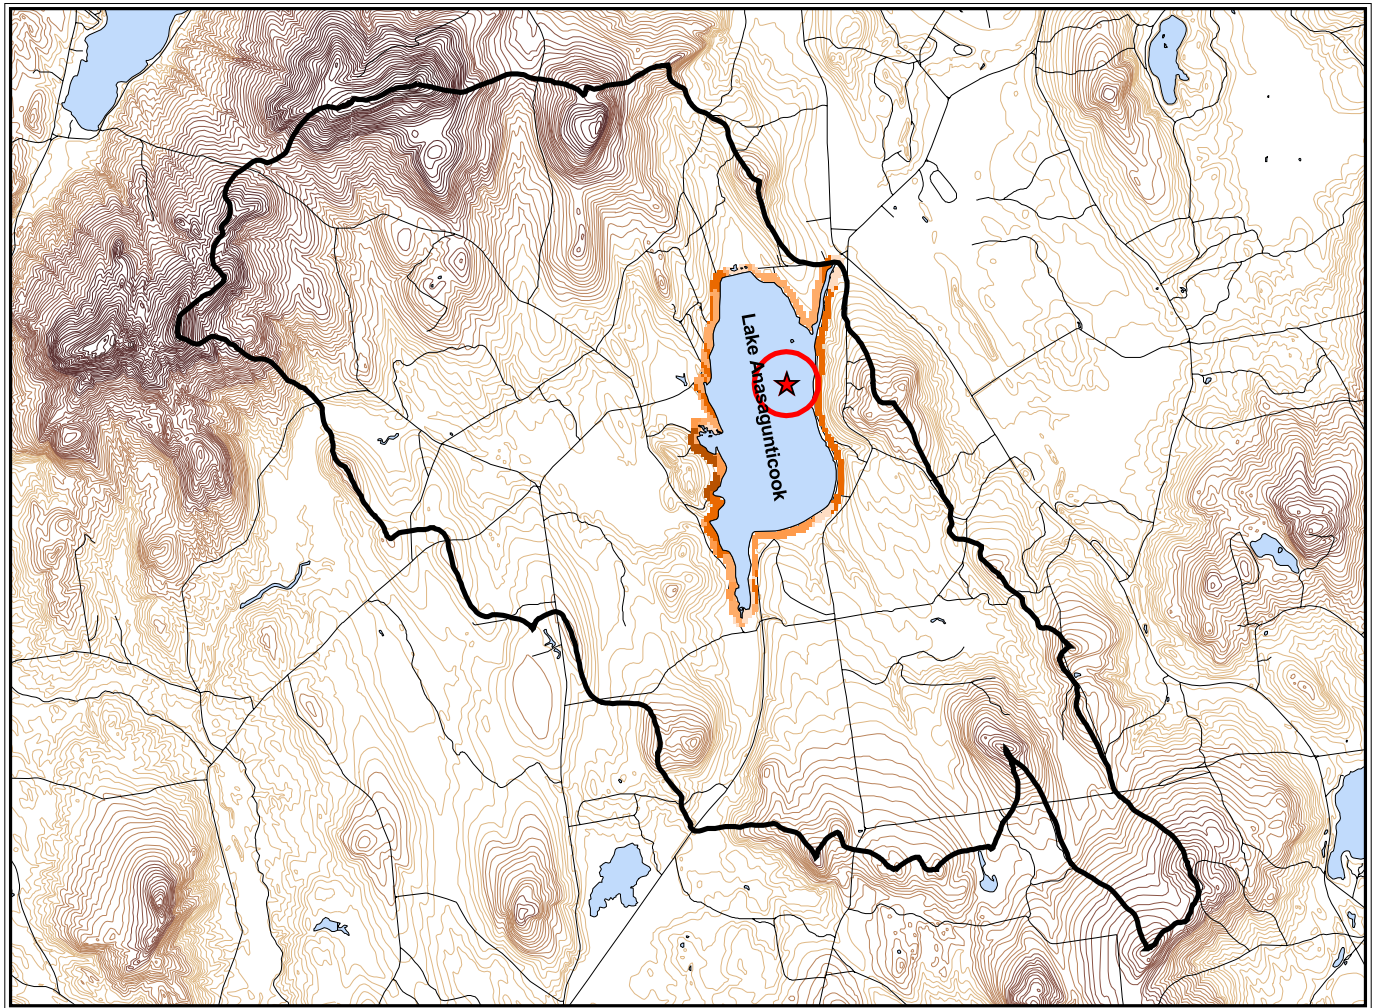

Legend

★	Canton Water District Intake	Erosion Potential	Elevation Contours	1561 - 2120
○	1000 ft. Intake Buffer	High	380 - 620	
○	Lake Anasagunticook Watershed Boundary	Medium	621 - 860	
○	Lakes & Ponds	Low	861 - 1180	
—	Public Roads		1181 - 1560	




Figure 4

Scale 1:72,000
1 inch = 6,000 feet

3/3/03

- 1) Base data layers are from the Maine Office of GIS.
- 2) Watershed boundary, intake and buffer locations are from the Maine Drinking Water Program.
- 3) Potential erodible soils identified through the Maine Source Water Assessment Program (SWAP).
- 4) Data are for planning purposes only.